


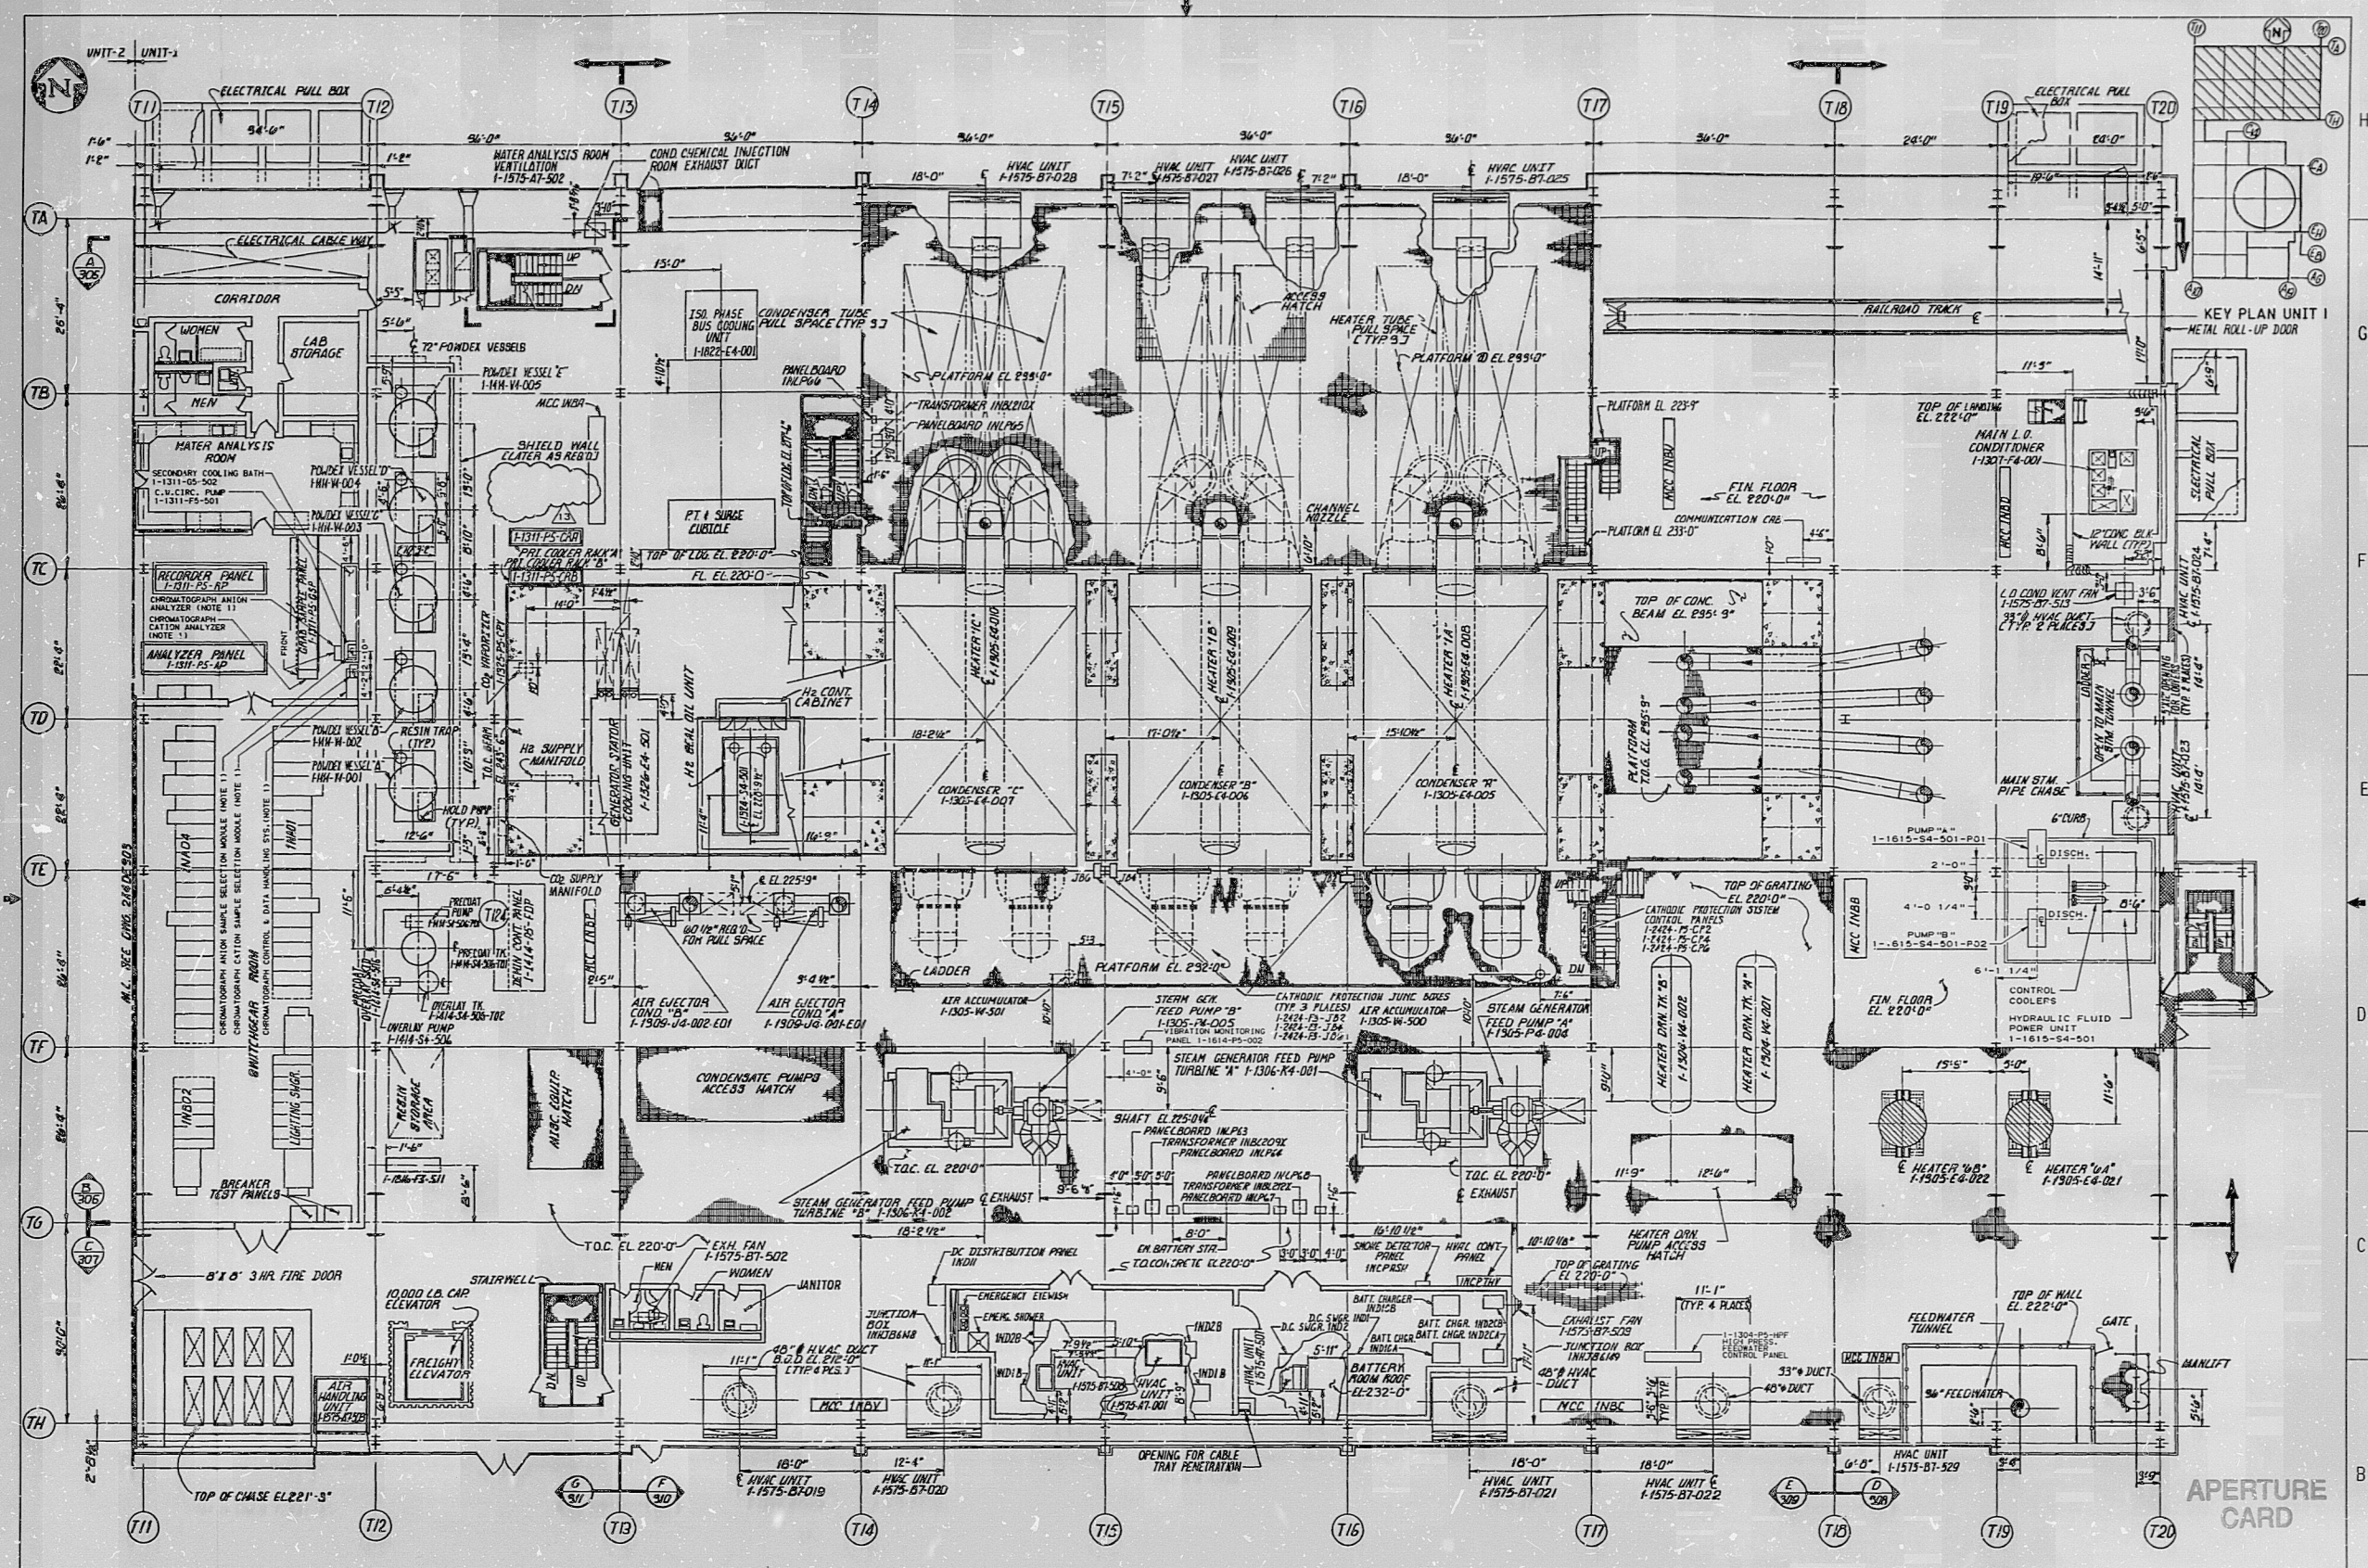

NOTES:
1. TPSS CHROMATOGRAPH ANALYTICAL PROCESS
ANALYZER (1-1311-PS-CPA) COMPONENT.


SOUTHERN COMPANY SERVICES, INC.
BIRMINGHAM, ALABAMA
GEORGIA POWER COMPANY
ALVIN W. VOGTLE NUCLEAR PLANT

TURBINE BLDG.
EQUIPMENT LOCATION PLAN
LEVEL 1, ELEV. 220'-0" TO 245'-0"

THIS DOCUMENT CONTAINS PROPRIETARY, CONFIDENTIAL, AND/OR TRADE SECRET INFORMATION OF THE SUBSIDIARIES OF THE SOUTHERN COMPANY OR OF THIRD PARTIES. IT IS INTENDED FOR USE ONLY BY EMPLOYEES OF, OR AUTHORIZED CONTRACTORS OF, THE SUBSIDIARIES OF THE SOUTHERN COMPANY. UNAUTHORIZED POSSESSION, USE, DISTRIBUTION, COPYING, DISSEMINATION, OR DISCLOSURE OF ANY PORTION HEREOF IS PROHIBITED.

INCORPORATED PER DCP 95-VAN0031
ISSUED FOR CONSTRUCTION
NO. 1
REVISIONS

SCALE: NONE
DRAWING NO. 1X4DE303
REV. 13
JOB NO. 10604
DATE OR CHK APPV DTL

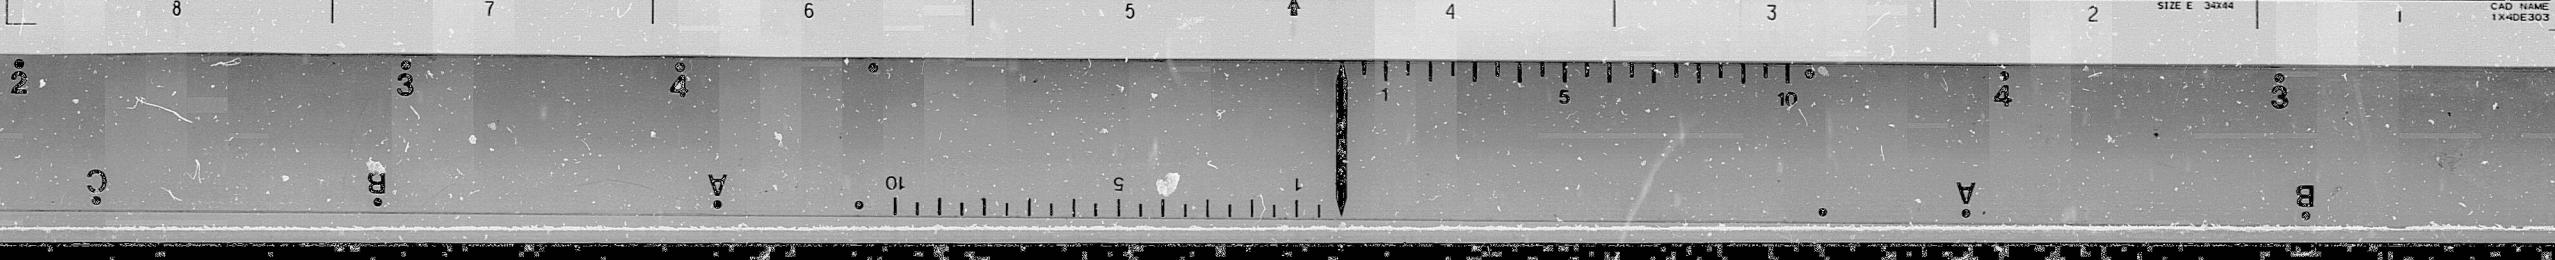

9910140014

PDR RIDS

9910140014

