


DRAWING NUMBER
FM-27B

YANKEE NUCLEAR CORPORATION
LOW PRESSURE SYSTEM

PLAN HOLD

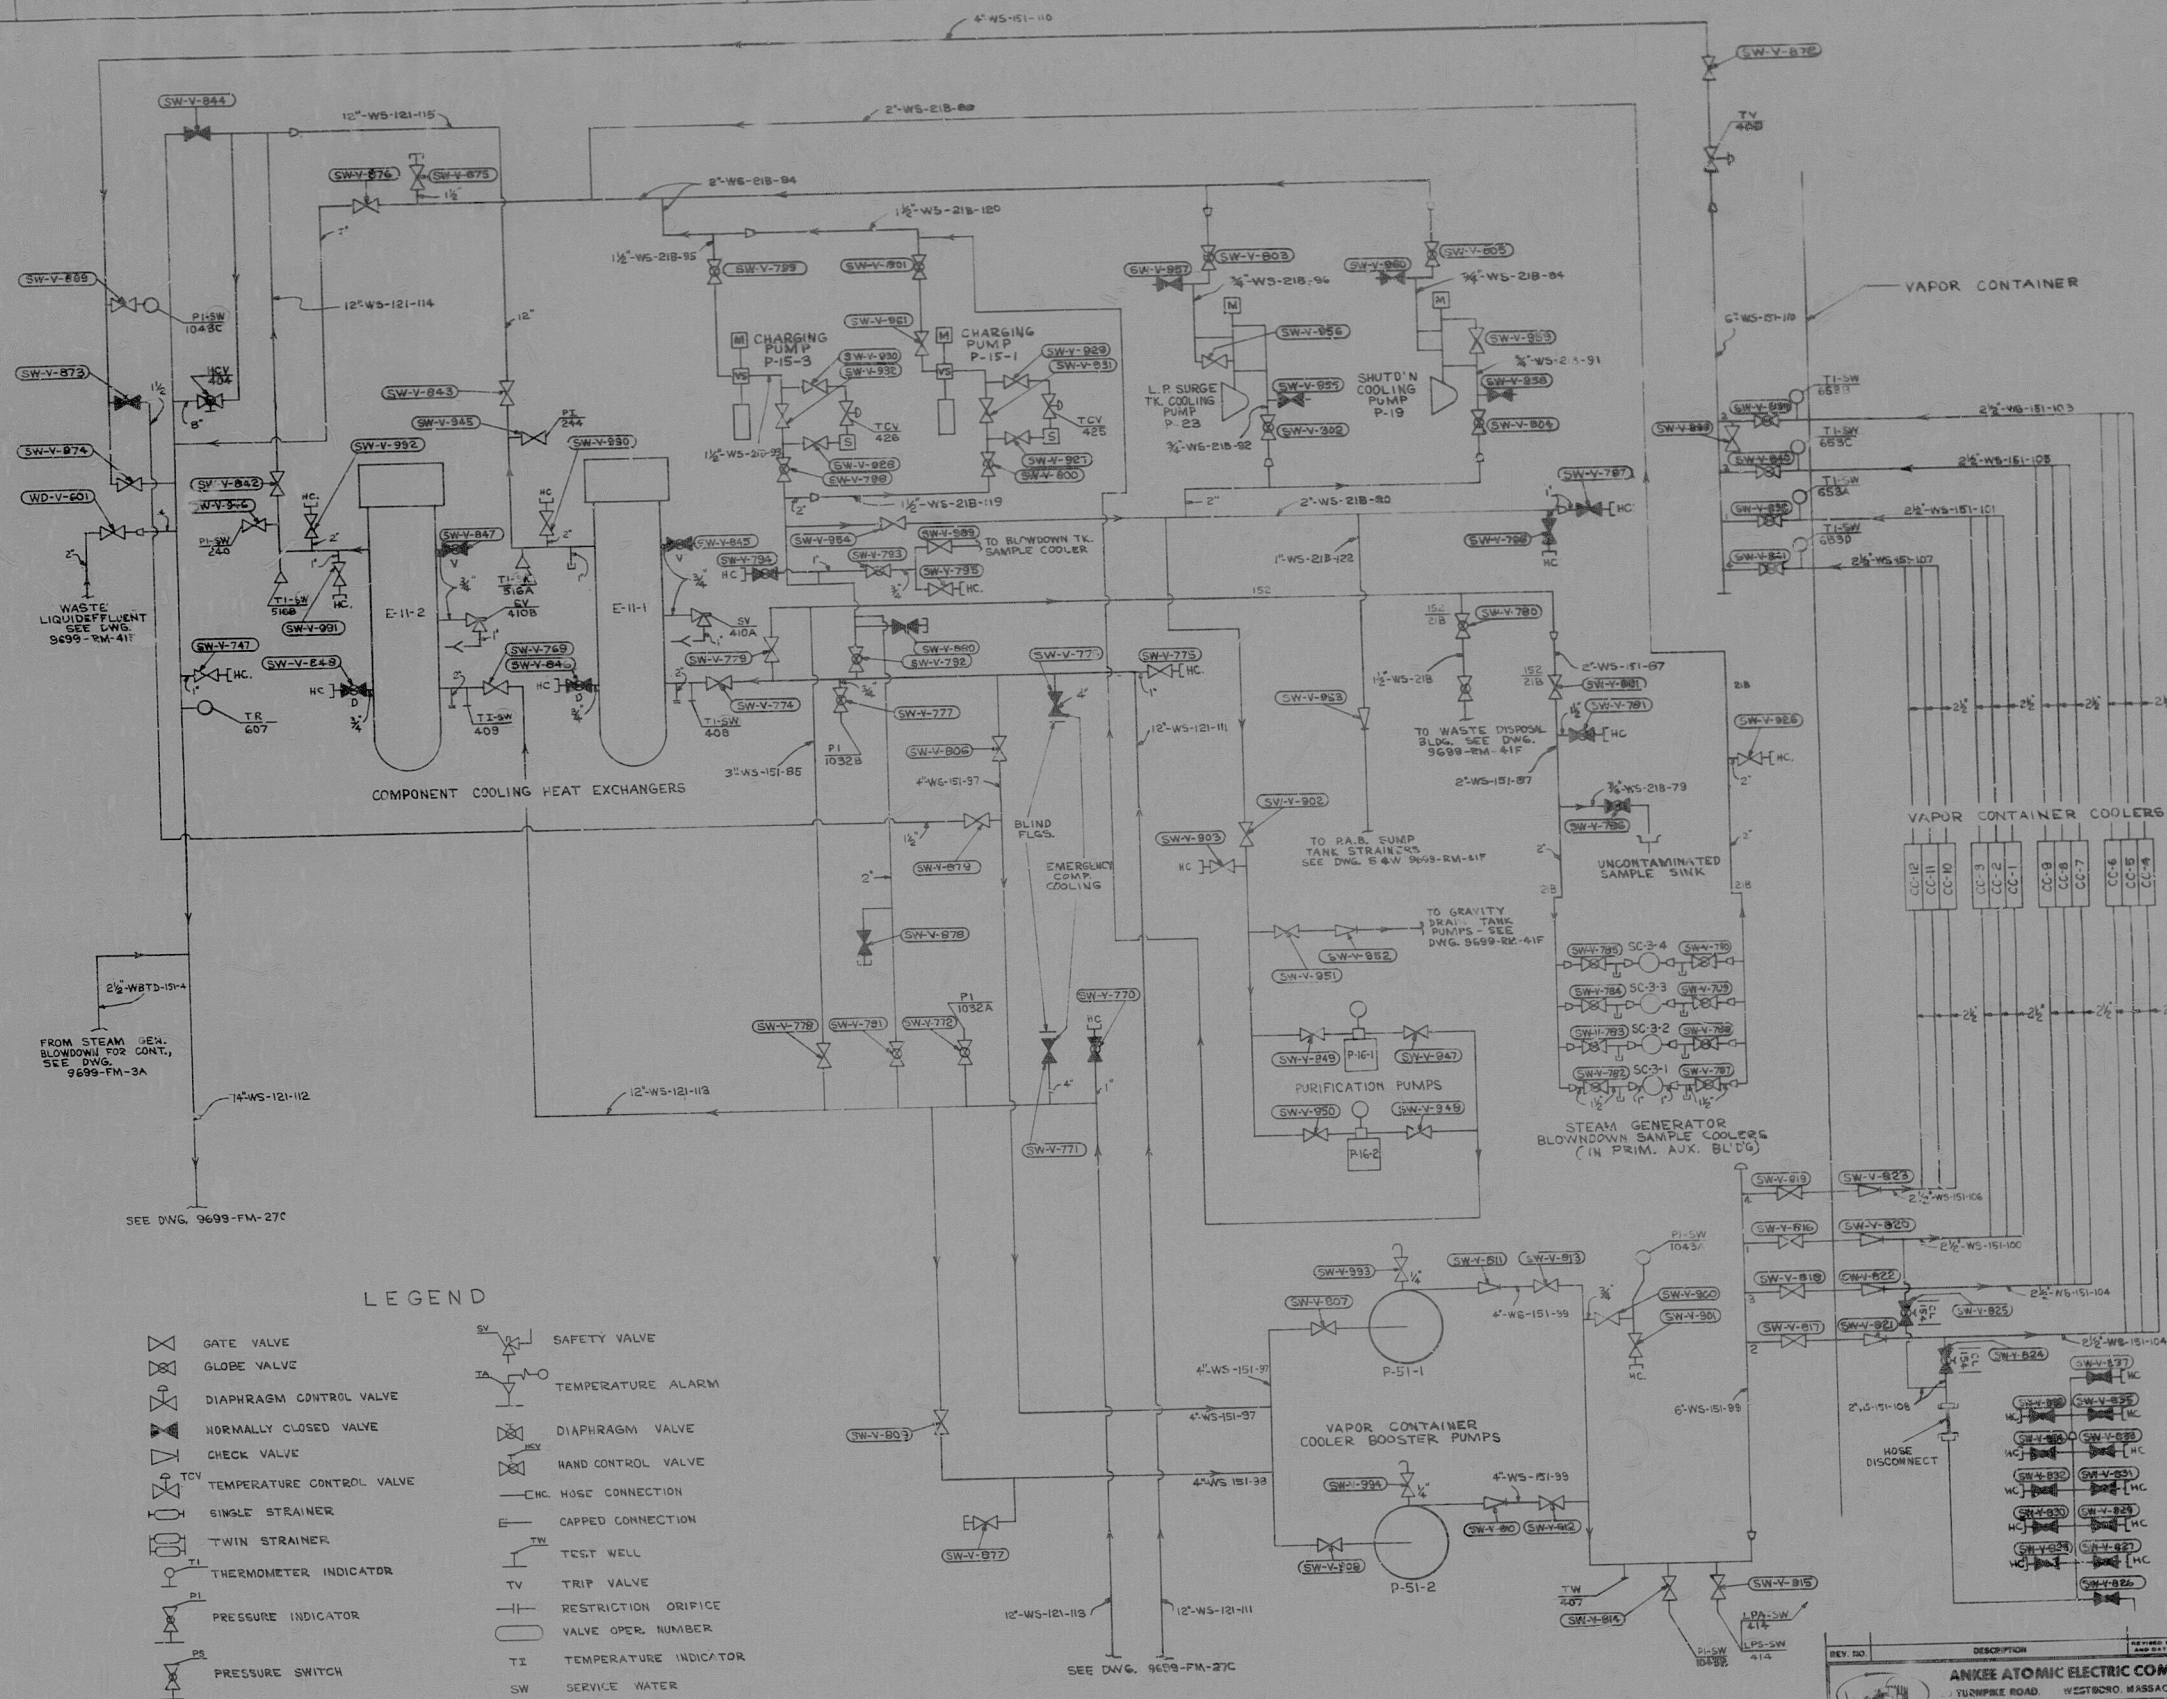

LEGEND

- | | | | |
|--|---------------------------|--|-----------------------|
| | GATE VALVE | | SAFETY VALVE |
| | GLOBE VALVE | | TEMPERATURE ALARM |
| | DIAPHRAGM CONTROL VALVE | | DIAPHRAGM VALVE |
| | NORMALLY CLOSED VALVE | | HAND CONTROL VALVE |
| | CHECK VALVE | | HOSE CONNECTION |
| | TEMPERATURE CONTROL VALVE | | CAPPED CONNECTION |
| | SINGLE STRAINER | | TEST WELL |
| | TWIN STRAINER | | TRIP VALVE |
| | THERMOMETER INDICATOR | | RESTRICTION ORIFICE |
| | PRESSURE INDICATOR | | VALVE OPER. NUMBER |
| | PRESSURE SWITCH | | TEMPERATURE INDICATOR |
| | | | SERVICE WATER |

THIS DWG. SUPERSEDES
9699-FM-27A REV. 14 IN PART.

REV.	NO.	DESCRIPTION	DATE	BY	CHKD.	APP'D.
1	1	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
2	2	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
3	3	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
4	4	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
5	5	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
6	6	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
7	7	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
8	8	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
9	9	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
10	10	REPLACED CARBON STEEL PIPING FOR STEAM GENERATOR BLOWDOWN. MODIFIED WITH COPPER TUBING PER PLS. MOD. 77-1-10-77.	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS

REV. NO.	DESCRIPTION	DATE	BY	CHKD.	APP'D.
1	ANKEE ATOMIC ELECTRIC COMPANY YANKEE ROAD, WESTBORO, MASSACHUSETTS NUCLEAR SERVICES DIVISION YANKEE ATOMIC ELECTRIC COMPANY RUME, MASS. LOW PRESSURE SYSTEM SERVICE WATER LINES SH. 1 PRIMARY PLANT	10-7-77	W. J. HARRIS	W. J. HARRIS	W. J. HARRIS
2					
3					
4					
5					
6					
7					
8					
9					
10					

9699

FM-27B

2FD SERV WTR LINES PRIM PL 1

DDA PID

NRCA ANPGF WA~~xxx~~

8104060124

