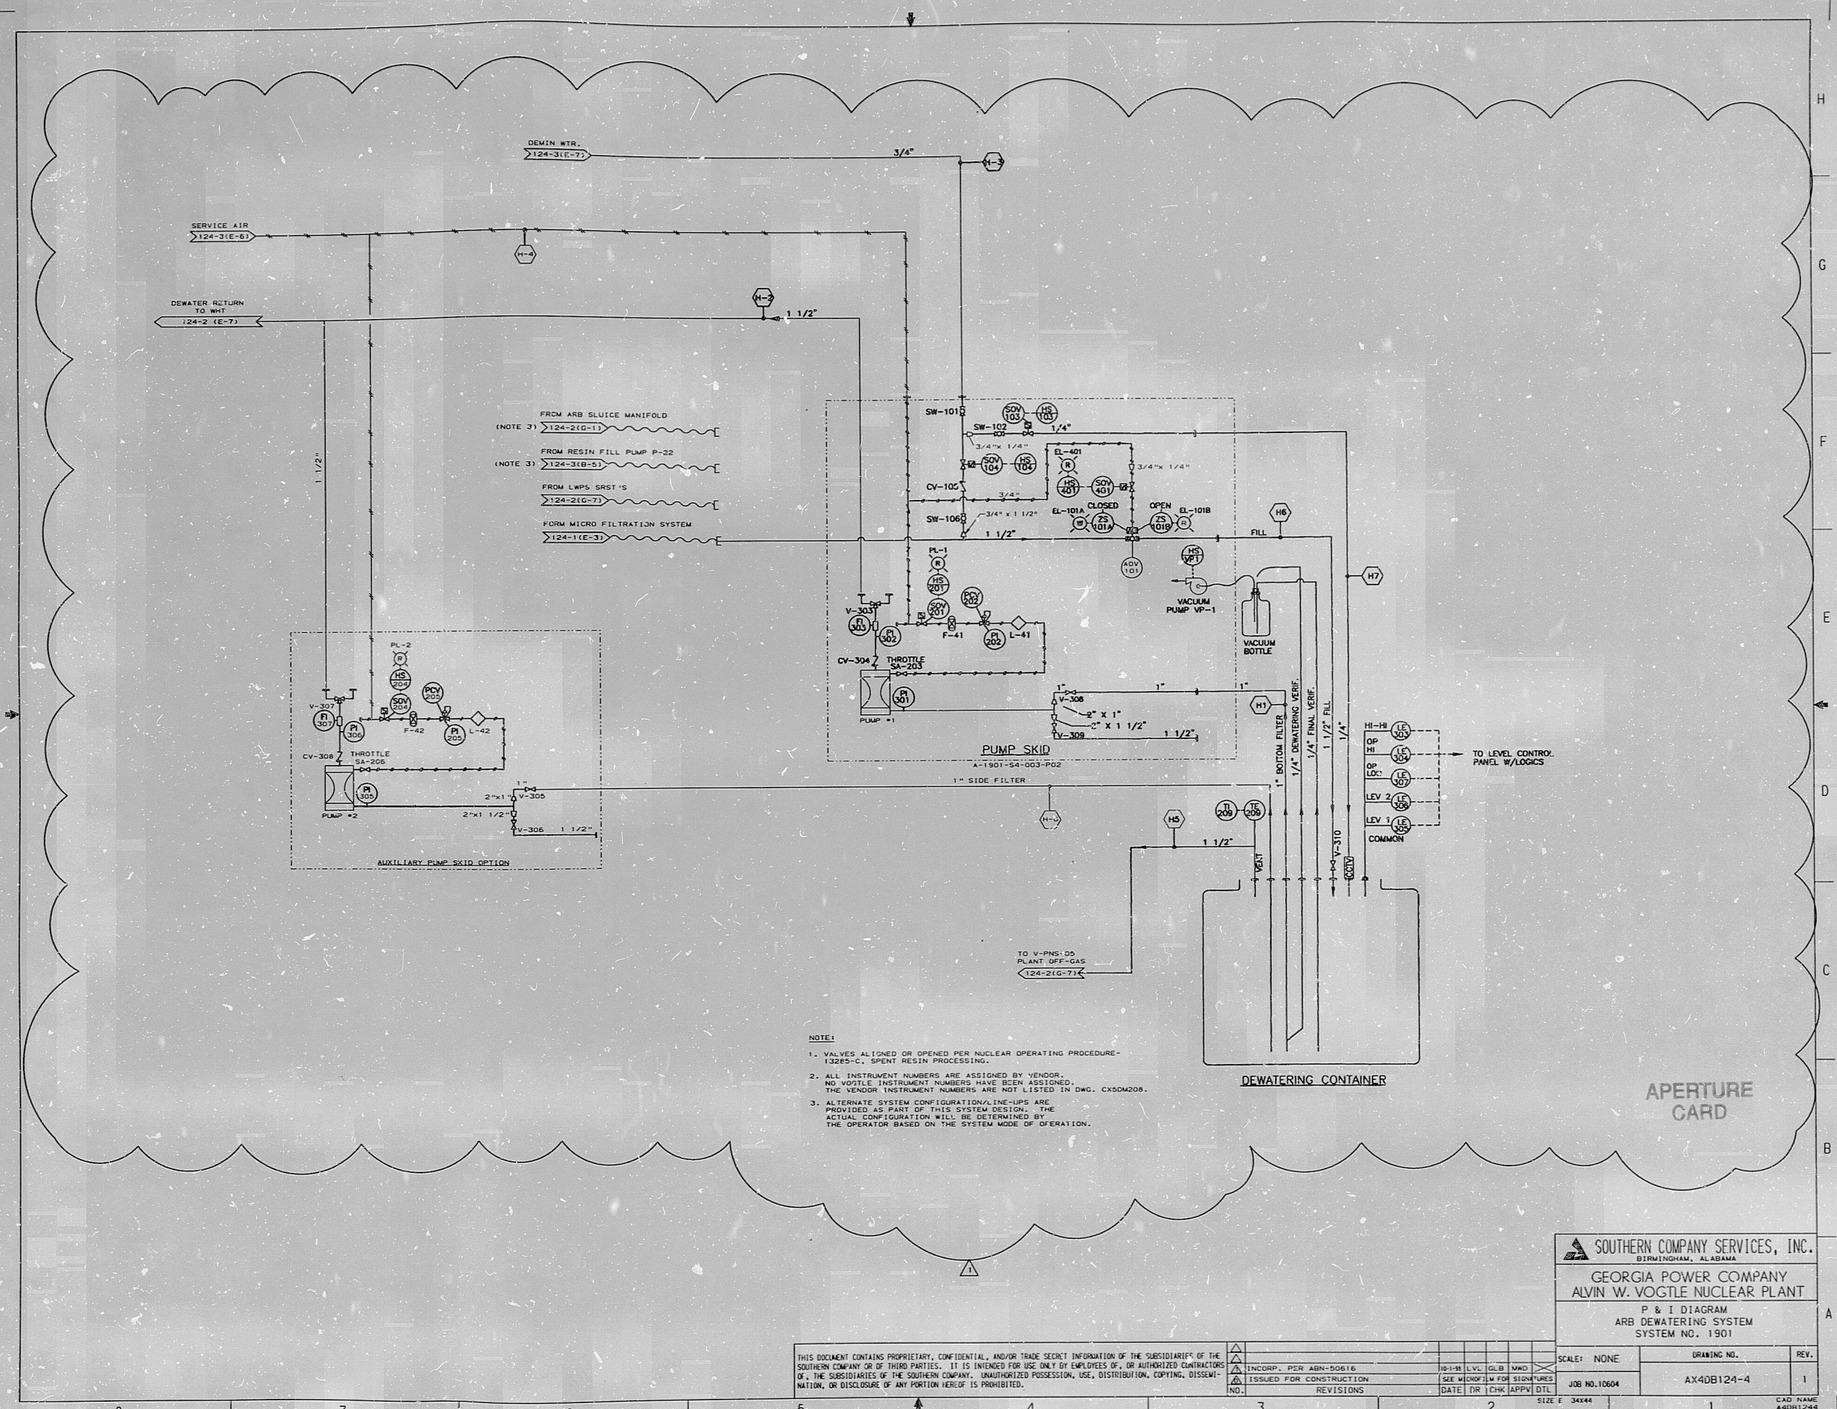

NOTE:

1. VALVES ALIGNED OR OPENED PER NUCLEAR OPERATING PROCEDURE-13265-C, SPENT RESIN PROCESSING.
2. ALL INSTRUMENT NUMBERS ARE ASSIGNED BY VENDOR. NO VOGTLE INSTRUMENT NUMBERS HAVE BEEN ASSIGNED. THE VENDOR INSTRUMENT NUMBERS ARE NOT LISTED IN DWG. CX5DM208.
3. ALTERNATE SYSTEM CONFIGURATION/LINE-UPS ARE PROVIDED AS PART OF THIS SYSTEM DESIGN. THE ACTUAL CONFIGURATION WILL BE DETERMINED BY THE OPERATOR BASED ON THE SYSTEM MODE OF OPERATION.

THIS DOCUMENT CONTAINS PROPRIETARY, CONFIDENTIAL, AND/OR TRADE SECRET INFORMATION OF THE SUBSIDIARIES OF THE SOUTHERN COMPANY OR OF THIRD PARTIES. IT IS INTENDED FOR USE ONLY BY EMPLOYEES OF, OR AUTHORIZED CONTRACTORS OF, THE SUBSIDIARIES OF THE SOUTHERN COMPANY. UNAUTHORIZED POSSESSION, USE, DISTRIBUTION, COPYING, DISSEMINATION, OR DISCLOSURE OF ANY PORTION HEREOF IS PROHIBITED.

NO.	REVISIONS	DATE	DR	CHK	APPV	DTL
3						
2						
1	INCORP. PER ABN-50616	10-1-91	LVL	GLB	MWD	
0	ISSUED FOR CONSTRUCTION	SEE W	CROFT	W FOR	SIGNATURES	

SOUTHERN COMPANY SERVICES, INC.
BIRMINGHAM, ALABAMA

GEORGIA POWER COMPANY
ALVIN W. VOGTLE NUCLEAR PLANT

P & I DIAGRAM
ARB DEWATERING SYSTEM
SYSTEM NO. 1901

SCALE: NONE	DRAWING NO.	REV.
JOB NO.10604	AX4DB124-4	1

SIZE E 34X44

CAD NAME A4DB1244

9910150027

PDR RIDS

[redacted]S

9910150027

[redacted]

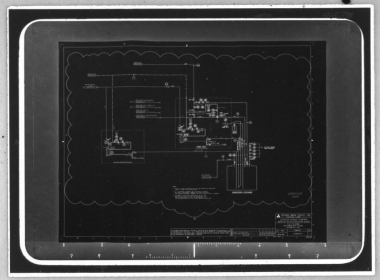

MMM 5824