


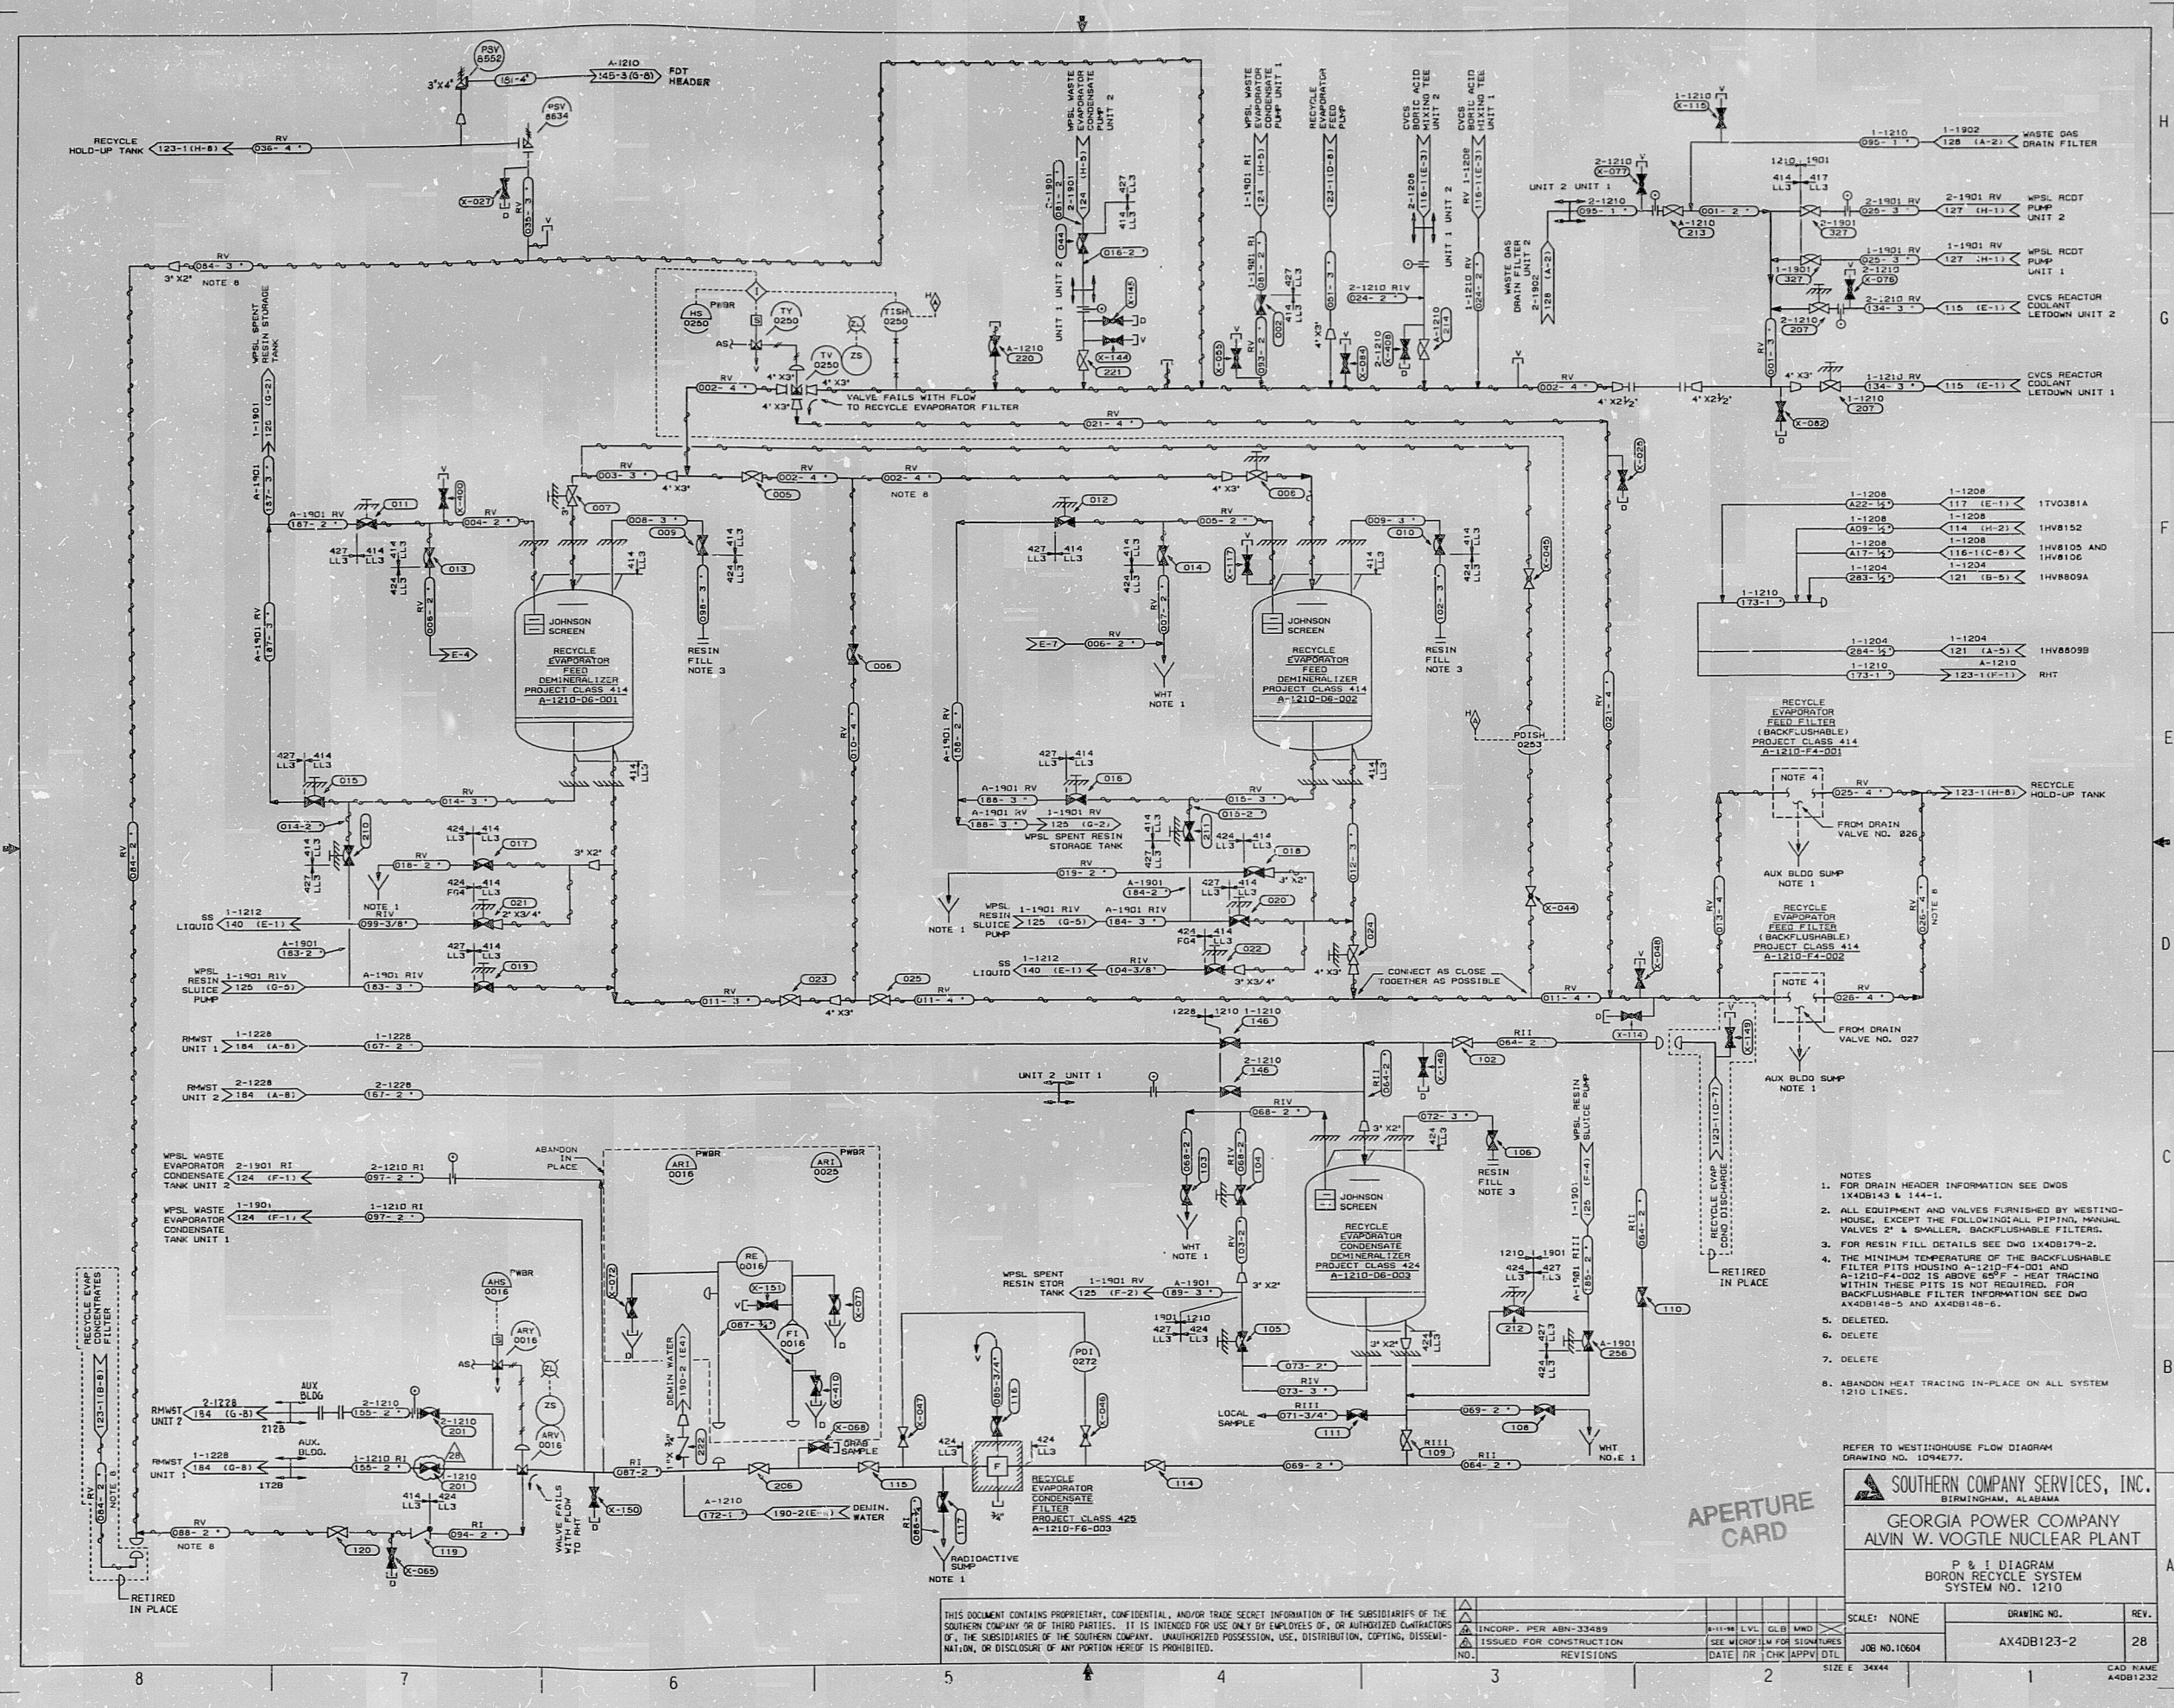

- NOTES
- 1. FOR DRAIN HEADER INFORMATION SEE DWG 1X40B143 & 144-1.
 - 2. ALL EQUIPMENT AND VALVES FURNISHED BY WESTINGHOUSE, EXCEPT THE FOLLOWING: ALL PIPING, MANUAL VALVES 2" & SMALLER, BACKFLUSHABLE FILTERS.
 - 3. FOR RESIN FILL DETAILS SEE DWG 1X40B179-2.
 - 4. THE MINIMUM TEMPERATURE OF THE BACKFLUSHABLE FILTER PITS HOUSING A-1210-F4-001 AND A-1210-F4-002 IS ABOVE 85°F. HEAT TRACING WITHIN THESE PITS IS NOT REQUIRED. FOR BACKFLUSHABLE FILTER INFORMATION SEE DWG 1X40B148-5 AND 1X40B148-6.
 - 5. DELETED.
 - 6. DELETE
 - 7. DELETE
 - 8. ABANDON HEAT TRACING IN-PLACE ON ALL SYSTEM 1210 LINES.

REFER TO WESTINGHOUSE FLOW DIAGRAM
DRAWING NO. 1094E77.

SOUTHERN COMPANY SERVICES, INC.
BIRMINGHAM, ALABAMA

GEORGIA POWER COMPANY
ALVIN W. VOGTLE NUCLEAR PLANT

P & I DIAGRAM
BORON RECYCLE SYSTEM
SYSTEM NO. 1210

APERTURE
CARD

THIS DOCUMENT CONTAINS PROPRIETARY, CONFIDENTIAL, AND/OR TRADE SECRET INFORMATION OF THE SUBSIDIARIES OF THE SOUTHERN COMPANY OR OF THIRD PARTIES. IT IS INTENDED FOR USE ONLY BY EMPLOYEES OF, OR AUTHORIZED CONTRACTORS OF, THE SUBSIDIARIES OF THE SOUTHERN COMPANY. UNAUTHORIZED POSSESSION, USE, DISTRIBUTION, COPYING, DISSEMINATION, OR DISCLOSURE OF ANY PORTION HEREOF IS PROHIBITED.

NO.	INCORP. PER ASN-33489	DATE	CHK	APPV	DLT
1	ISSUED FOR CONSTRUCTION				
2	REVISIONS				

SCALE: NONE	DRAWING NO. AX40B123-2	REV. 28
JOB NO. 10604	SIZE E 34X44	CAD NAME A40B1232

PDR R115

9910150029

99 10150029

SENSITIVE DATA

