


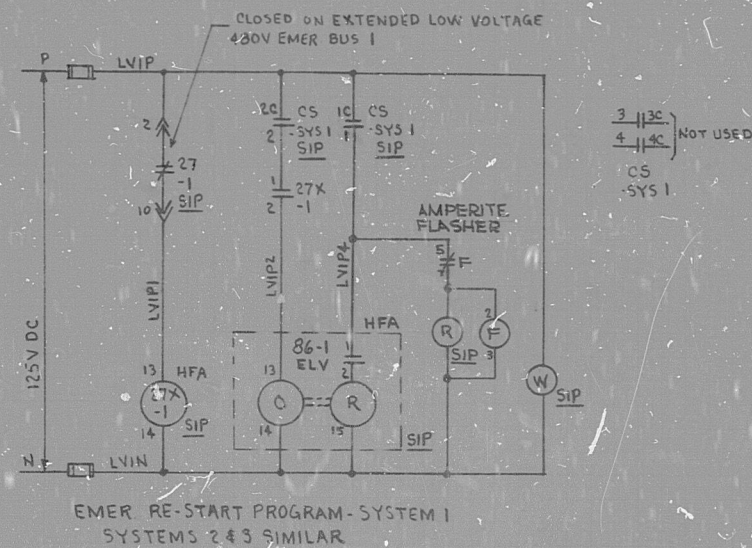

17 10 480V BUS TIE ACB 1A	37 140 HP SAFETY INJ PP1	57 160 MOV-22	77 180 MOV-532 ESK-GAA	3 14 HP SI PUMP TRIP	3 14 DIESEL START
17 18 480V BUS TIE ACB 1B	37 138 HP SAFETY INJ PP2	57 158 MOV-46	77 188 SOV-46 ESK-64B	5 16 LP SI PUMP CLOSE	5 16 BTIA TRIP
15 16 480V BUS TIE ACB 2A	35 136 HP SAFETY INJ PP3	55 156 MOV-4	75 176 SPARE	7 18 HP SI PUMP CLOSE	7 18 ETIB TRIP
13 14 480V BUS TIE ACB 2B	33 134 MOV-25	53 154 SPARE	73 174 SPARE	9 10 SPARE	9 10 EQ-1 CLOSE
11 12 480V BUS TIE ACB 3A	31 132 MOV-24	51 152 SPARE	71 172 SPARE	11 12 SPARE	11 12 INTLK. ESK-GA
9 10 480V BUS TIE ACB 3B	29 130 MOV-23 ESK-GAA	49 150 MOV-22	69 170 MOV-532 ESK-GAA	27X -1	86-1 ELV
7 8 LP SAFETY INJ PP1	27 128 MOV-25	47 148 MOV-46	67 168 SPARE		
5 6 LP SAFETY INJ PP2	25 126 MOV-24	45 146 MOV-4	65 166 SPARE		
3 4 LP SAFETY INJ FS 3	23 124 MOV-23	43 144 SPARE	63 164 SPARE		
1 2 SPARE	21 122 SPARE	41 142 SPARE	61 162 SPARE		

CS
-SYS 1
CONT
DIAG
"G"
3A
ESK

WESTINGHOUSE CO TYPE WL RELAY, GEAR OPERATED, 40 STAGE.

SIAS & SIAS
-A -B

CONT

CS	DIAG	ESK
-5451	"G"	3A

ELEMENTARY DIAGRAM	
AUTO START & EMER RE-START CKTS FOR SI-SYSTEMS	
YANKEE ATOMIC ELECTRIC COMPANY	
ROWE, MASS.	JO 11986
STOR & WEBSTER ENGINEERING CORPORATION 9699-ESK-11A-4	

7	6	5	4	3	2	1
			10/1/77 10-2-40 10-11-77 ETC 1-4-78 10-11-77	2-1-73 	1-4-70 	1-5-70 

9609- ESK-11A 4EL DIA AUTO ST&EMG RESTART

8104130302

DDA
NRCA ANPGF SF ϕ 45
EC ϕ 45

