



1691-321

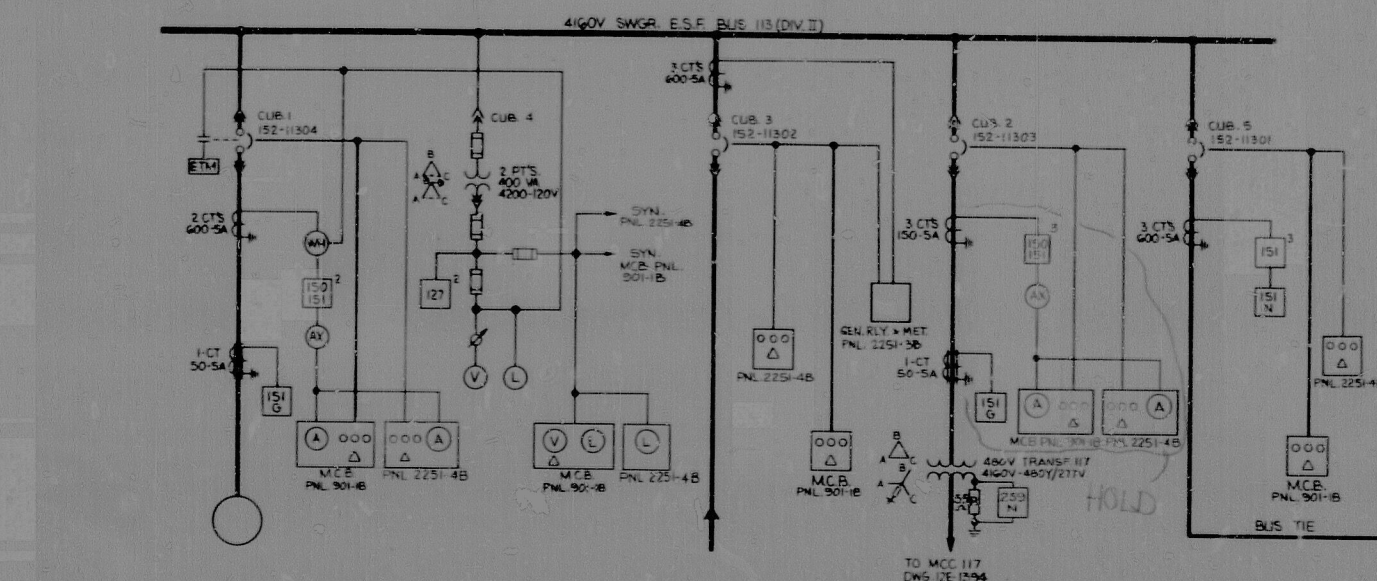

WIRING DIAGRAM	Later	Later	Later	Later	Later
SCHEMATIC DIAG.	12E-1421S	12E-1587	12E-1421R	12E-1421S	12E-1421R
KVA. OF TRANS.	3000HP	—	2000 KW	300 KVA	—
EXISTING BUS	1200	—	1200	1200	1200
SERVICE	HPCT PUMP	AUX. PT., INDIC. LIGHTS, METER & RELAY COMPARTMENT	HPCT DIESEL GENERATOR	TRANSFORMER 117 FEED TO 480V HPCT BLDG. MCC 117	BUS TIE
EQUIPMENT NO.	G-6101B	—	K-6101B	—	—

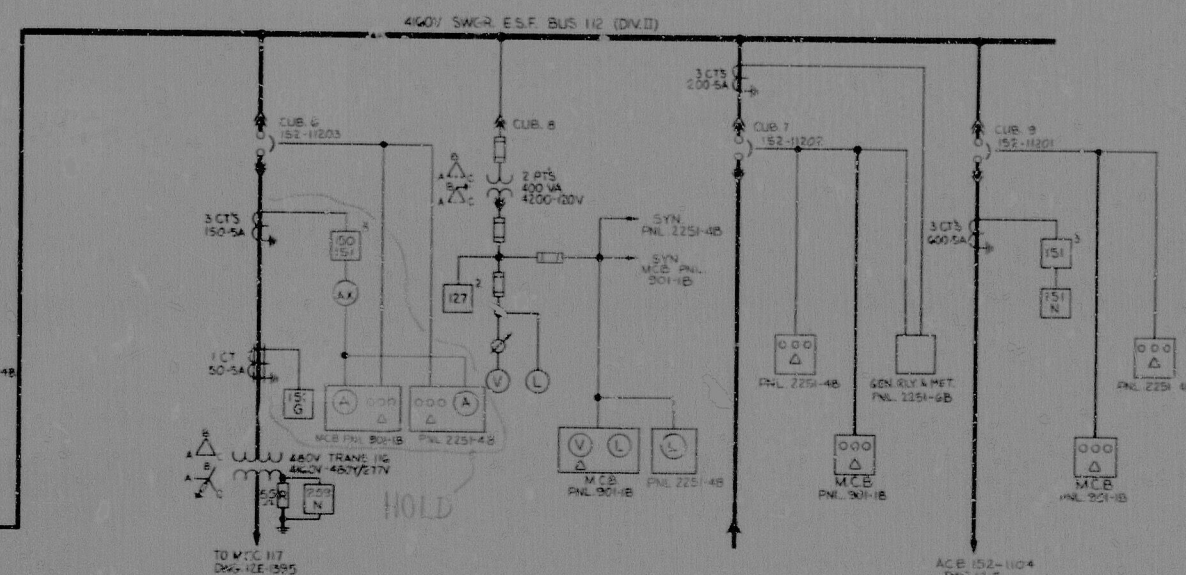

WIRING DIAGRAM	Later	Later	Later	Later
SCHEMATIC DIAG.	12E-1421P	12E-1386	12E-1421Q	12E-1421P
KVA. OF TRANS.	300 KVA	—	900 KW	—
EXISTING BUS	1200	—	1200	1200
SERVICE	TRANSFORMER 116 FEED TO 480V HPCT BLDG. MCC 117	AUX. PT., INDIC. LIGHTS, METER & RELAY COMPARTMENT	ESSENTIAL SERVICE DIESEL GENERATOR	FEED-480V TRANS. 119 (EXISTING 480V BUS 11) ACB 152-1104
EQUIPMENT NO.	—	K-6102B	—	—

REFERENCE DRAWINGS
 1/ SINGLE LINE DIAGRAM OF 480V SWGR
 E.S.F. BUS 112 & 113 - DWG 12E-1376

NOTE
 1/ FOR SYMBOLS AND DEVICE NUMBERS REFER TO
 561 STANDARDS EC-110, EC-111, & EC-115

ESF DIVISION II

NUCLEAR SAFETY RELATED
 EQUIPMENT IS SHOWN ON THIS DRAWING.

DRAWING RELEASE RECORD			DRAWN		REV.	DATE	DESCRIPTION	CHECKED	ENGR. APPROVAL
REV.	DATE	DESCRIPTION	RELEASED FOR CONSTRUCTION	DATE					
A	4-5-78	CONSTRUCTION							

SCALE: NONE	DRAWN: S. B. B. 12-78	SARGENT & LUNDY CHICAGO, ILLINOIS
CHECKED: S. B. B. 4-78	ENGINEER: S. B. B. 4-78	
APPROVED: S. B. B. 4-78	DRAWING NO. 12E-1391	
JOB NO. 4898		

24X

CAMERA OPERATOR


CWE1201

S04012E-1391

A 05AP76 X

DDAELE

8104210658

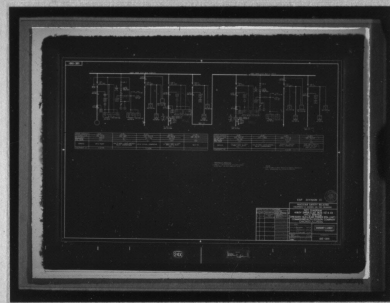

1391