


GEO PLANT VOGTLE CONSTR. MICROGRAPHICS
I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL
AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS
AN ACCURATE REPRODUCTION OF THE DOCUMENT SUBMITTED TO MICROGRAPHICS.

DATE 11/18/81
CAMERA OPERATOR [Signature]
SECTION SUPERVISOR [Signature]

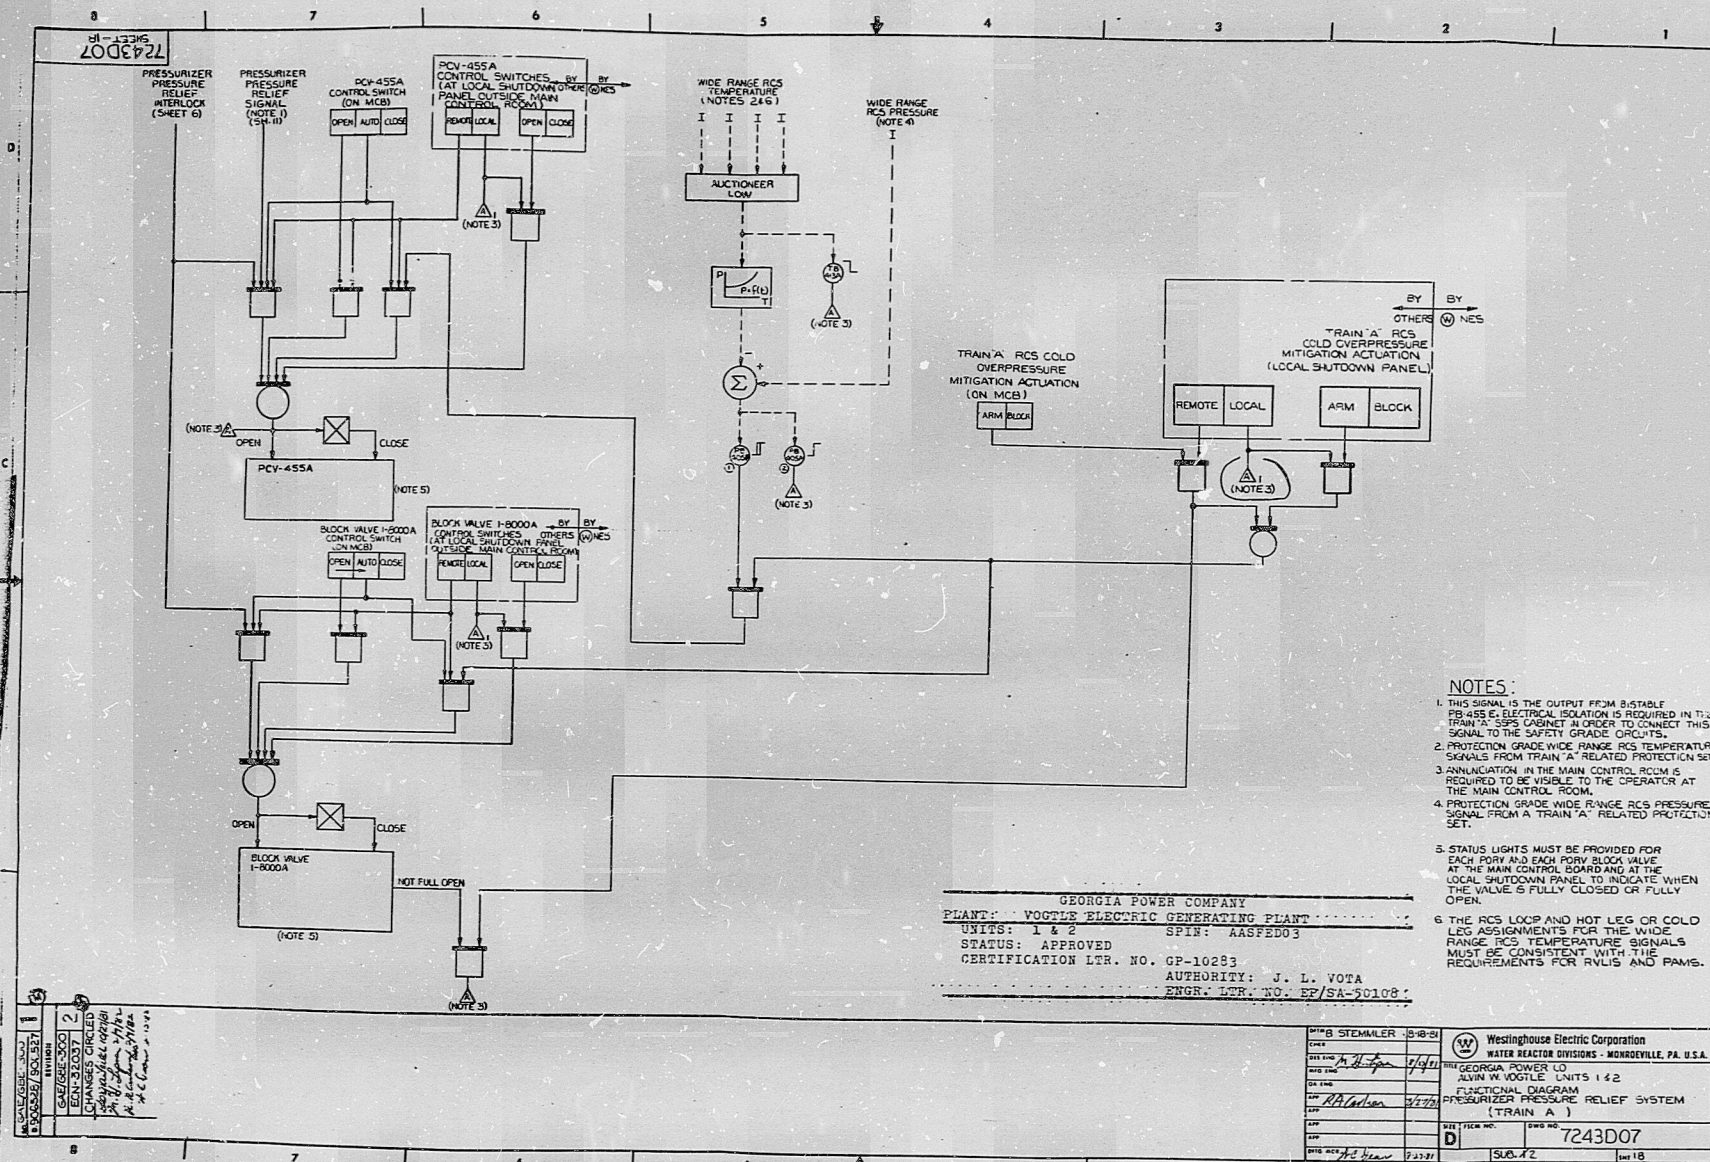

- NOTES:
- THIS SIGNAL IS THE OUTPUT FROM 8-STABLE P-RS 455 E. ELECTRICAL ISOLATION IS REQUIRED IN THE TRAIN 'A' SPS CANNOT A ORDER TO CHART THIS SIGNAL TO THE SAFETY GRADE CIRCUITS.
 - PROTECTION GRADE WIDE RANGE RCS TEMPERATURE SIGNALS FROM TRAIN 'A' RELATED PROTECTION USE ANNUNCIATION IN THE MAIN CONTROL ROOM IS REQUIRED TO BE VISIBLE TO THE OPERATOR AT THE MAIN CONTROL ROOM.
 - PROTECTION GRADE WIDE RANGE RCS PRESSURE SIGNAL FROM A TRAIN 'A' RELATED PROTECTION SET.
 - STATUS LIGHTS MUST BE PROVIDED FOR EACH P-RS IN 3 EACH P-RS BLOCK VALVE AT THE MAIN CONTROL BOARD AND AT THE LOCAL SHUTDOWN PANEL TO INDICATE WHEN THE VALVE IS FULLY CLOSED OR FULLY OPEN.
 - THE RCS LOCK AND HOT LEG OR COLO LEG ASSIGNMENTS FOR THE WIDE RANGE RCS TEMPERATURE SIGNALS MUST BE CONSISTENT WITH THE REQUIREMENTS FOR RVLS AND PAMS.

APERTURE CARD

MICROFILM QUALITY ACCEPTABLE

VOGTLE ELECTRIC GENERATING PLANT		JOB NO. 9518
EQUIPMENT TAG NO.		122
STARTUP DESIGNATION NO.		122
ACTIVITY NO.		122
SYSTEM NO.		122
CATEGORY NO.		122
RETROFITTING REQUIRED		☐ YES ☒ NO
DISTRIBUTION TO: FOR REVIEW		INFO
• MECHANICAL		
• HVAC		
• NSS		
• BOP		
• CONTROL SYSTEMS		
• ELECTRICAL		
• WIRING		
• CONDUIT		
• HAZARDS		
• CIVIL/STRUCTURAL		
• NUCLEAR		
• STRESS/PLANT DESIGN		
• CODES AND STANDARDS		
• ARCHITECTURAL		
• STARTUP		
• CONSTRUCTION		
• NOT REQ'D BY ENGRS		
• CLIENT		
• EQUIP. QUALIFICATION		
• M & QS		
• WESTINGHOUSE		
IDENTIFYING TITLE OF THIS DOCUMENT:		Functional Diagram
Sheet Log No.		102237
1 XCA102-499-12		
IMPORTANT		
Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods or materials developed or selected by the supplier and does not relieve supplier from full compliance with contract obligations.		
DATE RECEIVED 1-9-86		SIGNED [Signature]
DOCUMENT STATUS		
• WORK MAY PROCEED		
• REVISE AND RESUBMIT		
• WORK MAY PROCEED SUBJECT TO INCORPORATION		
• REVISE AND RESUBMIT		
• WORK MAY NOT PROCEED		
• INFORMATION ONLY		
• DISTRIBUTION REQUIRED		
• MICROFILM QUALITY ACCEPTABLE		
• MICROFILM QUALITY ACCEPTABLE		

SUPERSEDES LOG NO. 112V6DPA03-4436

9910180195

PDR RIDS

9910180195

