NPR 2

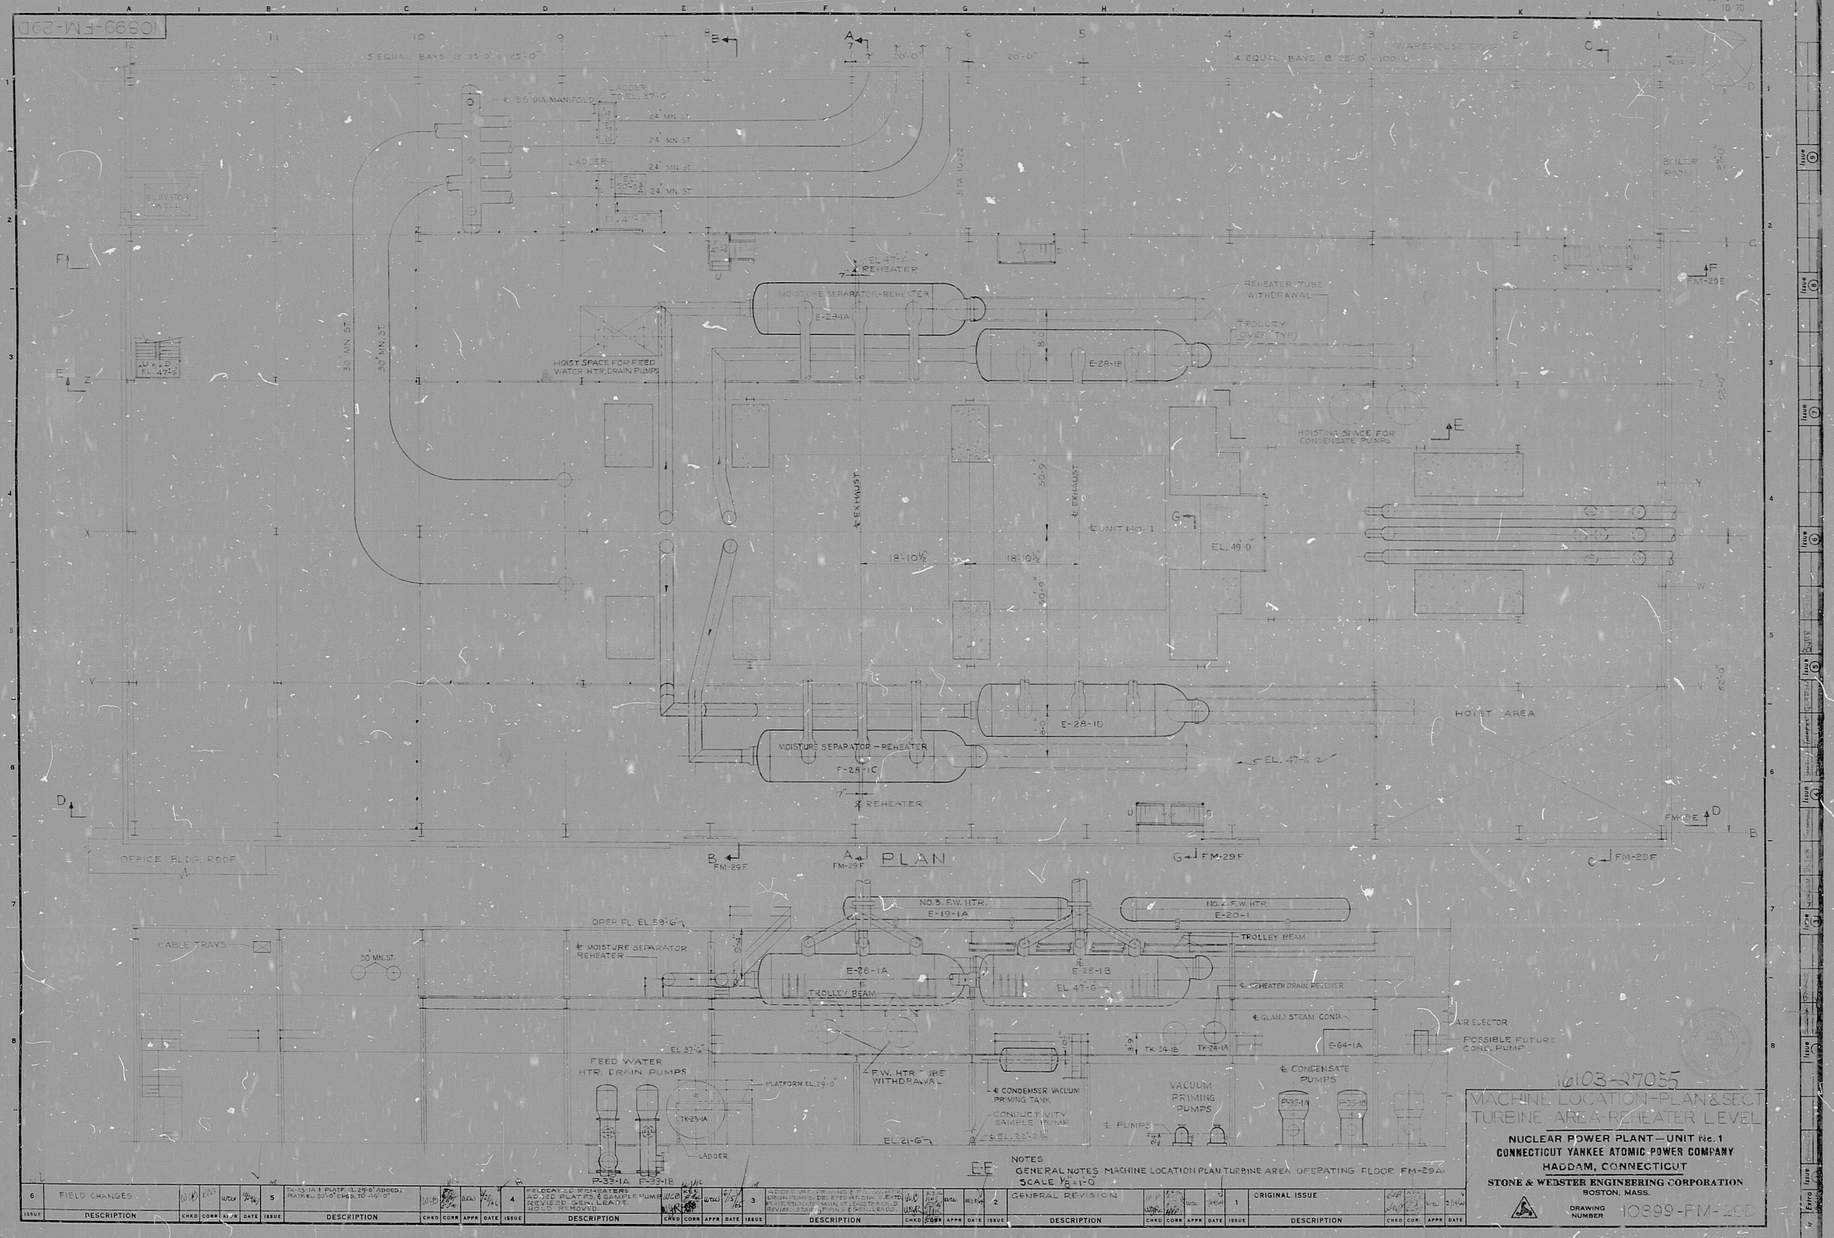
PLAN
MOISTURE SEPARATOR-REHEATER
E-28-1A
E-28-1B
E-28-1C
E-28-1D
REHEATER
HOIST SPACE FOR FEED WATER HTR. DRAIN PUMPS
HOISTING SPACE FOR CONDENSATE PUMPS
HOIST AREA
UNIT No. 1
EXHAUST
OFFICE BLDG. ROOF
CABLE TRAYS
NO. 3 F.W. HTR.
E-19-1A
NO. 4 F.W. HTR.
E-20-1
TROLLEY BEAM
E-26-1A
E-22-1B
E-64-1A
FEED WATER HTR. DRAIN PUMPS
F.W. HTR. TUBE WITHDRAWAL
CONDENSER VACUUM PRIMING TANK
VACUUM PRIMING PUMPS
CONDENSATE PUMPS
AIR EJECTOR
POSSIBLE FUTURE COND. PUMP
GLAND STEAM COND.
HEATER DRAIN RECEIVER
PLATFORM EL. 29'-0"
LADDER
EL. 47'-6"
EL. 49'-0"
EL. 61'-6"
OPER. FL. EL. 59'-6"
30 MN. ST.
24" MN. ST.
NOTES
GENERAL NOTES MACHINE LOCATION PLAN TURBINE AREA OPERATING FLOOR FM-29A
SCALE 1/8"=1'-0"
6103-27055
MACHINE LOCATION-PLAN & SECT.
TURBINE AREA-REHEATER LEVEL
NUCLEAR POWER PLANT—UNIT No. 1
CONNECTICUT YANKEE ATOMIC POWER COMPANY
HADDAM, CONNECTICUT
STONE & WEBSTER ENGINEERING CORPORATION
BOSTON, MASS.
DRAWING NUMBER 10899-FM-29D
GENERAL REVISION
ORIGINAL ISSUE
FIELD CHANGES
DESCRIPTION
Designed by
Des. Chk'd by
Drawn by
Chk'd by

8104220607
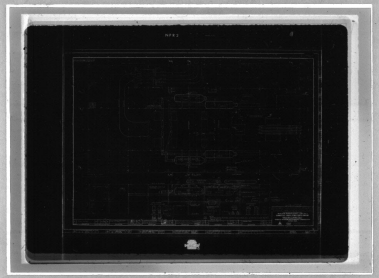
DDA FAC