
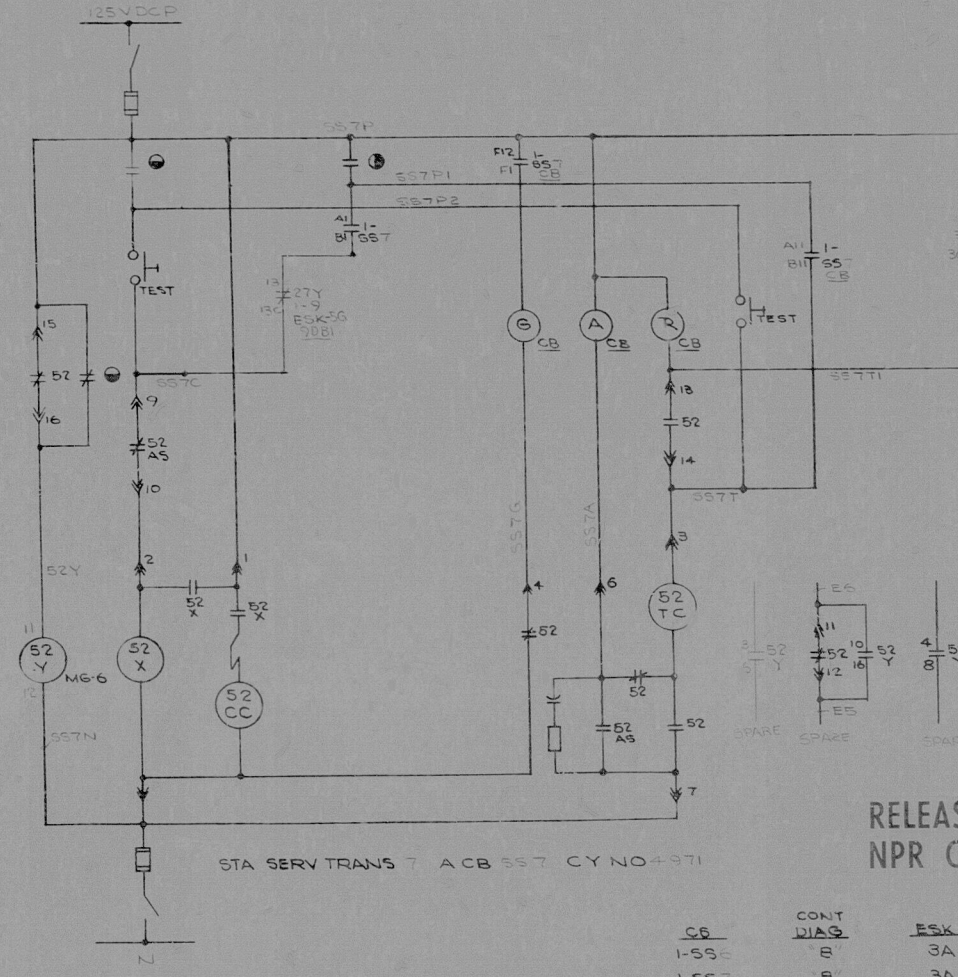


NPR 2


NORTHEAST UTILITIES

NUCLEAR SAFETY RELATED

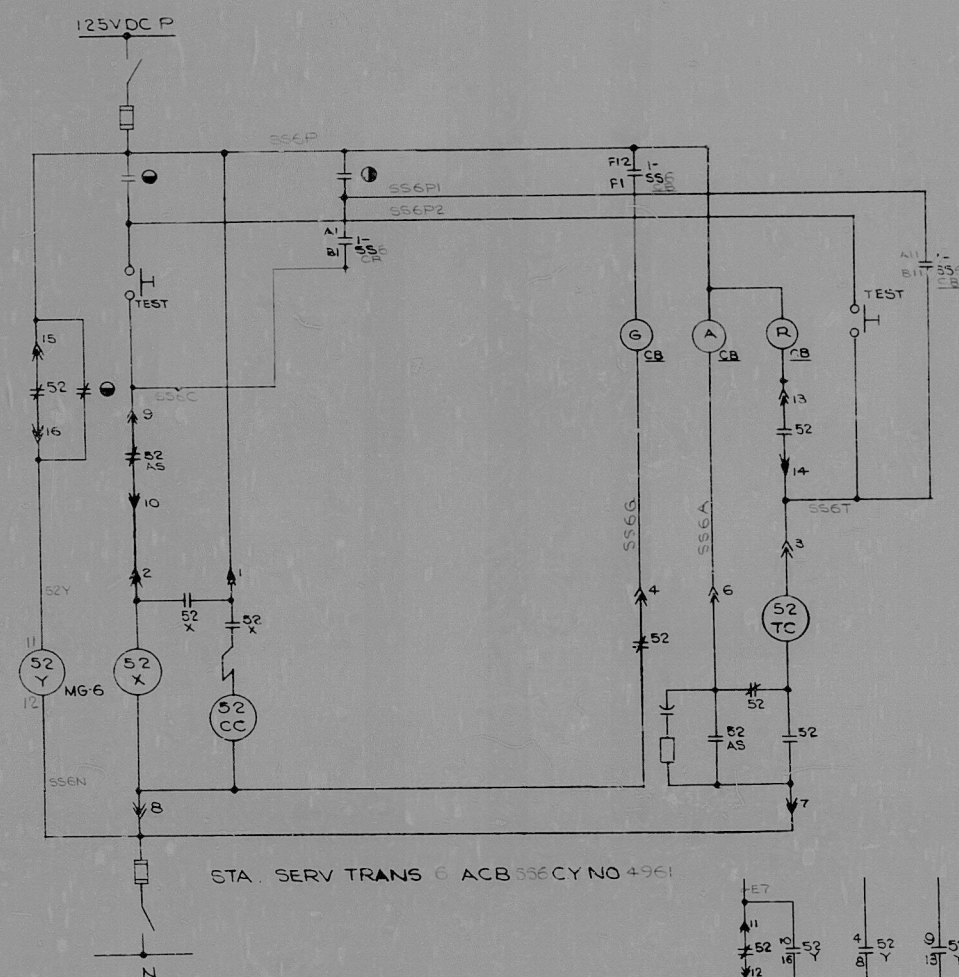

RELEASED FROM
NPR CONTROL

- CELL SW CLOSED WHEN ACB IS IN OPERATE POSITION ONLY
- CELL SW CLOSED WHEN ACB IS IN TEST POSITION ONLY
- NOTE: (-C) WIRES TO BE DISCONNECTED BY FIELD
- ALL EQUIPMENT LOCATED AT SWGR UNLESS NOTED OTHERWISE

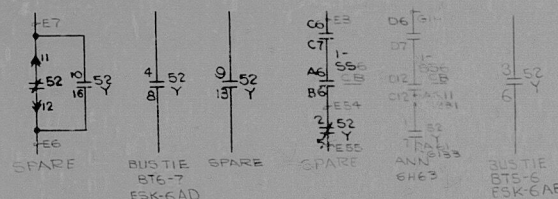

CONT
DIAG
1-55-
1-55-7

ELEMENTARY DIAGRAM 480V
STATION SERVICE TRANS ACB's


SS6 & SS7
CONN YANKEE ATOMIC POWER CO

STONE & WEBSTER ENGINEERING CORPORATION

10899 - E SK-6 AC

ISSUED FOR J.O. 11726-05
SUPERSEDES IN PART ESK-6A

7	6	5	4	3	2	1

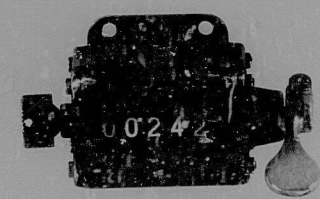

8104230270

