


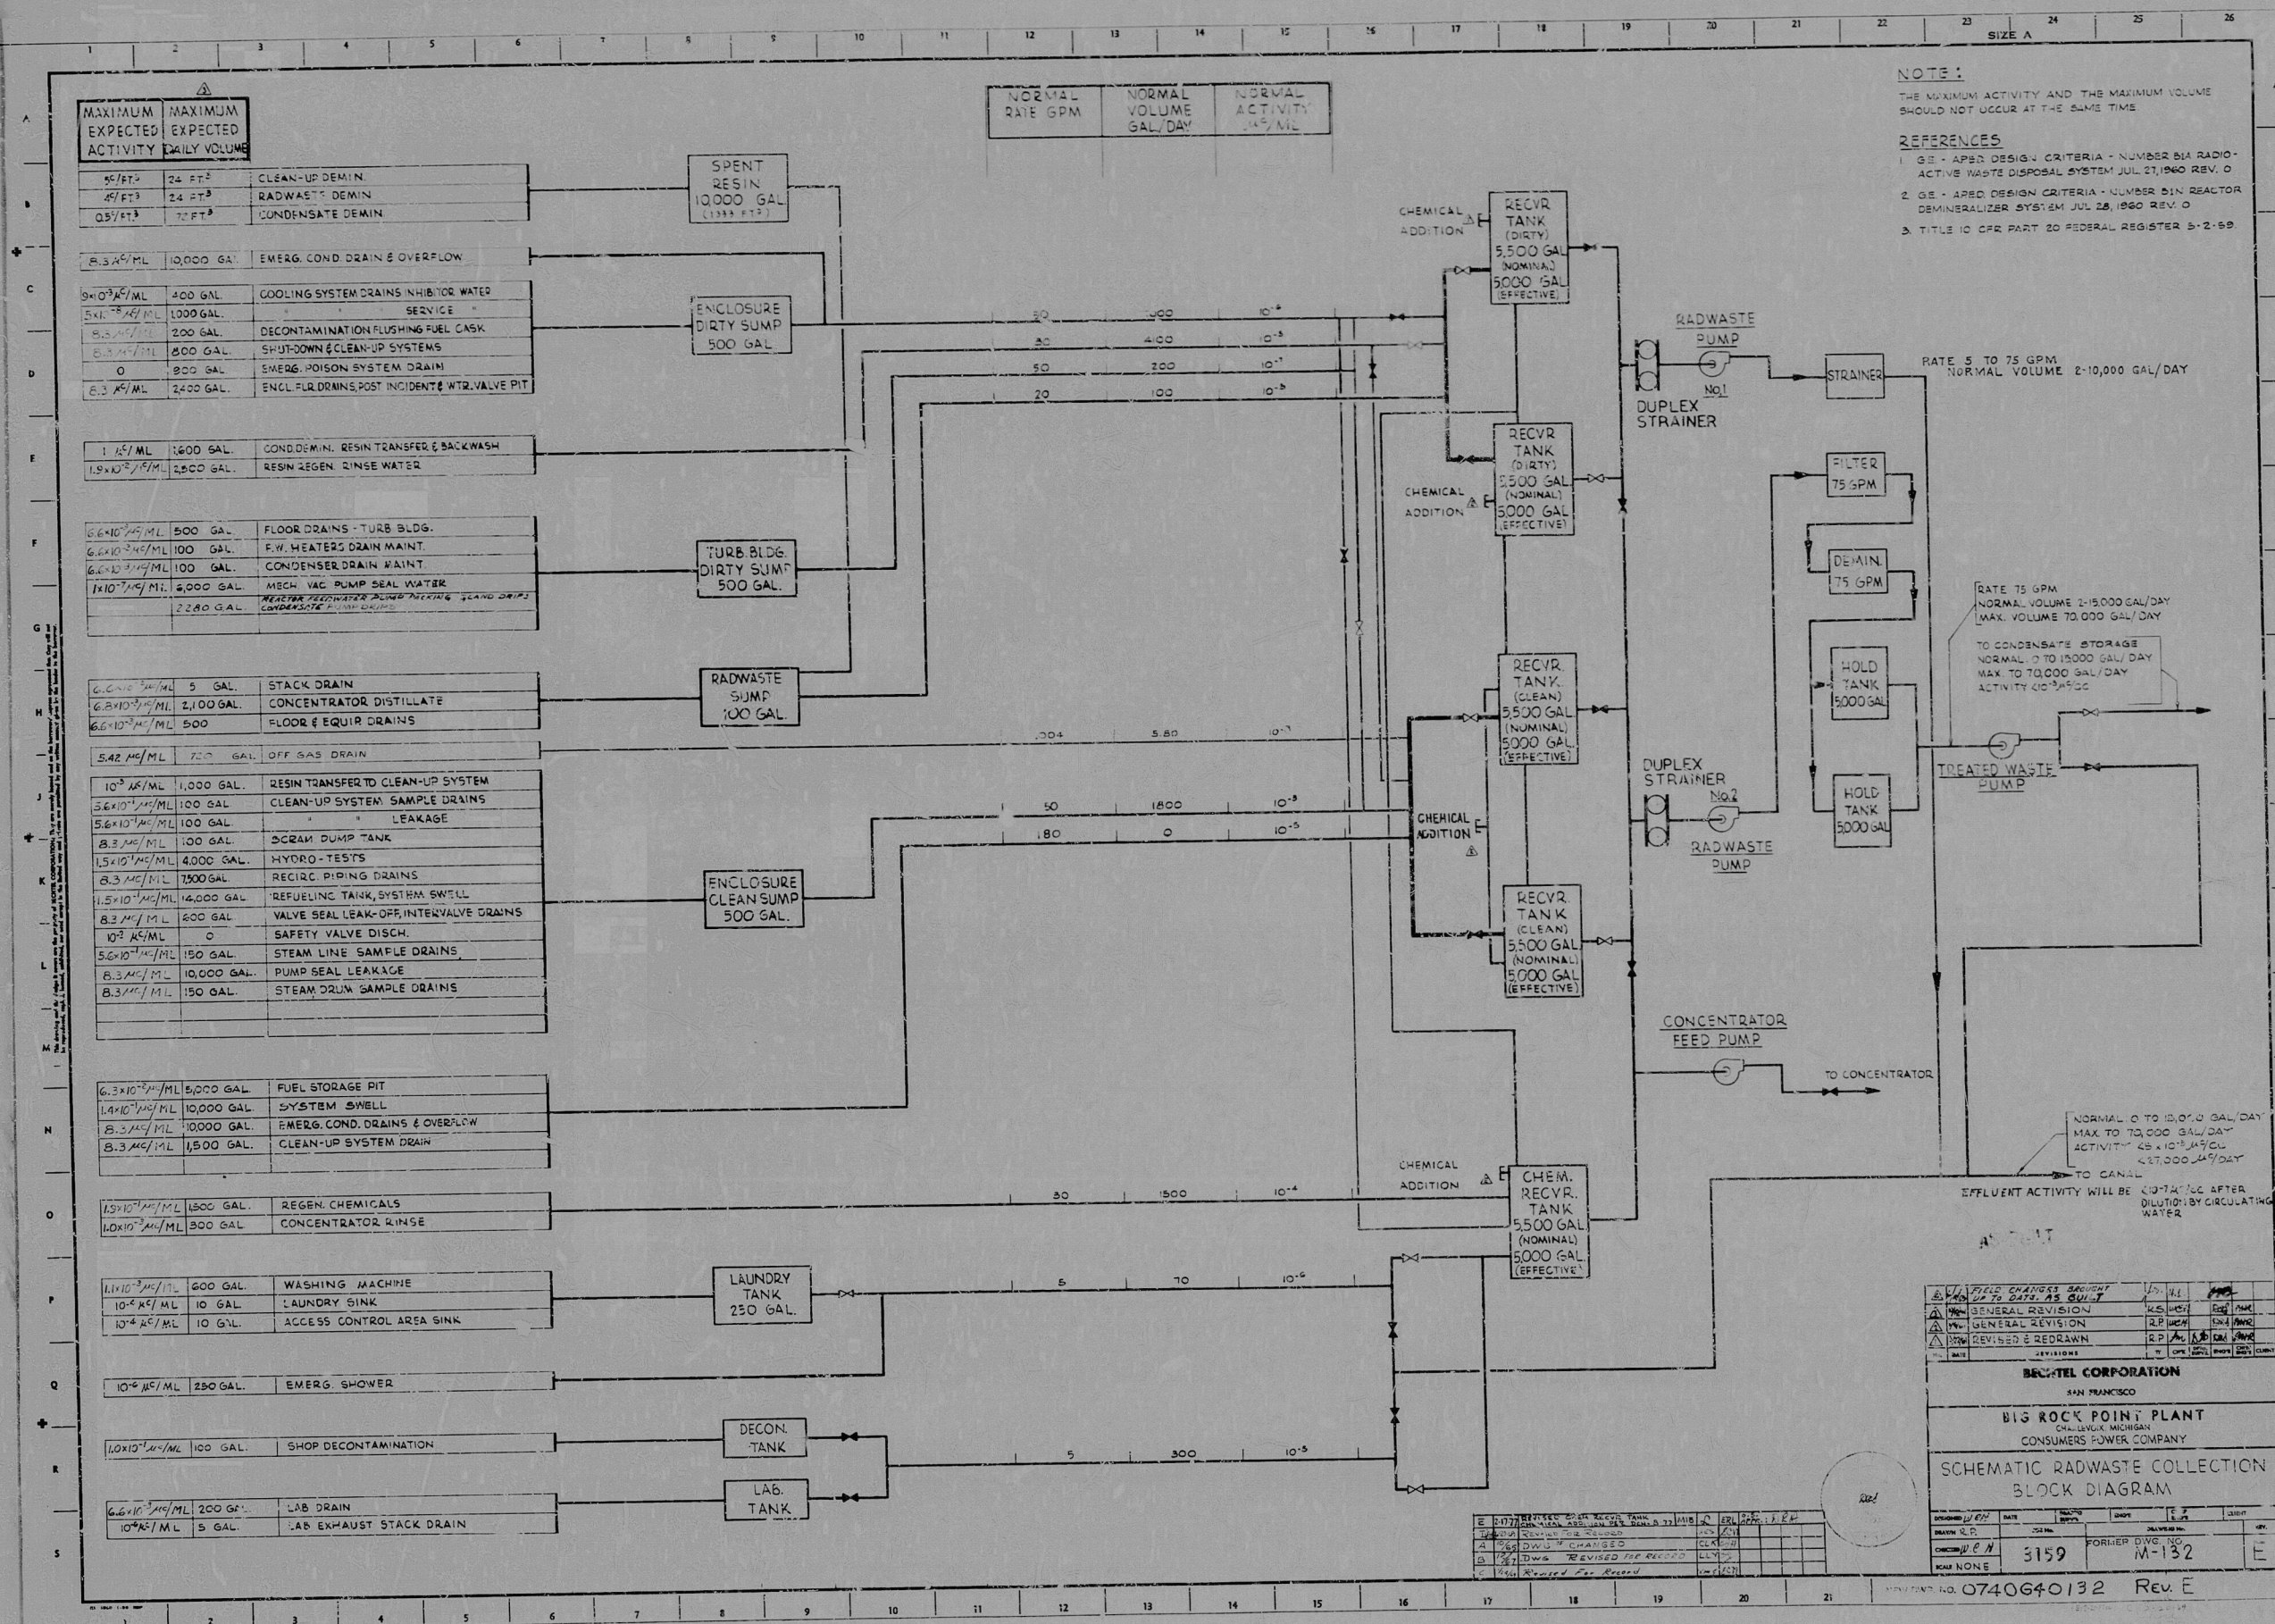

NOTE:
THE MAXIMUM ACTIVITY AND THE MAXIMUM VOLUME SHOULD NOT OCCUR AT THE SAME TIME.

REFERENCES
1. GE - APED DESIGN CRITERIA - NUMBER 814 RADIO-ACTIVE WASTE DISPOSAL SYSTEM JUL 27, 1960 REV. 0
2. GE - APED DESIGN CRITERIA - NUMBER 815 REACTOR DEMINERALIZER SYSTEM JUL 28, 1960 REV. 0
3. TITLE 10 CFR PART 20 FEDERAL REGISTER 5-2-59

DATE	BY	CHKD	APPD	REV
10/1/68	WCH	WCH	WCH	1
10/1/68	WCH	WCH	WCH	2
10/1/68	WCH	WCH	WCH	3
10/1/68	WCH	WCH	WCH	4
10/1/68	WCH	WCH	WCH	5
10/1/68	WCH	WCH	WCH	6
10/1/68	WCH	WCH	WCH	7
10/1/68	WCH	WCH	WCH	8
10/1/68	WCH	WCH	WCH	9
10/1/68	WCH	WCH	WCH	10
10/1/68	WCH	WCH	WCH	11
10/1/68	WCH	WCH	WCH	12
10/1/68	WCH	WCH	WCH	13
10/1/68	WCH	WCH	WCH	14
10/1/68	WCH	WCH	WCH	15
10/1/68	WCH	WCH	WCH	16
10/1/68	WCH	WCH	WCH	17
10/1/68	WCH	WCH	WCH	18
10/1/68	WCH	WCH	WCH	19
10/1/68	WCH	WCH	WCH	20
10/1/68	WCH	WCH	WCH	21
10/1/68	WCH	WCH	WCH	22
10/1/68	WCH	WCH	WCH	23
10/1/68	WCH	WCH	WCH	24
10/1/68	WCH	WCH	WCH	25
10/1/68	WCH	WCH	WCH	26

BECHTEL CORPORATION
SAN FRANCISCO
BIG ROCK POINT PLANT
CHALLEVILLE, MICHIGAN
CONSUMERS POWER COMPANY
SCHEMATIC RADWASTE COLLECTION
BLOCK DIAGRAM
3159
M-132
Rev E

0740G40132 E001 SCHEM RADWASTE COLLECTIONS

61

8104290330

