


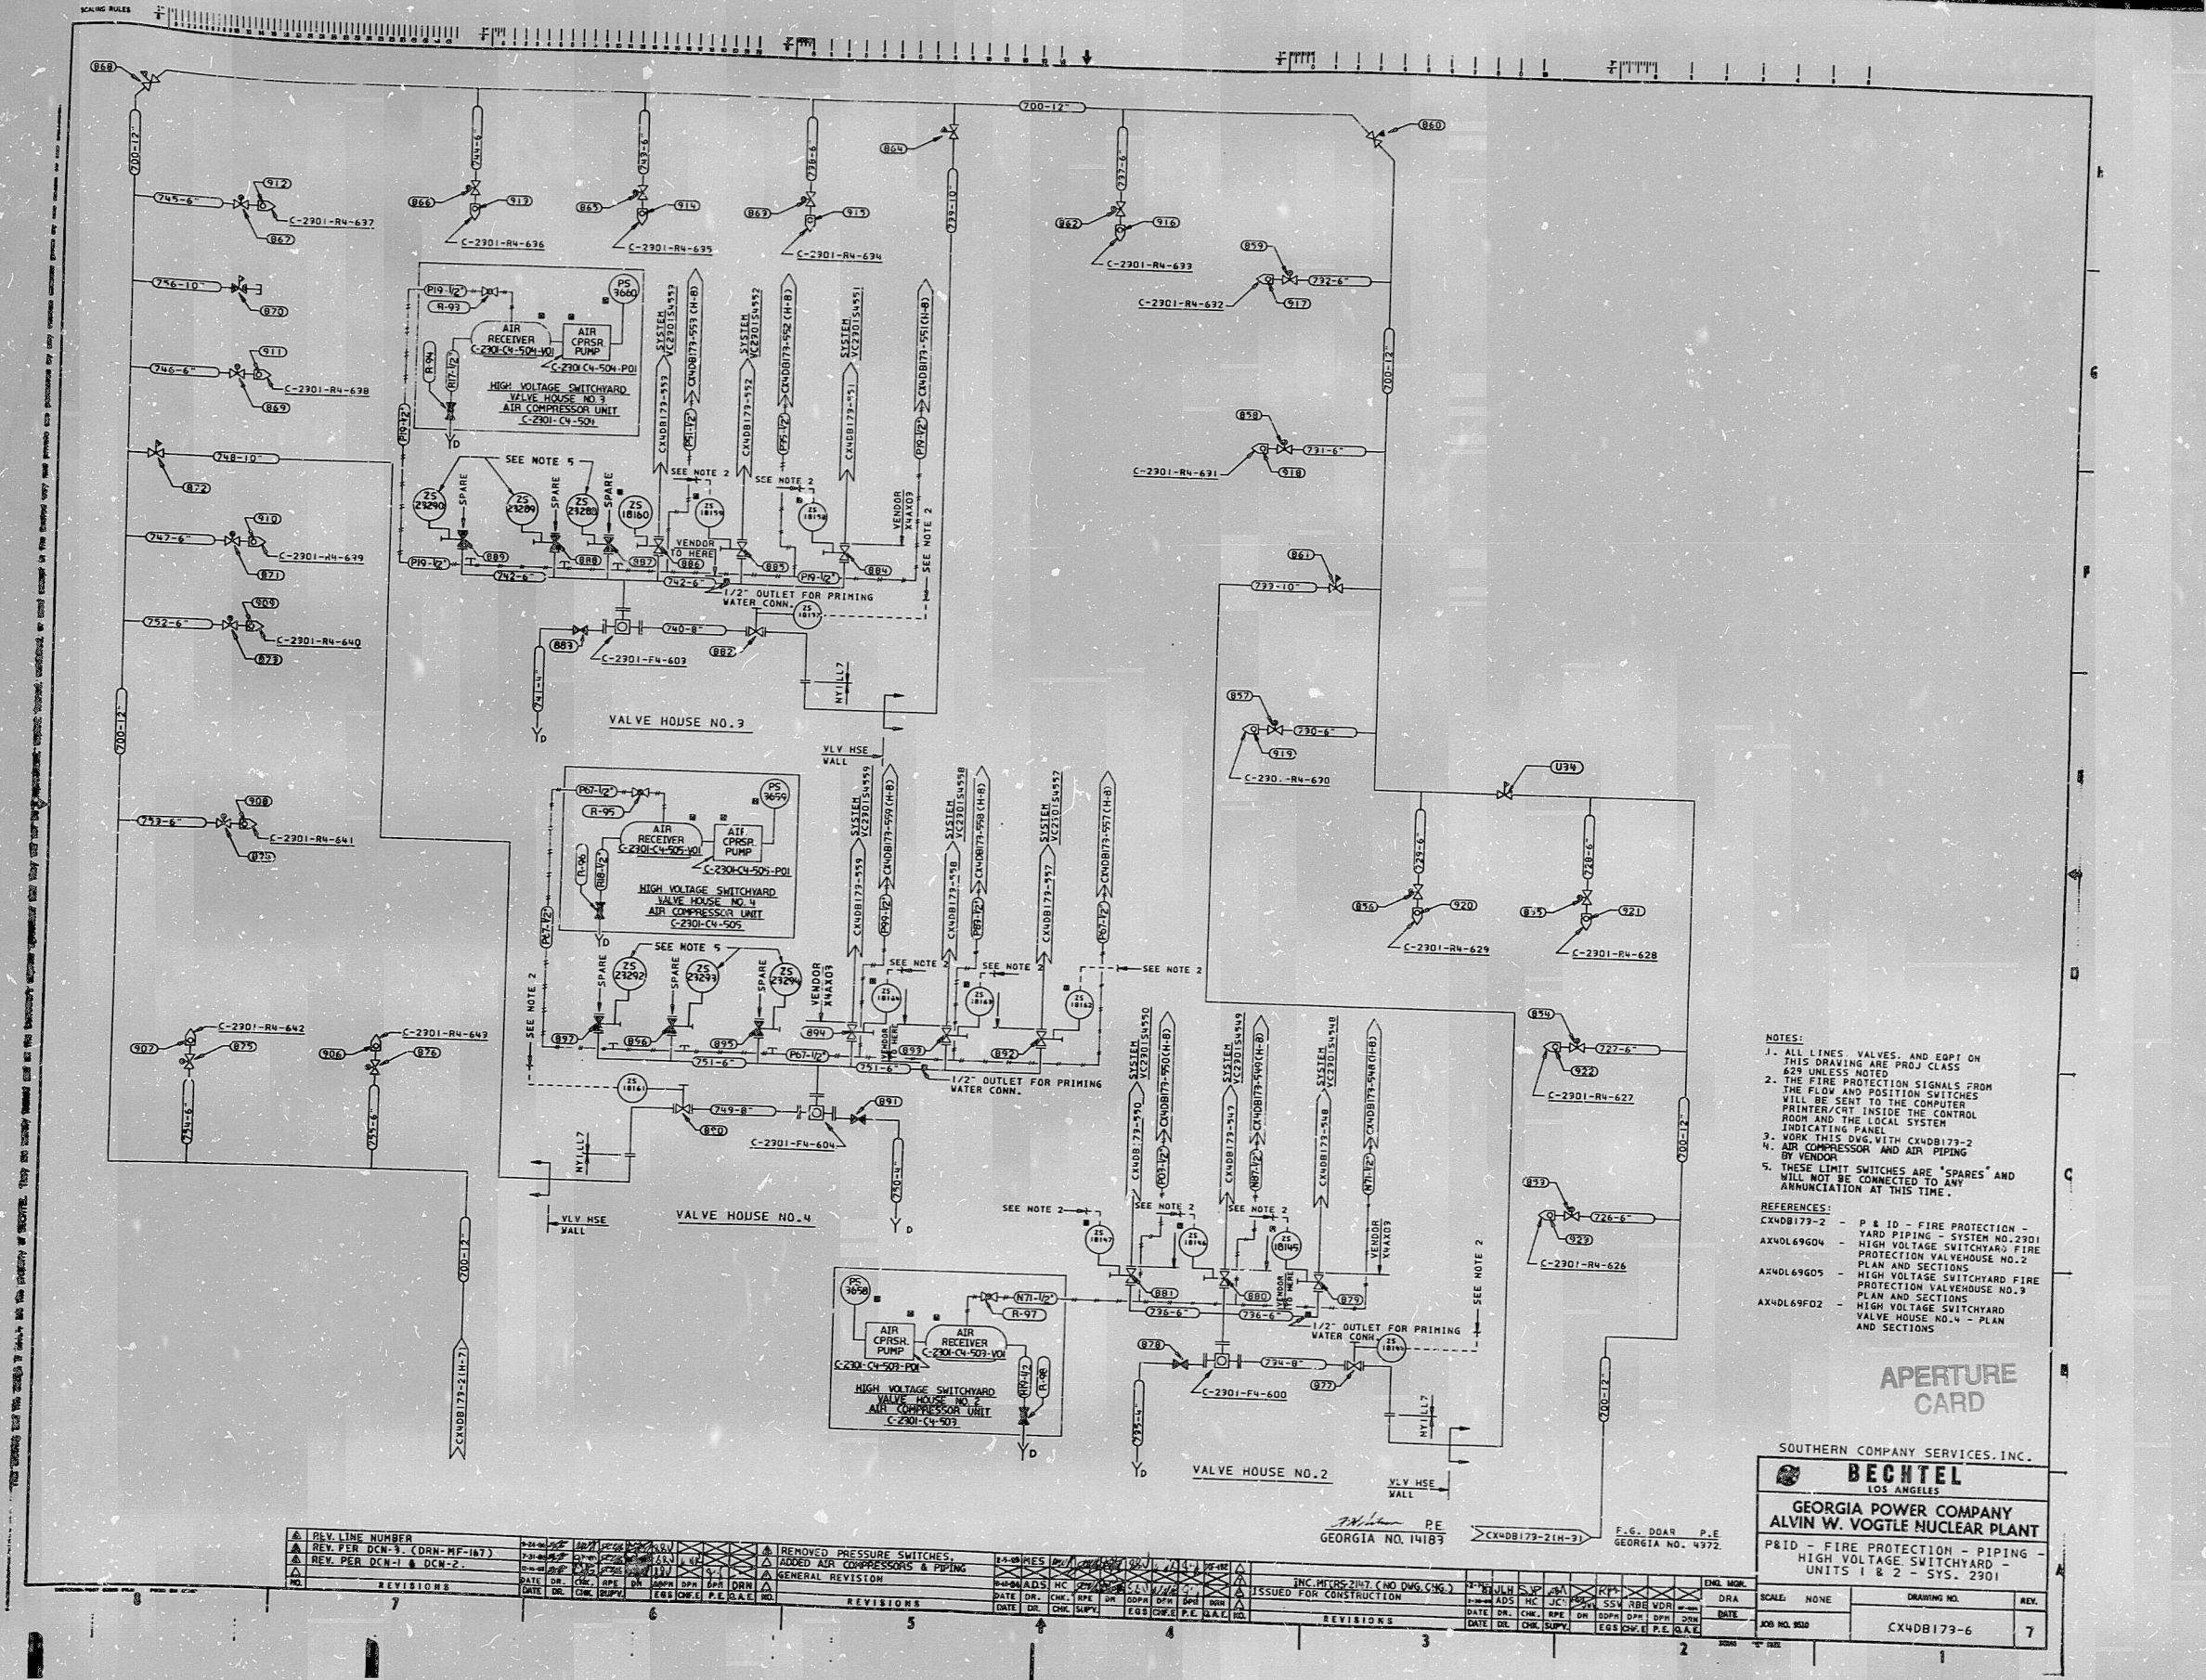

- NOTES:
1. ALL LINES, VALVES, AND EQUIP ON THIS DRAWING ARE PROJ CLASS 625 UNLESS NOTED.
 2. THE FIRE PROTECTION SIGNALS FROM THE FLOW AND POSITION SWITCHES WILL BE SENT TO THE COMPUTER PRINTER/ART INSIDE THE CONTROL ROOM AND THE LOCAL SYSTEM INDICATING PANEL.
 3. WORK THIS DWG WITH CX40B173-2.
 4. AIR COMPRESSOR AND AIR PIPING BY VENDOR.
 5. THESE LIMIT SWITCHES ARE "SPARES" AND WILL NOT BE CONNECTED TO ANY ANNUNCIATION AT THIS TIME.
- REFERENCES:
- CX40B173-2 - P & ID - FIRE PROTECTION - YARD PIPING - SYSTEM NO. 2301
 - AX40L69604 - HIGH VOLTAGE SWITCHYARD FIRE PROTECTION VALVEHOUSE NO. 2 PLAN AND SECTIONS
 - AX40L69605 - HIGH VOLTAGE SWITCHYARD FIRE PROTECTION VALVEHOUSE NO. 3 PLAN AND SECTIONS
 - AX40L69602 - HIGH VOLTAGE SWITCHYARD VALVEHOUSE NO. 4 - PLAN AND SECTIONS

APERTURE CARD

SOUTHERN COMPANY SERVICES, INC.

BECHTEL
LOS ANGELES

GEORGIA POWER COMPANY
ALVIN W. VOGTLE NUCLEAR PLANT

P&ID - FIRE PROTECTION - PIPING - HIGH VOLTAGE SWITCHYARD - UNITS 1 & 2 - SYS. 2301

REV.	NO.	DATE	BY	CHK.	APP.	DESCRIPTION
1	1	10/1/73	W. L. HARRIS	J. E. DOAN	P. E.	ISSUED FOR CONSTRUCTION
2	2	10/1/73	W. L. HARRIS	J. E. DOAN	P. E.	ISSUED FOR CONSTRUCTION
3	3	10/1/73	W. L. HARRIS	J. E. DOAN	P. E.	ISSUED FOR CONSTRUCTION
4	4	10/1/73	W. L. HARRIS	J. E. DOAN	P. E.	ISSUED FOR CONSTRUCTION
5	5	10/1/73	W. L. HARRIS	J. E. DOAN	P. E.	ISSUED FOR CONSTRUCTION
6	6	10/1/73	W. L. HARRIS	J. E. DOAN	P. E.	ISSUED FOR CONSTRUCTION
7	7	10/1/73	W. L. HARRIS	J. E. DOAN	P. E.	ISSUED FOR CONSTRUCTION

9910190123

PDR RIDS

9910190123

