


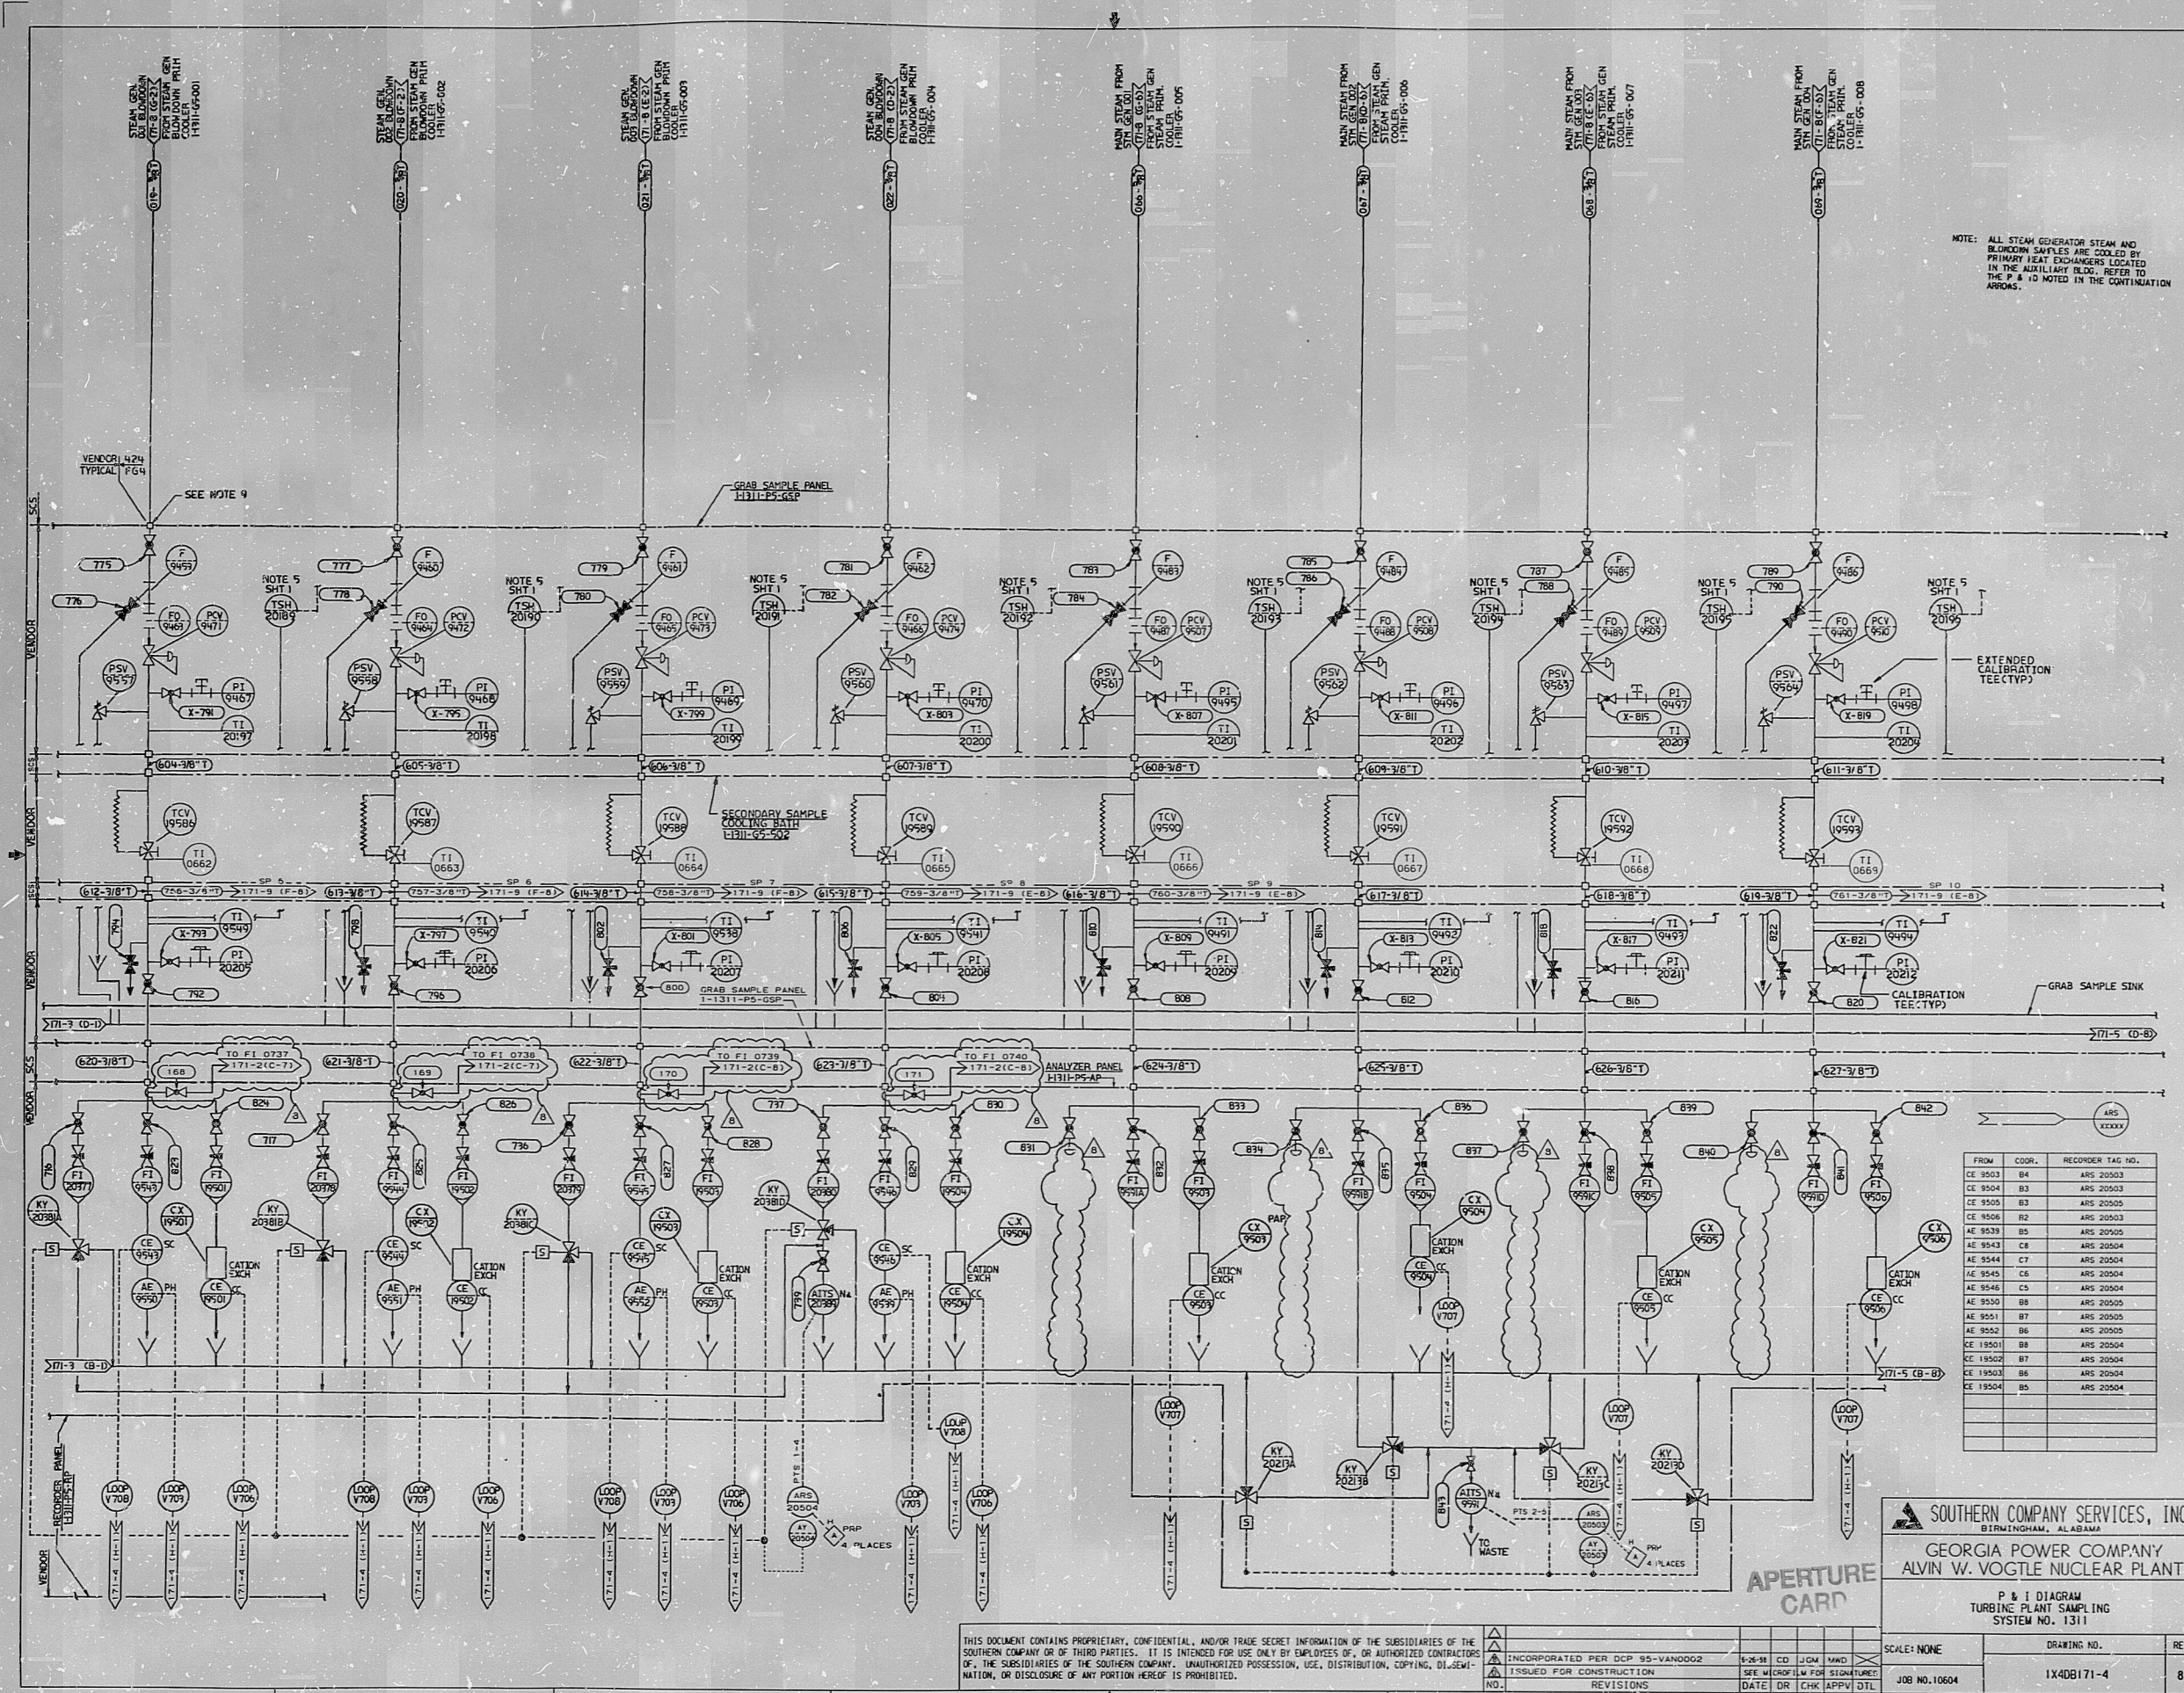

NOTE: ALL STEAM GENERATOR STEAM AND
CONDENSATE SAMPLES ARE COOLED BY
PRIMARY HEAT EXCHANGERS LOCATED
IN THE AUXILIARY BLDG. REFER TO
THE P & I NOTED IN THE CONTINUATION
AREAS.

FROM	COND.	RECORDER TAG NO.
CE 9503	B4	ARS 20503
CE 9504	B3	ARS 20503
CE 9505	B3	ARS 20505
CE 9506	B2	ARS 20503
AE 9533	B5	ARS 20505
AE 9543	C8	ARS 20504
AE 9544	C7	ARS 20504
AE 9545	C5	ARS 20504
AE 9546	C5	ARS 20504
AE 9550	B8	ARS 20505
AE 9551	B7	ARS 20505
AE 9552	B6	ARS 20505
CE 15501	B8	ARS 20504
CE 15502	B7	ARS 20504
CE 15503	B6	ARS 20504
CE 15504	B5	ARS 20504

SOUTHERN COMPANY SERVICES, INC.
BIRMINGHAM, ALABAMA
GEORGIA POWER COMPANY
ALVIN W. VOGTLE NUCLEAR PLANT
P & I DIAGRAM
TURBINE PLANT SAMPLING
SYSTEM NO. 1311

NO.	REVISIONS	DATE	DR	CHK	APPV	DTL	SCALE: NONE	DRAWING NO.	REV.
1	INCORPORATED PER DCP 95-VAN0002	5-24-98	CD	JGM	MND			1X408171-4	8
2	ISSUED FOR CONSTRUCTION	SEE WORKSHEET FOR SIGNATURE							

9910190205

PDR RIDS

9910190205

