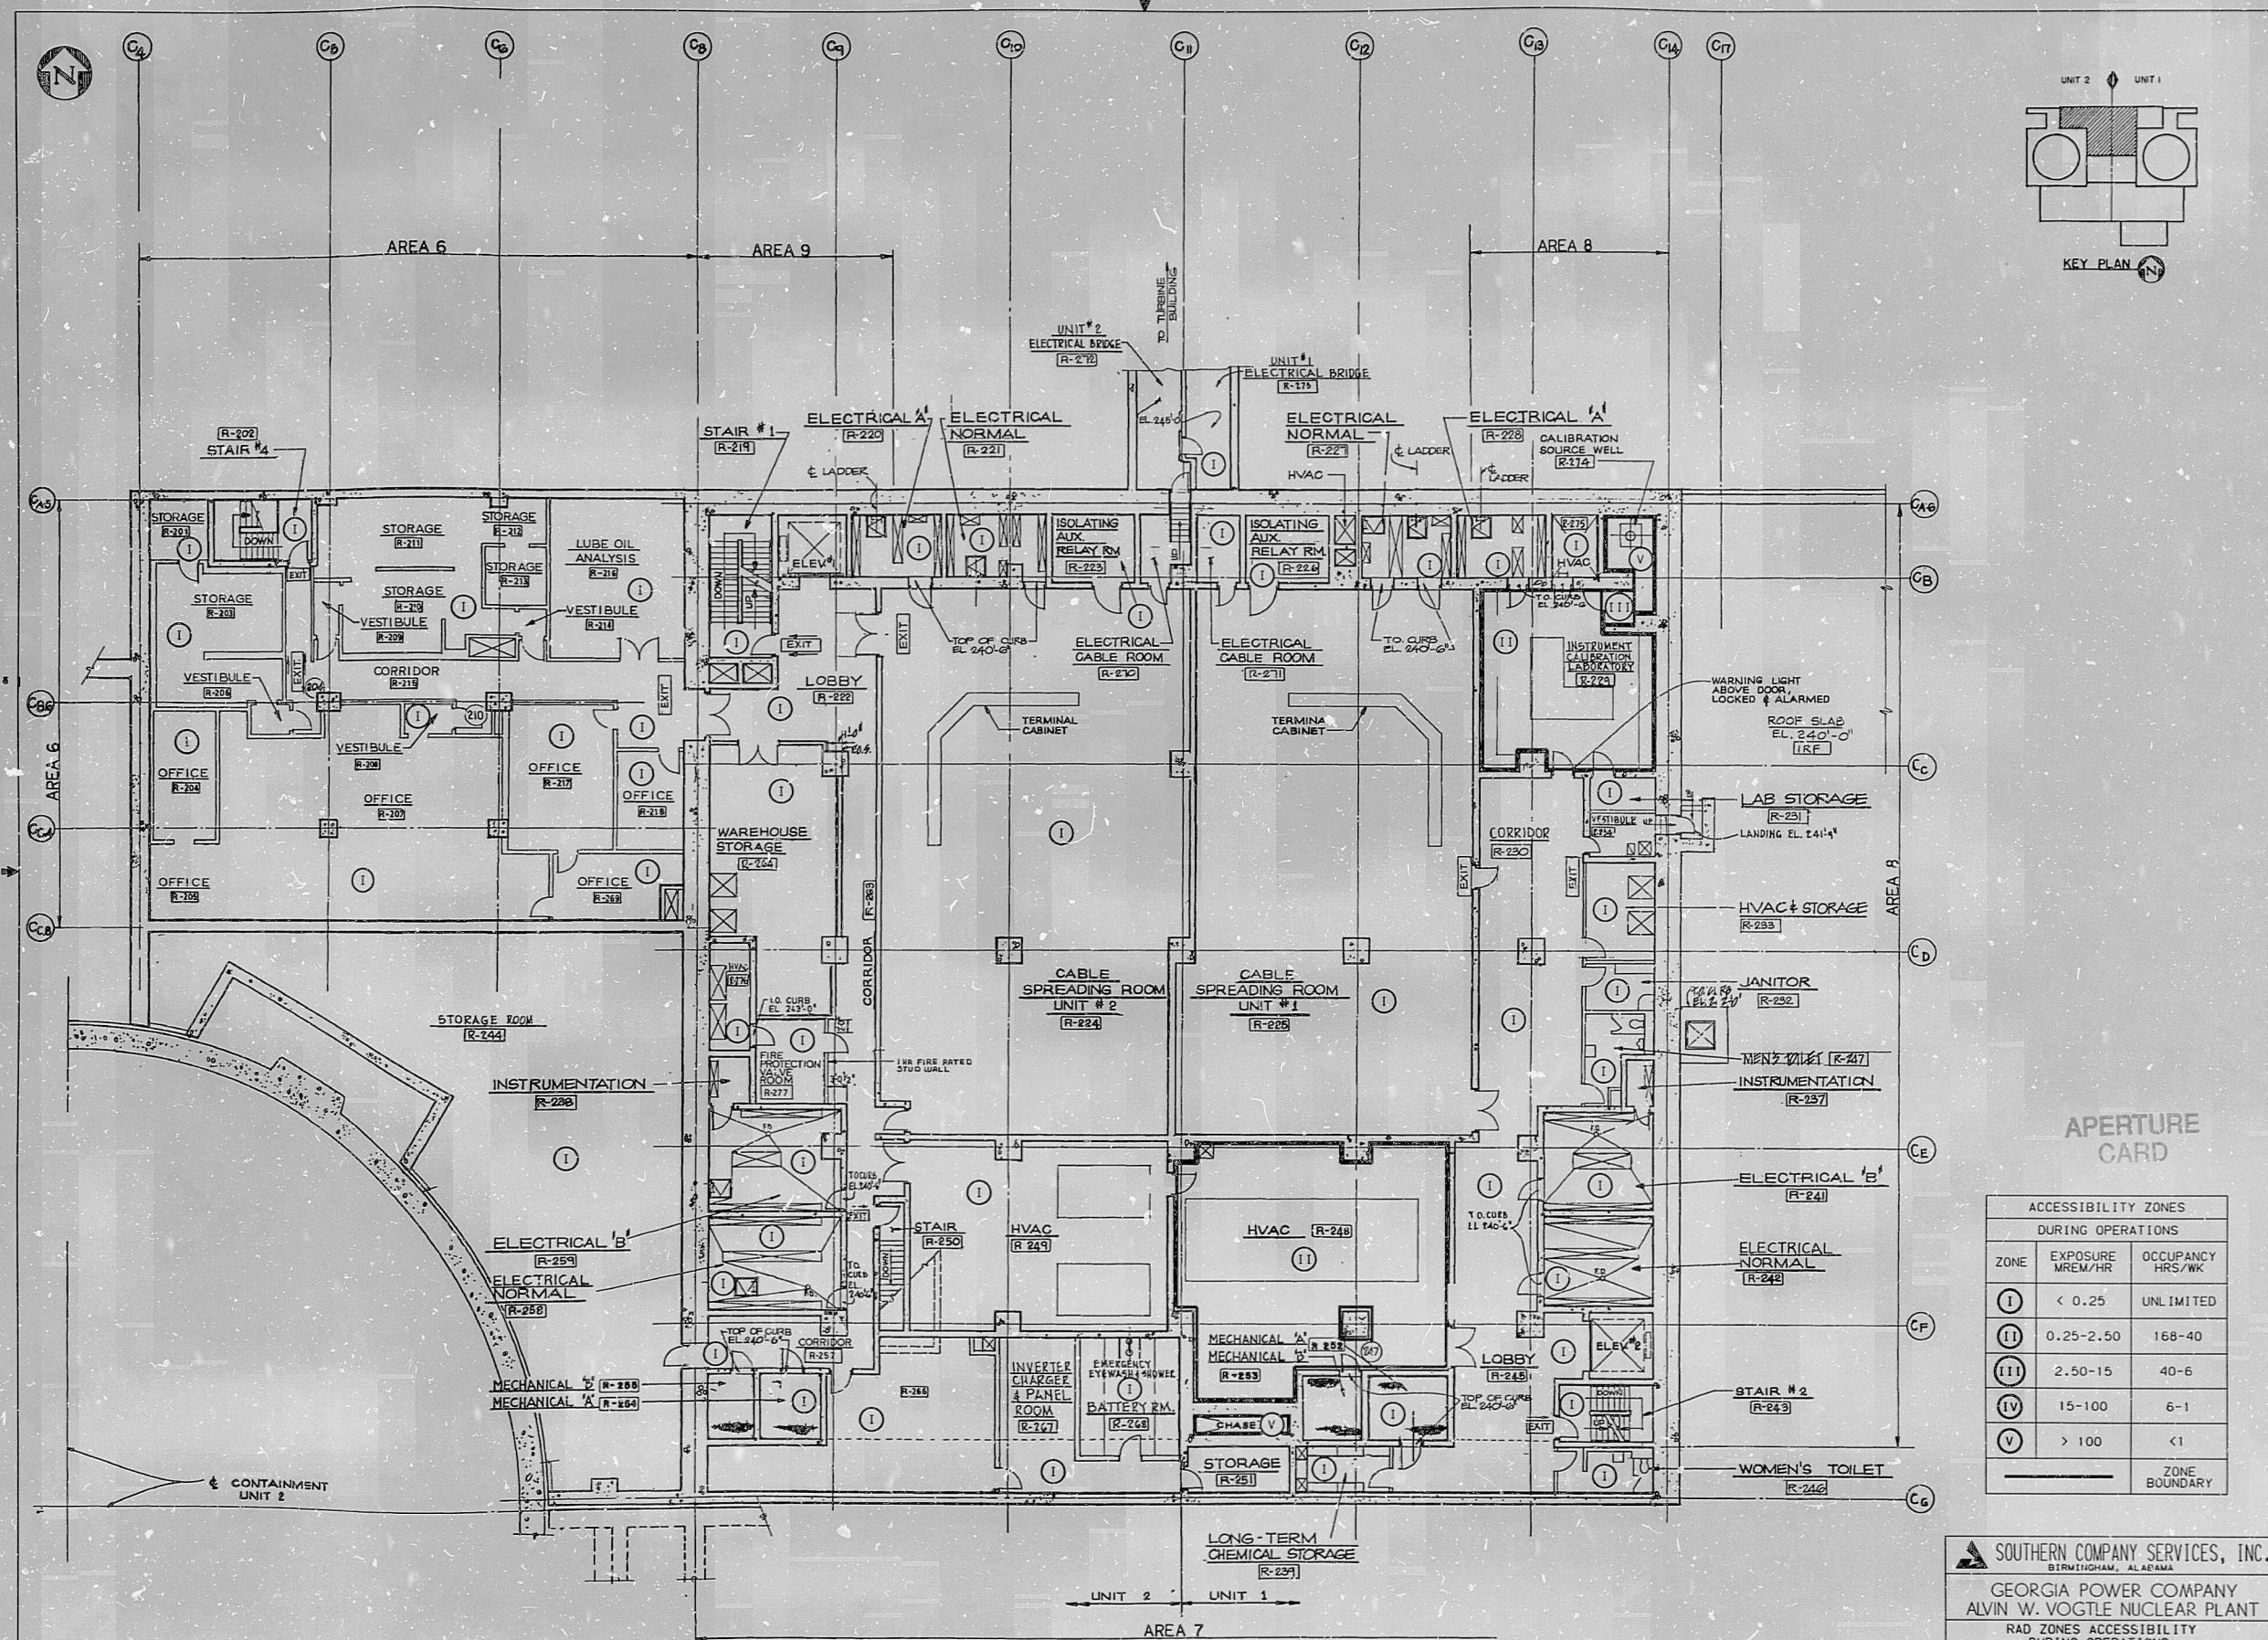


APERTURE CARD

ACCESSIBILITY ZONES DURING OPERATIONS		
ZONE	EXPOSURE MREM/HR	OCCUPANCY HRS/WK
I	< 0.25	UNLIMITED
II	0.25-2.50	168-40
III	2.50-15	40-6
IV	15-100	6-1
V	> 100	<1
ZONE BOUNDARY		

SOUTHERN COMPANY SERVICES, INC.
 GEORGIA POWER COMPANY
 ALVIN W. VOGTLE NUCLEAR PLANT
 RAD ZONES ACCESSIBILITY
 DURING OPERATIONS:
 CONTROL BUILDING
 FLOOR PLAN EL. 240'-0" LEVEL 2

THIS DOCUMENT CONTAINS PROPRIETARY, CONFIDENTIAL, AND/OR TRADE SECRET INFORMATION. THE INFORMATION IS THE PROPERTY OF THE SOUTHERN COMPANY OR OF THIRD PARTIES. IT IS INTENDED FOR USE ONLY BY EMPLOYEES OF, OR AUTHORIZED CONTRACTORS OF, THE SOUTHERN COMPANY. UNAUTHORIZED POSSESSION, USE, DISTRIBUTION, COPYING, DISSEMINATION, OR DISCLOSURE OF ANY PORTION HEREOF IS PROHIBITED.

REV.	DATE	BY	CHK	APPV	DTL
1	10/1/84	CS	RBH	CBH	NFP
2	10/1/84	CS	RBH	CBH	NFP
3	10/1/84	CS	RBH	CBH	NFP
4	10/1/84	CS	RBH	CBH	NFP
5	10/1/84	CS	RBH	CBH	NFP
6	10/1/84	CS	RBH	CBH	NFP
7	10/1/84	CS	RBH	CBH	NFP
8	10/1/84	CS	RBH	CBH	NFP
9	10/1/84	CS	RBH	CBH	NFP
10	10/1/84	CS	RBH	CBH	NFP

SCALE: 1/8"=1'-0"
 JOB NO. 10604
 DRAWING NO. AX600024
 REV. 0
 CAD NAME AX600024

PDR RID 9910190249

9910190249

