


CRP 905 (5385-5727)



C1304A S1 - W B G O R

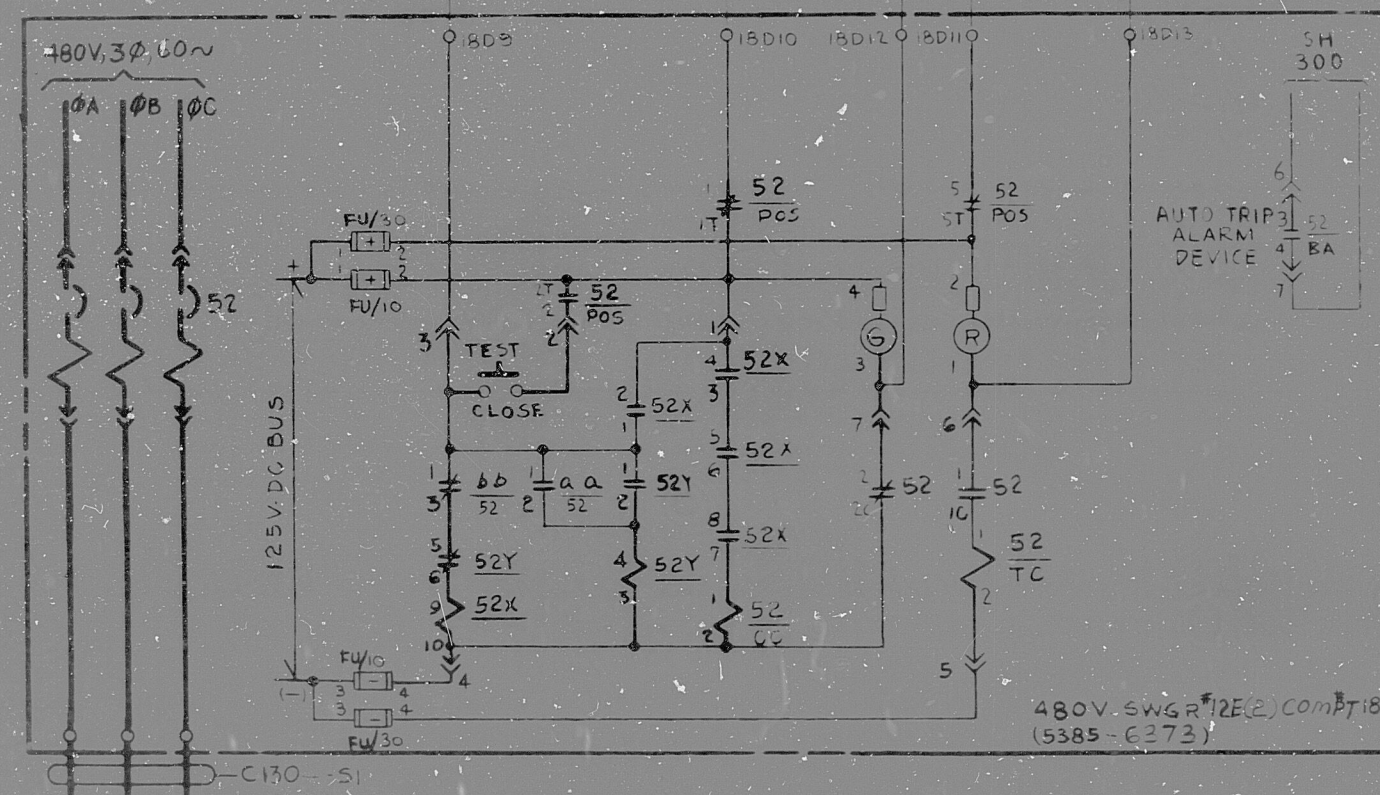

480V SWGR #12E(2) COMPT 180 (5385-6273)

TO REACTOR BLD
MCCES (2-3)

NUCLEAR SAFETY RELATED

CS
304

CONTACTS		POSITIONS			
HANDLE END	NO	CLOSE	NORMAL	TRIP	
1-11-0	0-11-0	X			
2-11-0	0-11-0	X			
3-11-0	0-11-0			X	
4-11-0	0-11-0			X	
5-11-0	0-11-0		X		
6-11-0	0-11-0	X	X		

SPRING RETURN TO NORMAL

52
POS

CONTACTS		BKR POS		CWD		BKR AUX SWITCHES			
HANDLE END	NO	OUT	IN	SH		1-11-0	2-11-0	3-11-0	4-11-0
1-11-0	0-11-0	X				X	X	X	X
2-11-0	0-11-0	X				X	X	X	X
3-11-0	0-11-0		X			X	X	X	X
4-11-0	0-11-0		X			X	X	X	X
5-11-0	0-11-0		X			X	X	X	X
6-11-0	0-11-0	X	X			X	X	X	X

THIS SHEET

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT BETWEEN EBASCO SERVICES INCORPORATED AND GENERAL ELECTRIC.

REV	DATE	BY	APPROVED	REV	DATE	BY	APPROVED
8				4	7-26-76	WES	
7				3	2-27-75	GL	
6				2	11-21-74	WES	
5				1	4-18-74	WES	

EBASCO SERVICES INCORPORATED
NEW YORK

DIV. ELEC. DR. KF
SCALE: CH. AG
DATE: NOV. 1, 1968

GENERAL ELECTRIC COMPANY
MILLSTONE NUCLEAR POWER STATION
CONTROL WIRING DIAGRAM
480V SWITCHGEAR NO. 12E(2)
REACTOR BUILDING MCCES 2-3

B-187613

SH 304

25202-31001 SH 304

8105080432

DOCKET
NUMBER

ACCESSION
NUMBER

DRAWING NUMBER

SHEET REV.

