


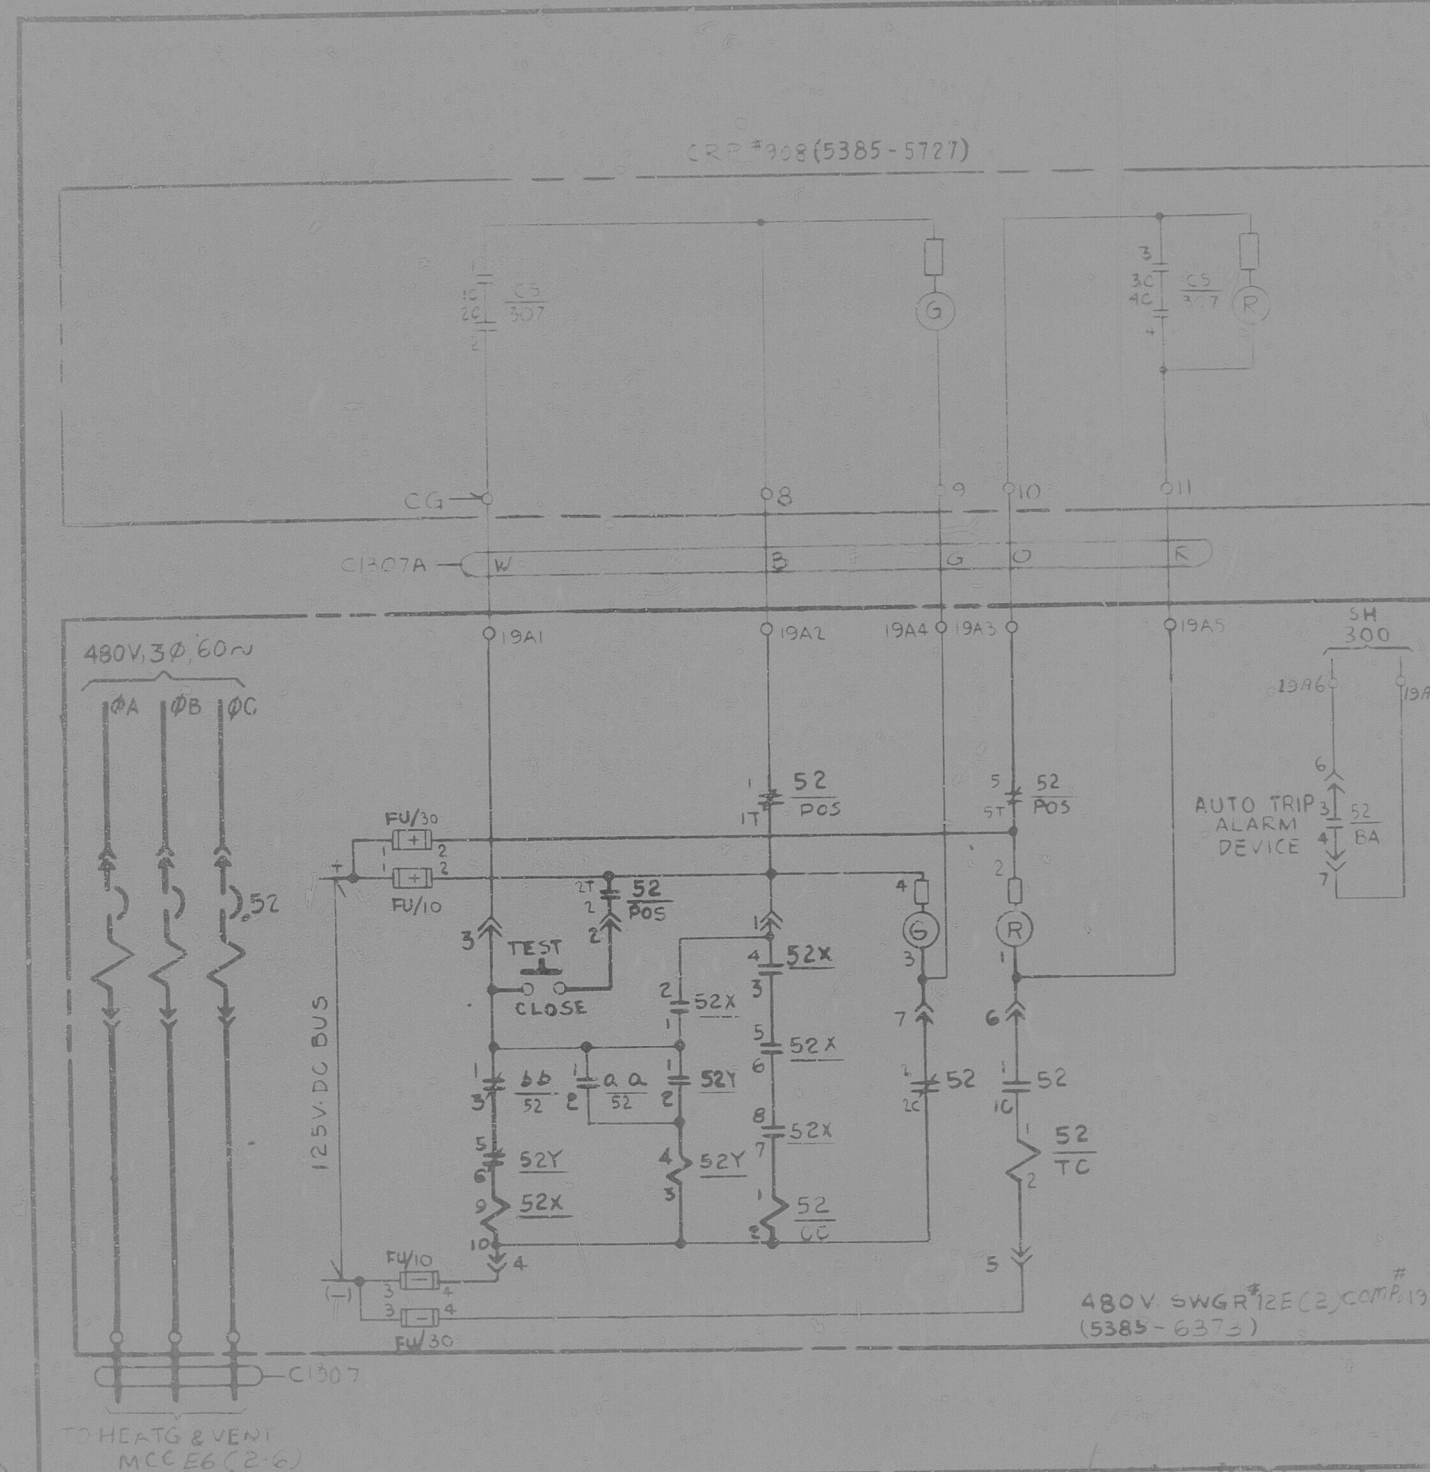

CONTACTS

HANDLE END	NO	CLOSE	NORM AFTER CLOSE	TRIP
1-10 20 2	1	X		
0-11-0 0-11-0	2	X		
0-11-0 0-11-0	3			X
0-11-0 0-11-0	4			X
0-11-0 0-11-0	5	X	X	
0-11-0 0-11-0	6	X	X	

SP

SPRING RETURN TO NORMAL

52
POS

CONTACTS

HANDLE END	NO	OUT	IN	SH
1-10 20 2	1	X		
0-11-0 0-11-0	2	X		
0-11-0 0-11-0	3		X	
0-11-0 0-11-0	4	X		
0-11-0 0-11-0	5		X	
0-11-0 0-11-0	6	X		
0-11-0 0-11-0	7		X	
0-11-0 0-11-0	8	X		

BKR POS

NO	OUT	IN	SH
1	X		
2	X		
3		X	
4	X		
5		X	
6	X		
7		X	
8	X		

* - THIS SHEET

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT BETWEEN EBASCO SERVICES INCORPORATED AND GENERAL ELECTRIC.

REV	DATE	BY	APPROVED	REV	DATE	BY	APPROVED
1	7-26-76	WJS		4	7-26-76	WJS	
2	8-27-75	GL		5	8-27-75	GL	
3	10-24-70	EK		6	10-24-70	EK	
4	4-18-69	JAC		7	4-18-69	JAC	

EBASCO SERVICES INCORPORATED
NEW YORK

DIV. ELEC. DR. E.F.
SCALE: CH. JAC
DATE: NOV. 9, 1968

GENERAL ELECTRIC COMPANY
MILLSTONE NUCLEAR POWER STATION
CONTROL WIRING DIAGRAM
480 V SWITCHGEAR NO. 12E(2)
HEATING & VENT. MCC E6 (2-6)

B-187613
SH 307

8105110040

DOCKET
NUMBER

ACCESSION
NUMBER

DRAWING NUMBER

SHEET REV.

