


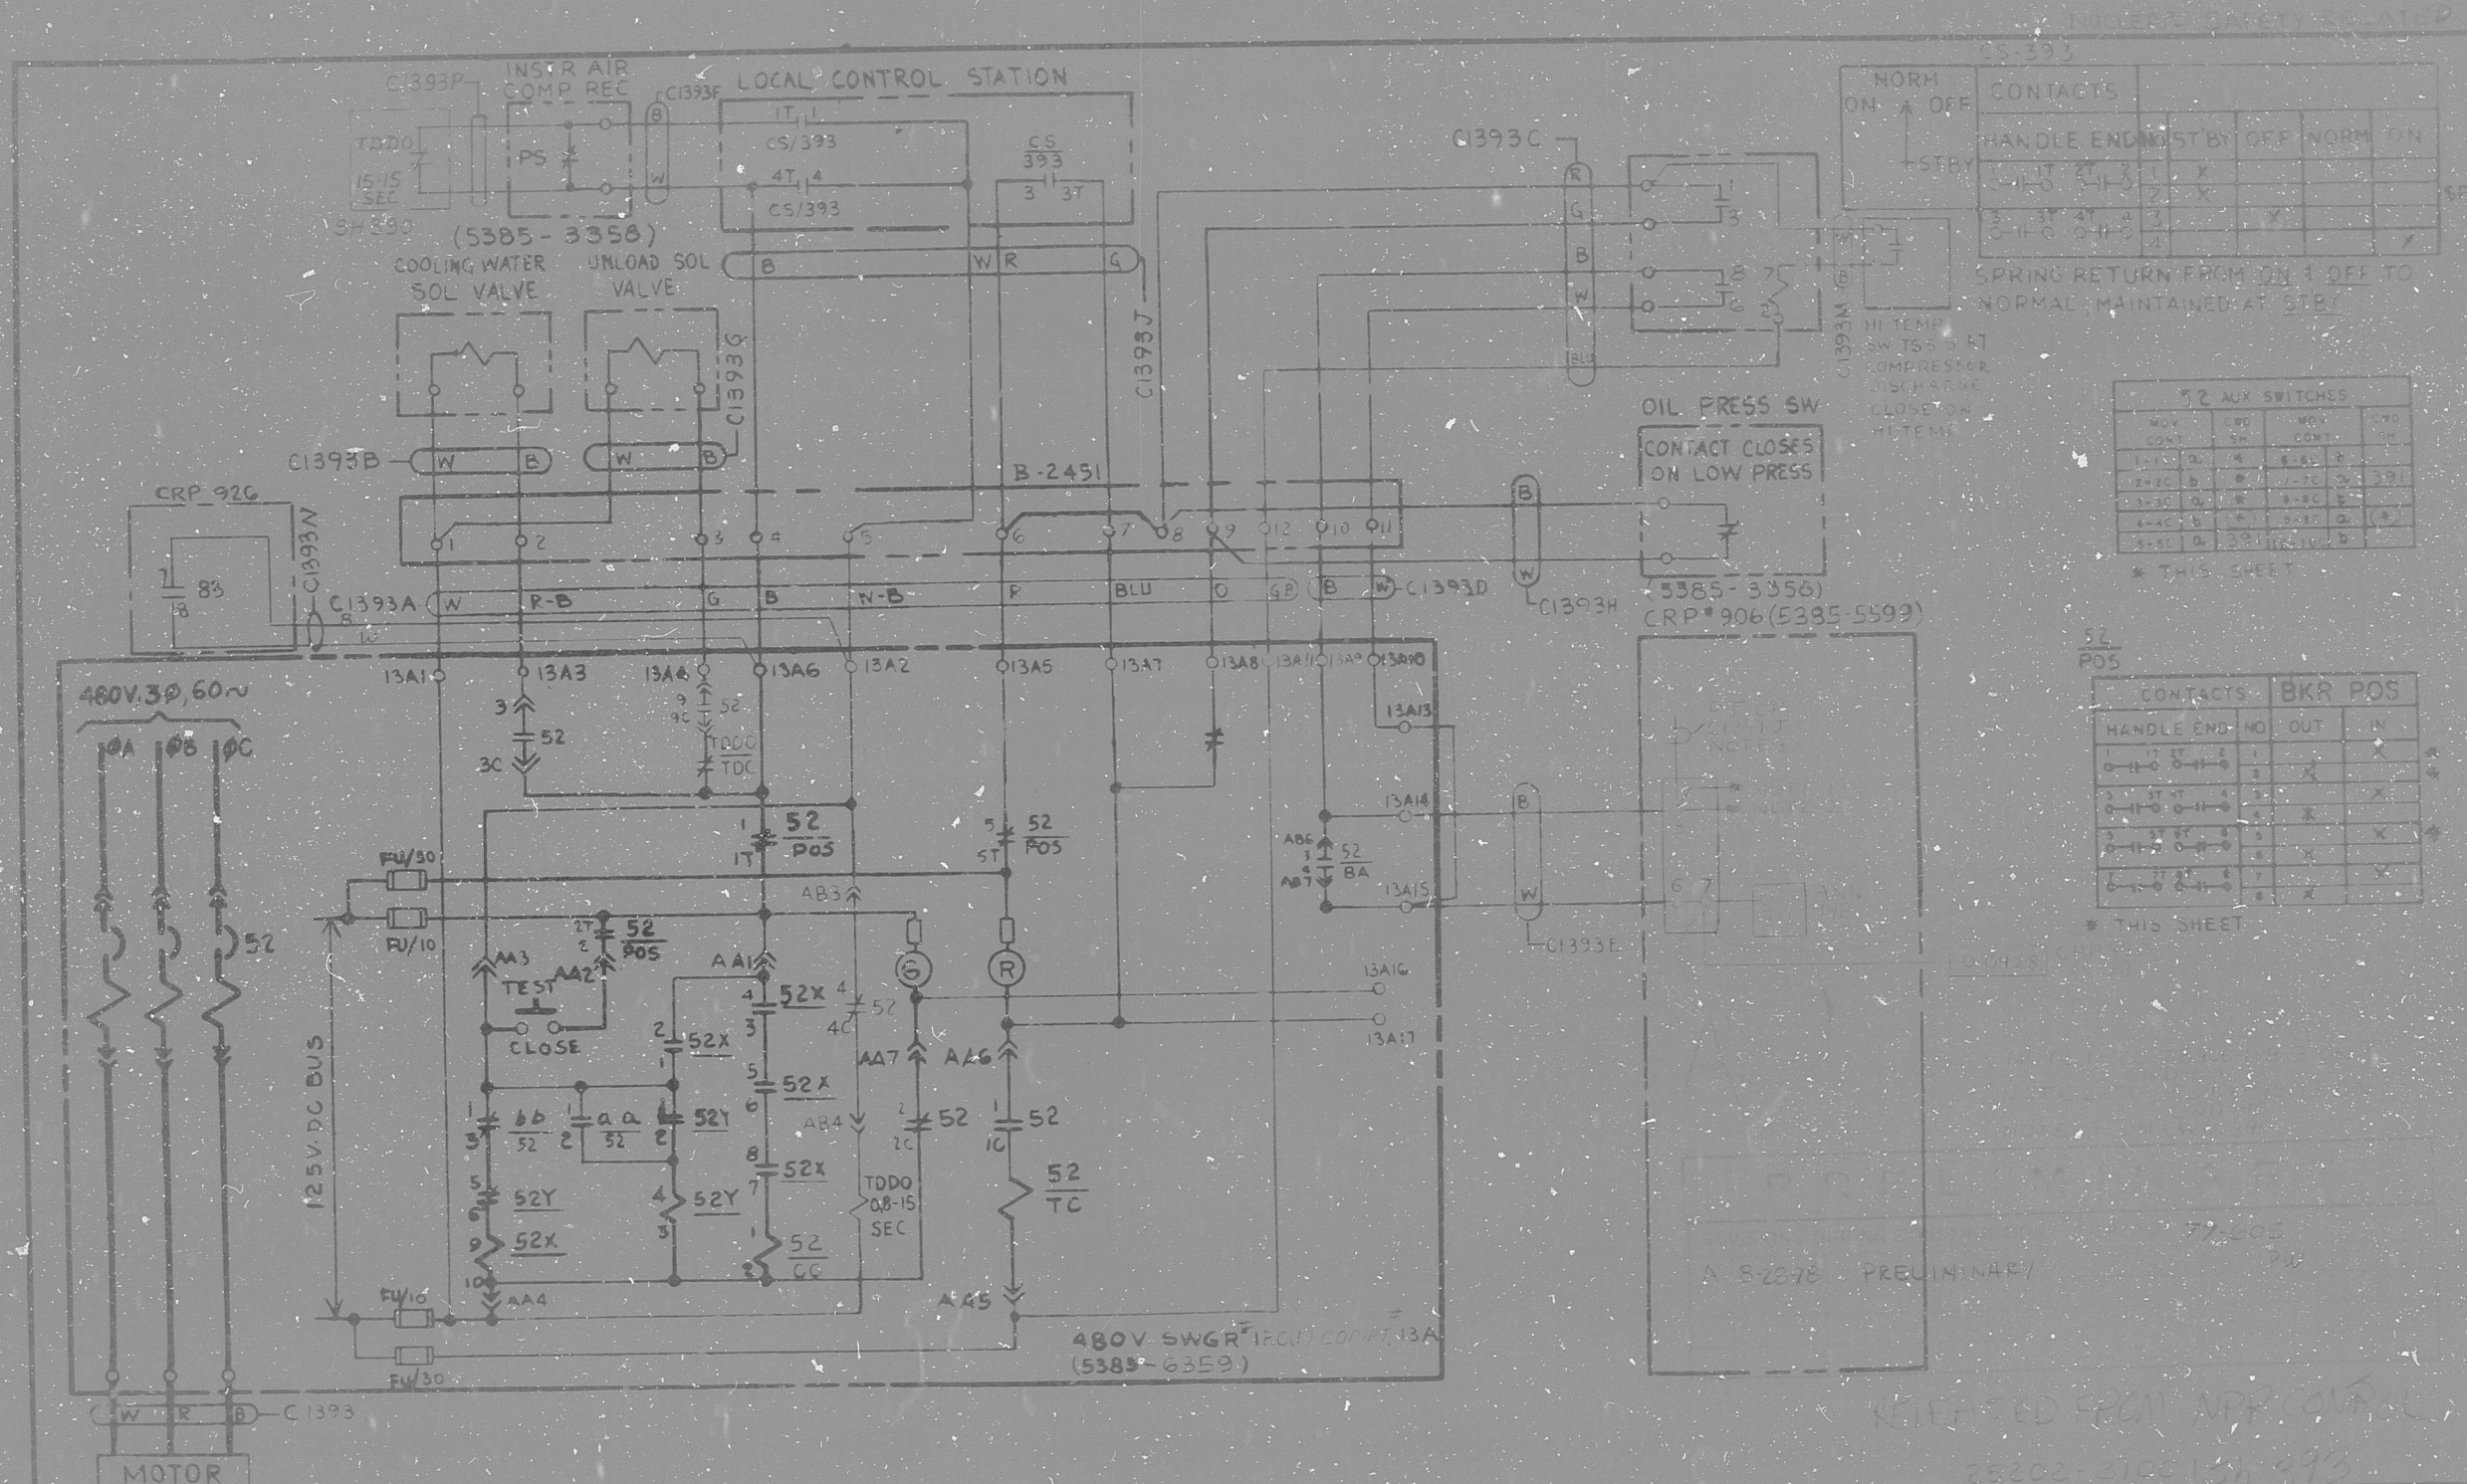

CS-333

CONTACTS	HANDLE END	NO	NC	COM
1-2	1	2	3	4
3-4	5	6	7	8
5-6	9	10	11	12
7-8	13	14	15	16
9-10	17	18	19	20
11-12	21	22	23	24
13-14	25	26	27	28
15-16	29	30	31	32

SPRING RETURN FROM ON 1 OFF TO NORMAL MAINTAINED AT STBY

52 AUX SWITCHES

NOV	NOV	NOV	NOV	NOV
1-2	3-4	5-6	7-8	9-10
11-12	13-14	15-16	17-18	19-20
21-22	23-24	25-26	27-28	29-30
31-32	33-34	35-36	37-38	39-40
41-42	43-44	45-46	47-48	49-50
51-52	53-54	55-56	57-58	59-60

* THIS SHEET

52 POS

CONTACTS	BKR POS	OUT	IN
1-2	1	2	3
3-4	4	5	6
5-6	7	8	9
7-8	10	11	12
9-10	13	14	15
11-12	16	17	18
13-14	19	20	21
15-16	22	23	24
17-18	25	26	27
19-20	28	29	30
21-22	31	32	33
23-24	34	35	36
25-26	37	38	39
27-28	40	41	42
29-30	43	44	45
31-32	46	47	48
33-34	49	50	51
35-36	52	53	54
37-38	55	56	57
39-40	58	59	60

* THIS SHEET

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT BETWEEN EBASCO SERVICES INCORPORATED AND GENERAL ELECTRIC.

REV	DATE	BY	APPROVED	REV	DATE	BY	APPROVED
1	7-25-77	GL	JEG	1	7-25-77	GL	JEG
2	7-25-77	GL	JEG	2	7-25-77	GL	JEG
3	7-25-77	GL	JEG	3	7-25-77	GL	JEG
4	7-25-77	GL	JEG	4	7-25-77	GL	JEG
5	7-25-77	GL	JEG	5	7-25-77	GL	JEG
6	7-25-77	GL	JEG	6	7-25-77	GL	JEG
7	7-25-77	GL	JEG	7	7-25-77	GL	JEG
8	7-25-77	GL	JEG	8	7-25-77	GL	JEG
9	7-25-77	GL	JEG	9	7-25-77	GL	JEG
10	7-25-77	GL	JEG	10	7-25-77	GL	JEG

EBASCO SERVICES INCORPORATED
NEW YORK
DIV. ELEC. SR. KF
SCALE: CH. 45
DATE: MAY 19, 1968

GENERAL ELECTRIC COMPANY
MILLSTONE NUCLEAR POWER STATION
CONTROL WIRING DIAGRAM
480V SWITCHGEAR NO 1200
STATION AIR COMPRESSOR MS-1

B-187613
SH 353

9105110154

DOCKET
NUMBER

ACCESSION
NUMBER

DRAWING NUMBER

SHEET REV.

