


CRP # 305 (5385-4524)



CS-326

CONTACTS	POSITION	
	NO	NC
10-11-02		X
36-11-04	X	

SPRING RETURN TO NORMAL

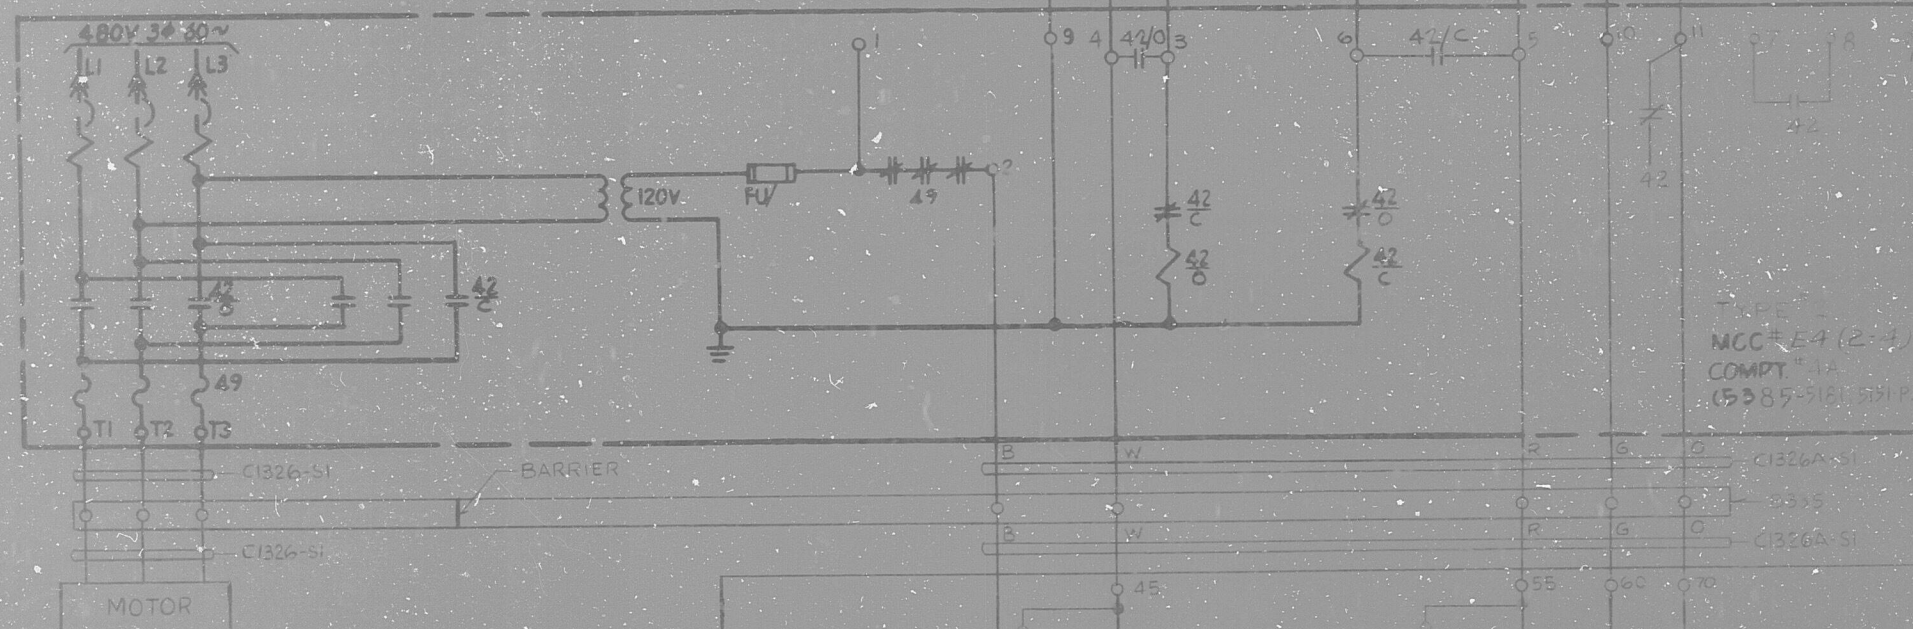

LIMIT SWITCH DEVELOPMENT

CONTACT	VALVE OPENING %	SHEET NO
LS1		
LS2		
LS3		
LS4		
LS5		
LS6		
LS7		
LS8		
LS9		
LS10		
LS11		
LS12		
LS13		
LS14		
LS15		
LS16		

* THIS SHEET
CONTACT CLOSED



VALVE V2-35A LIMIT SW (5385-6195)

THIS DOCUMENT IS THE PROPERTY OF ESASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT BETWEEN ESASCO SERVICES INCORPORATED AND GENERAL ELECTRIC.

REV	DATE	BY	APPROVED	REV	DATE	BY	APPROVED
1	8-25-76	RAY	1-CH/BL/ST	2	5-29-74	AS	W/MA
2	5-29-74	AS	W/MA	3	3-6-74	AM	W/MA

ESASCO SERVICES INCORPORATED NEW YORK	
DIV. <u>MC</u>	DR. <u>ESM</u>
SCALE <u>1/2"</u>	CH <u>HS</u>
DATE <u>DEC 2 1978</u>	BY <u>MF</u>

GENERAL ELECTRIC COMPANY
MILLSTONE NUCLEAR POWER STATION
CONTROL WIRING DIAGRAM
FEEDWATER BLOCK VALVE
1-FW 40°C V2-35A

B-187613
SHEET 322

8105110201

DOCKET
NUMBER

ACCESSION
NUMBER

DRAWING NUMBER

SHEET REV.

