

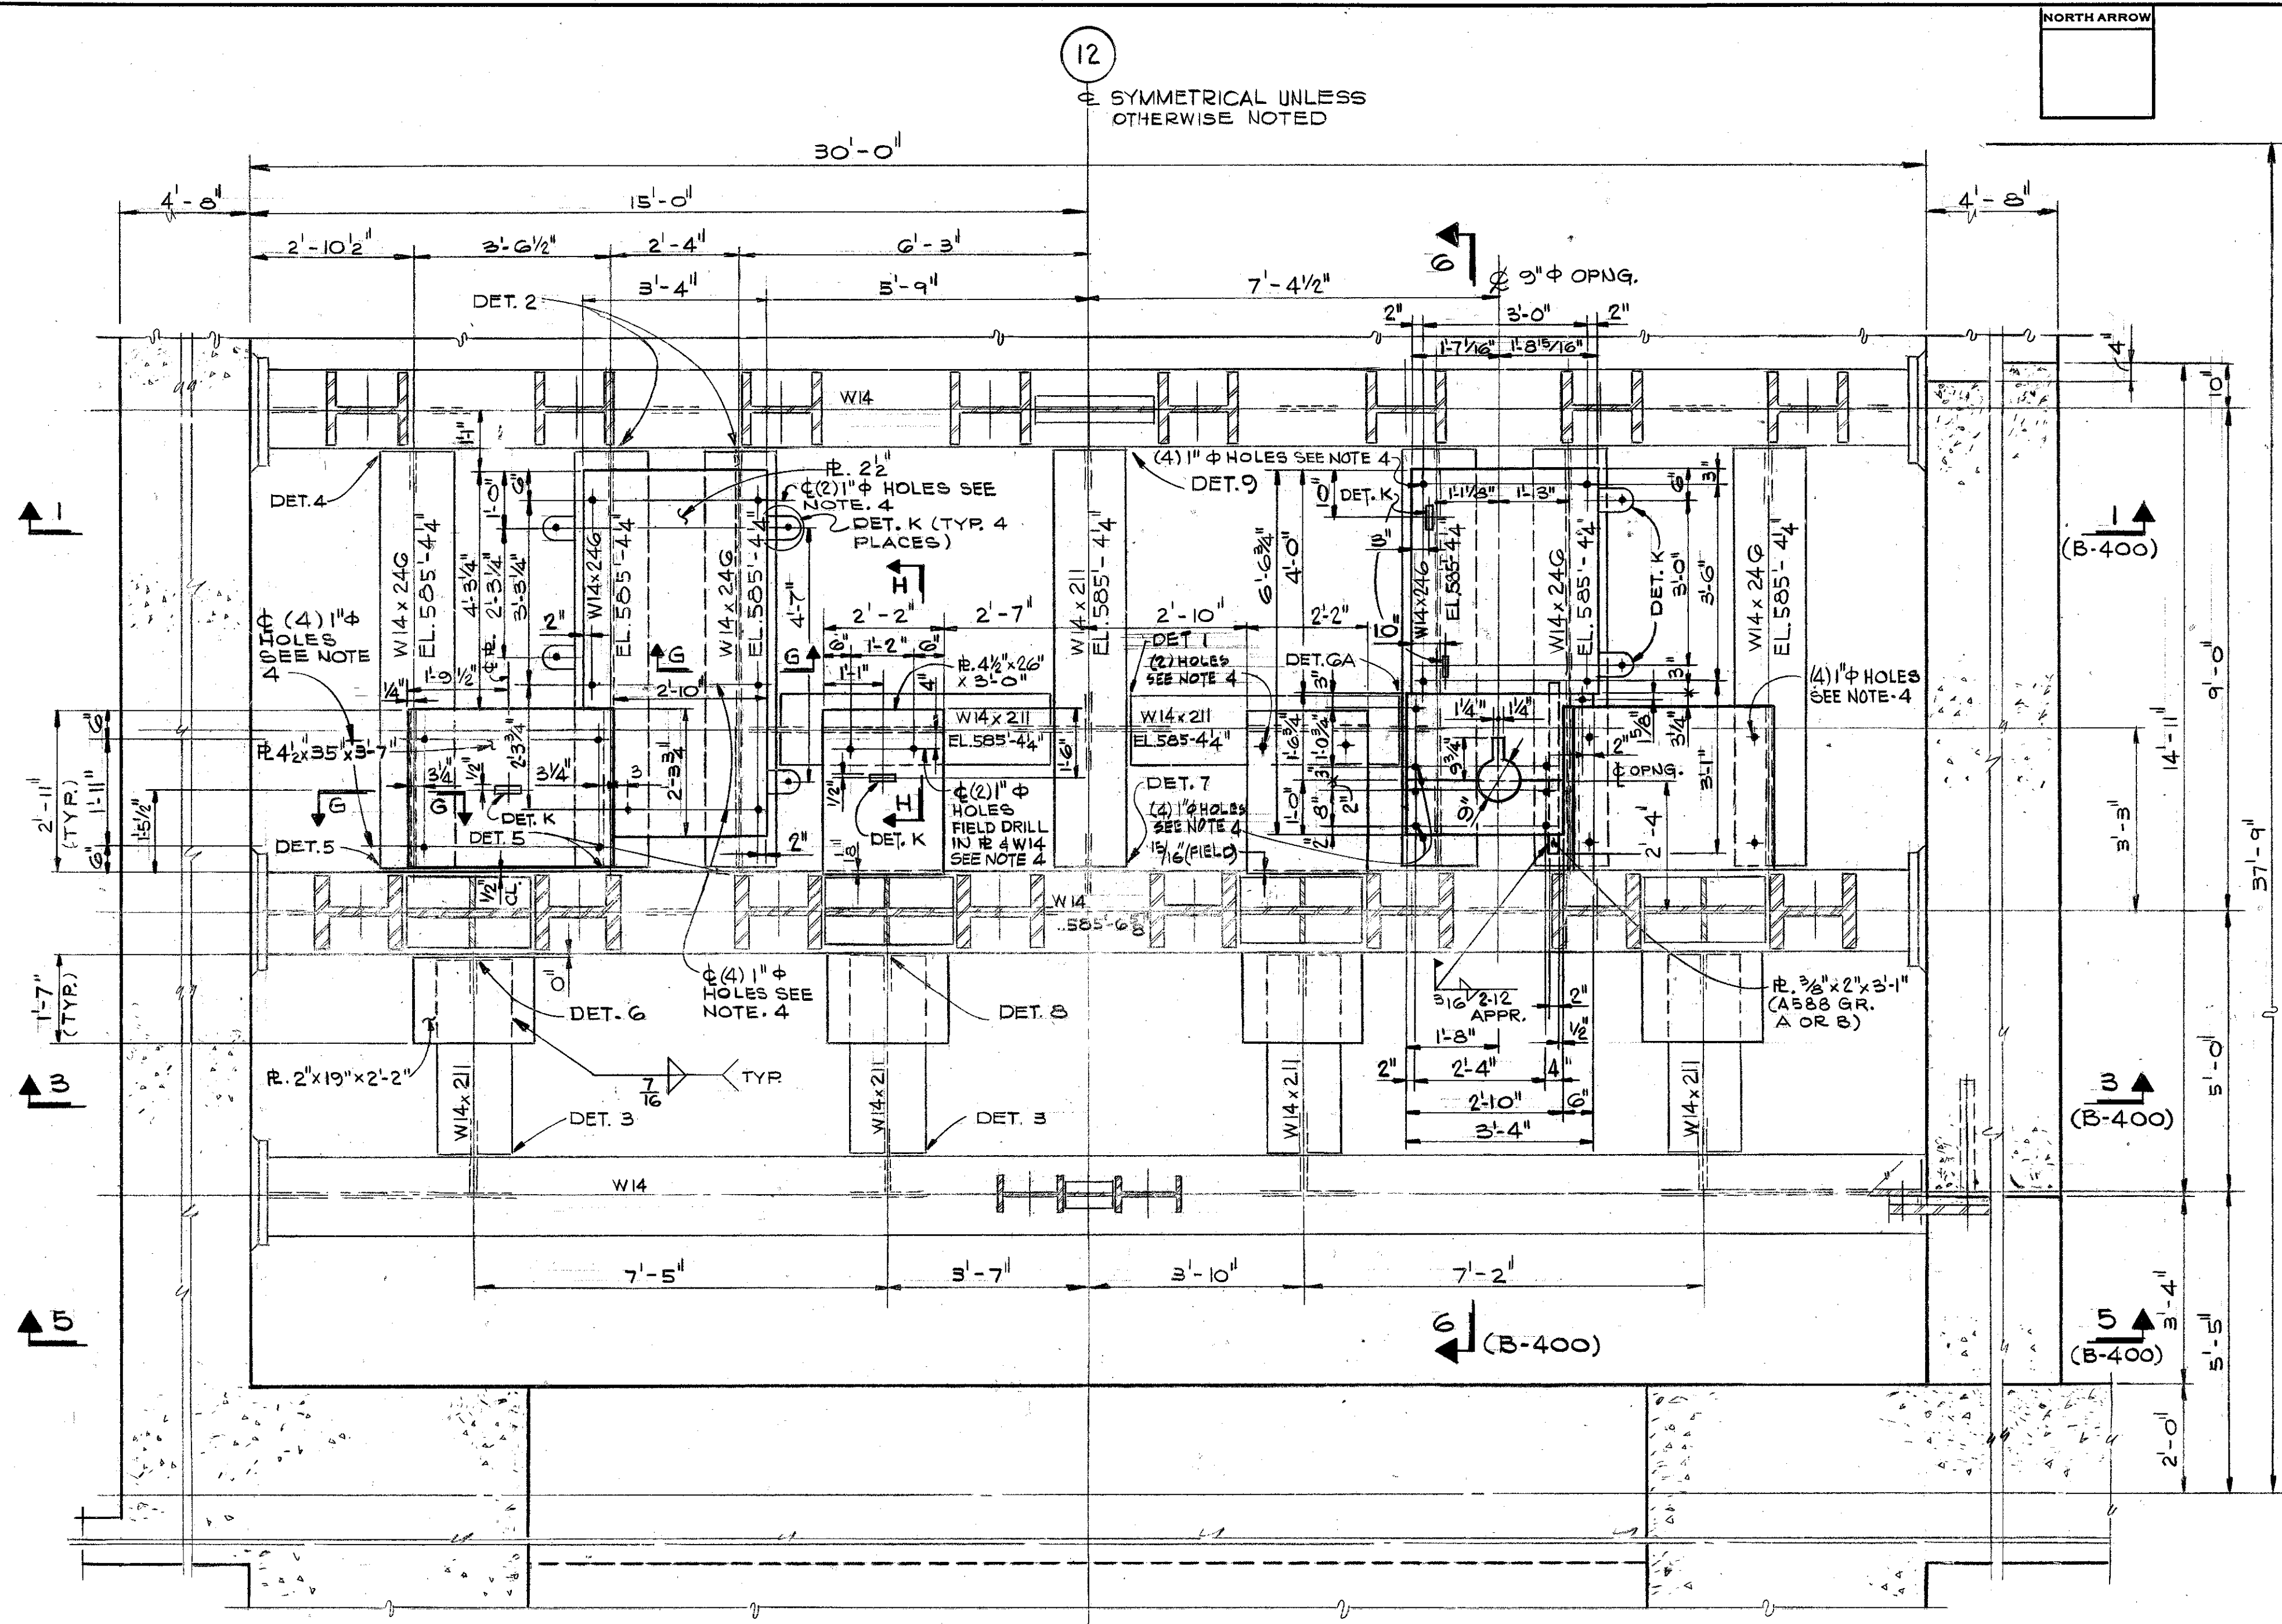
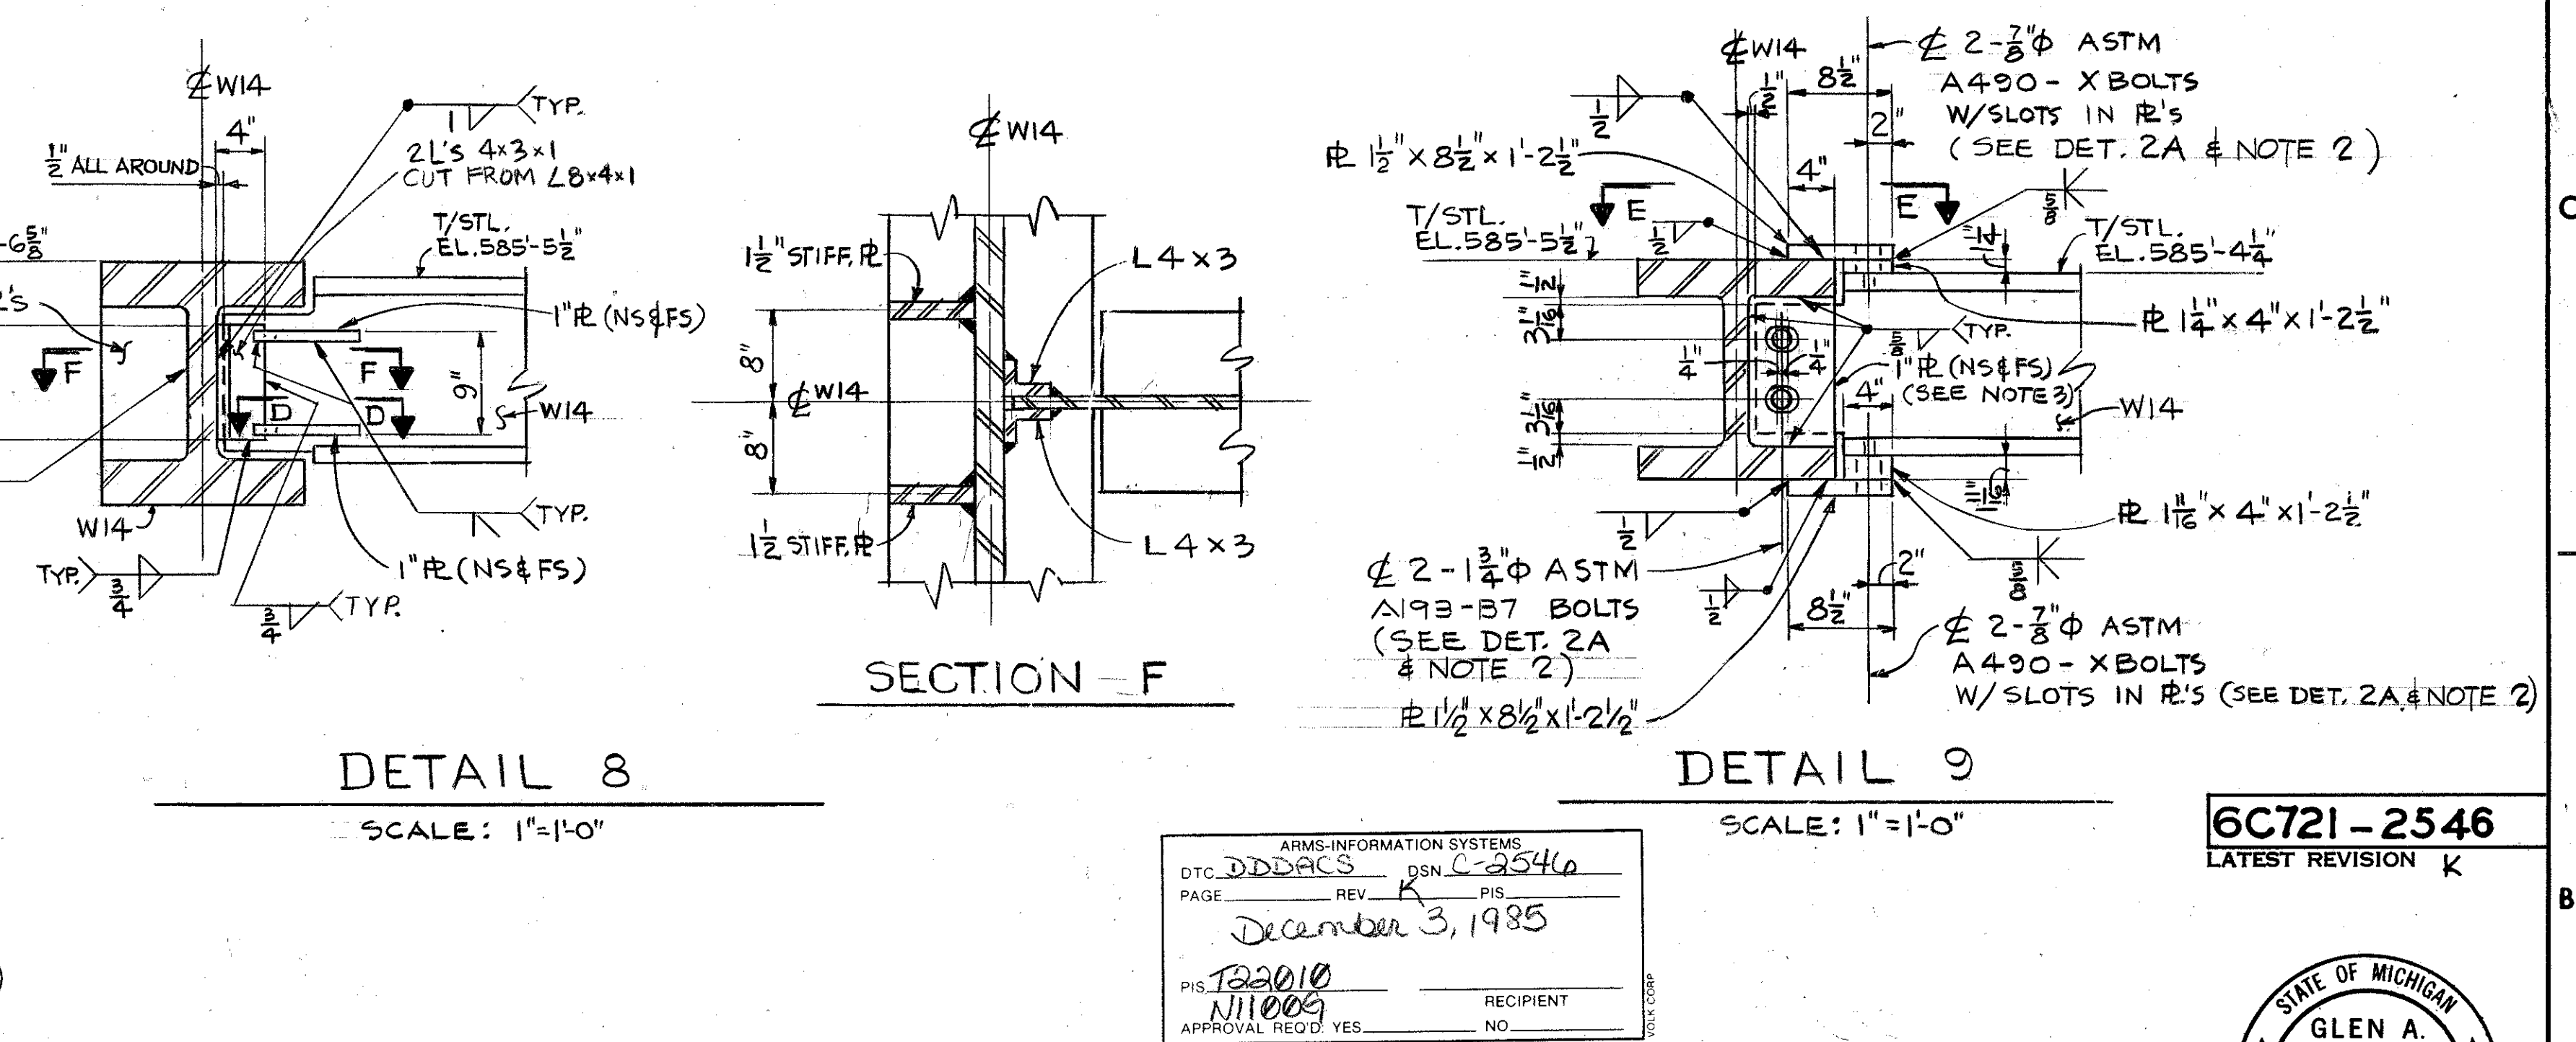
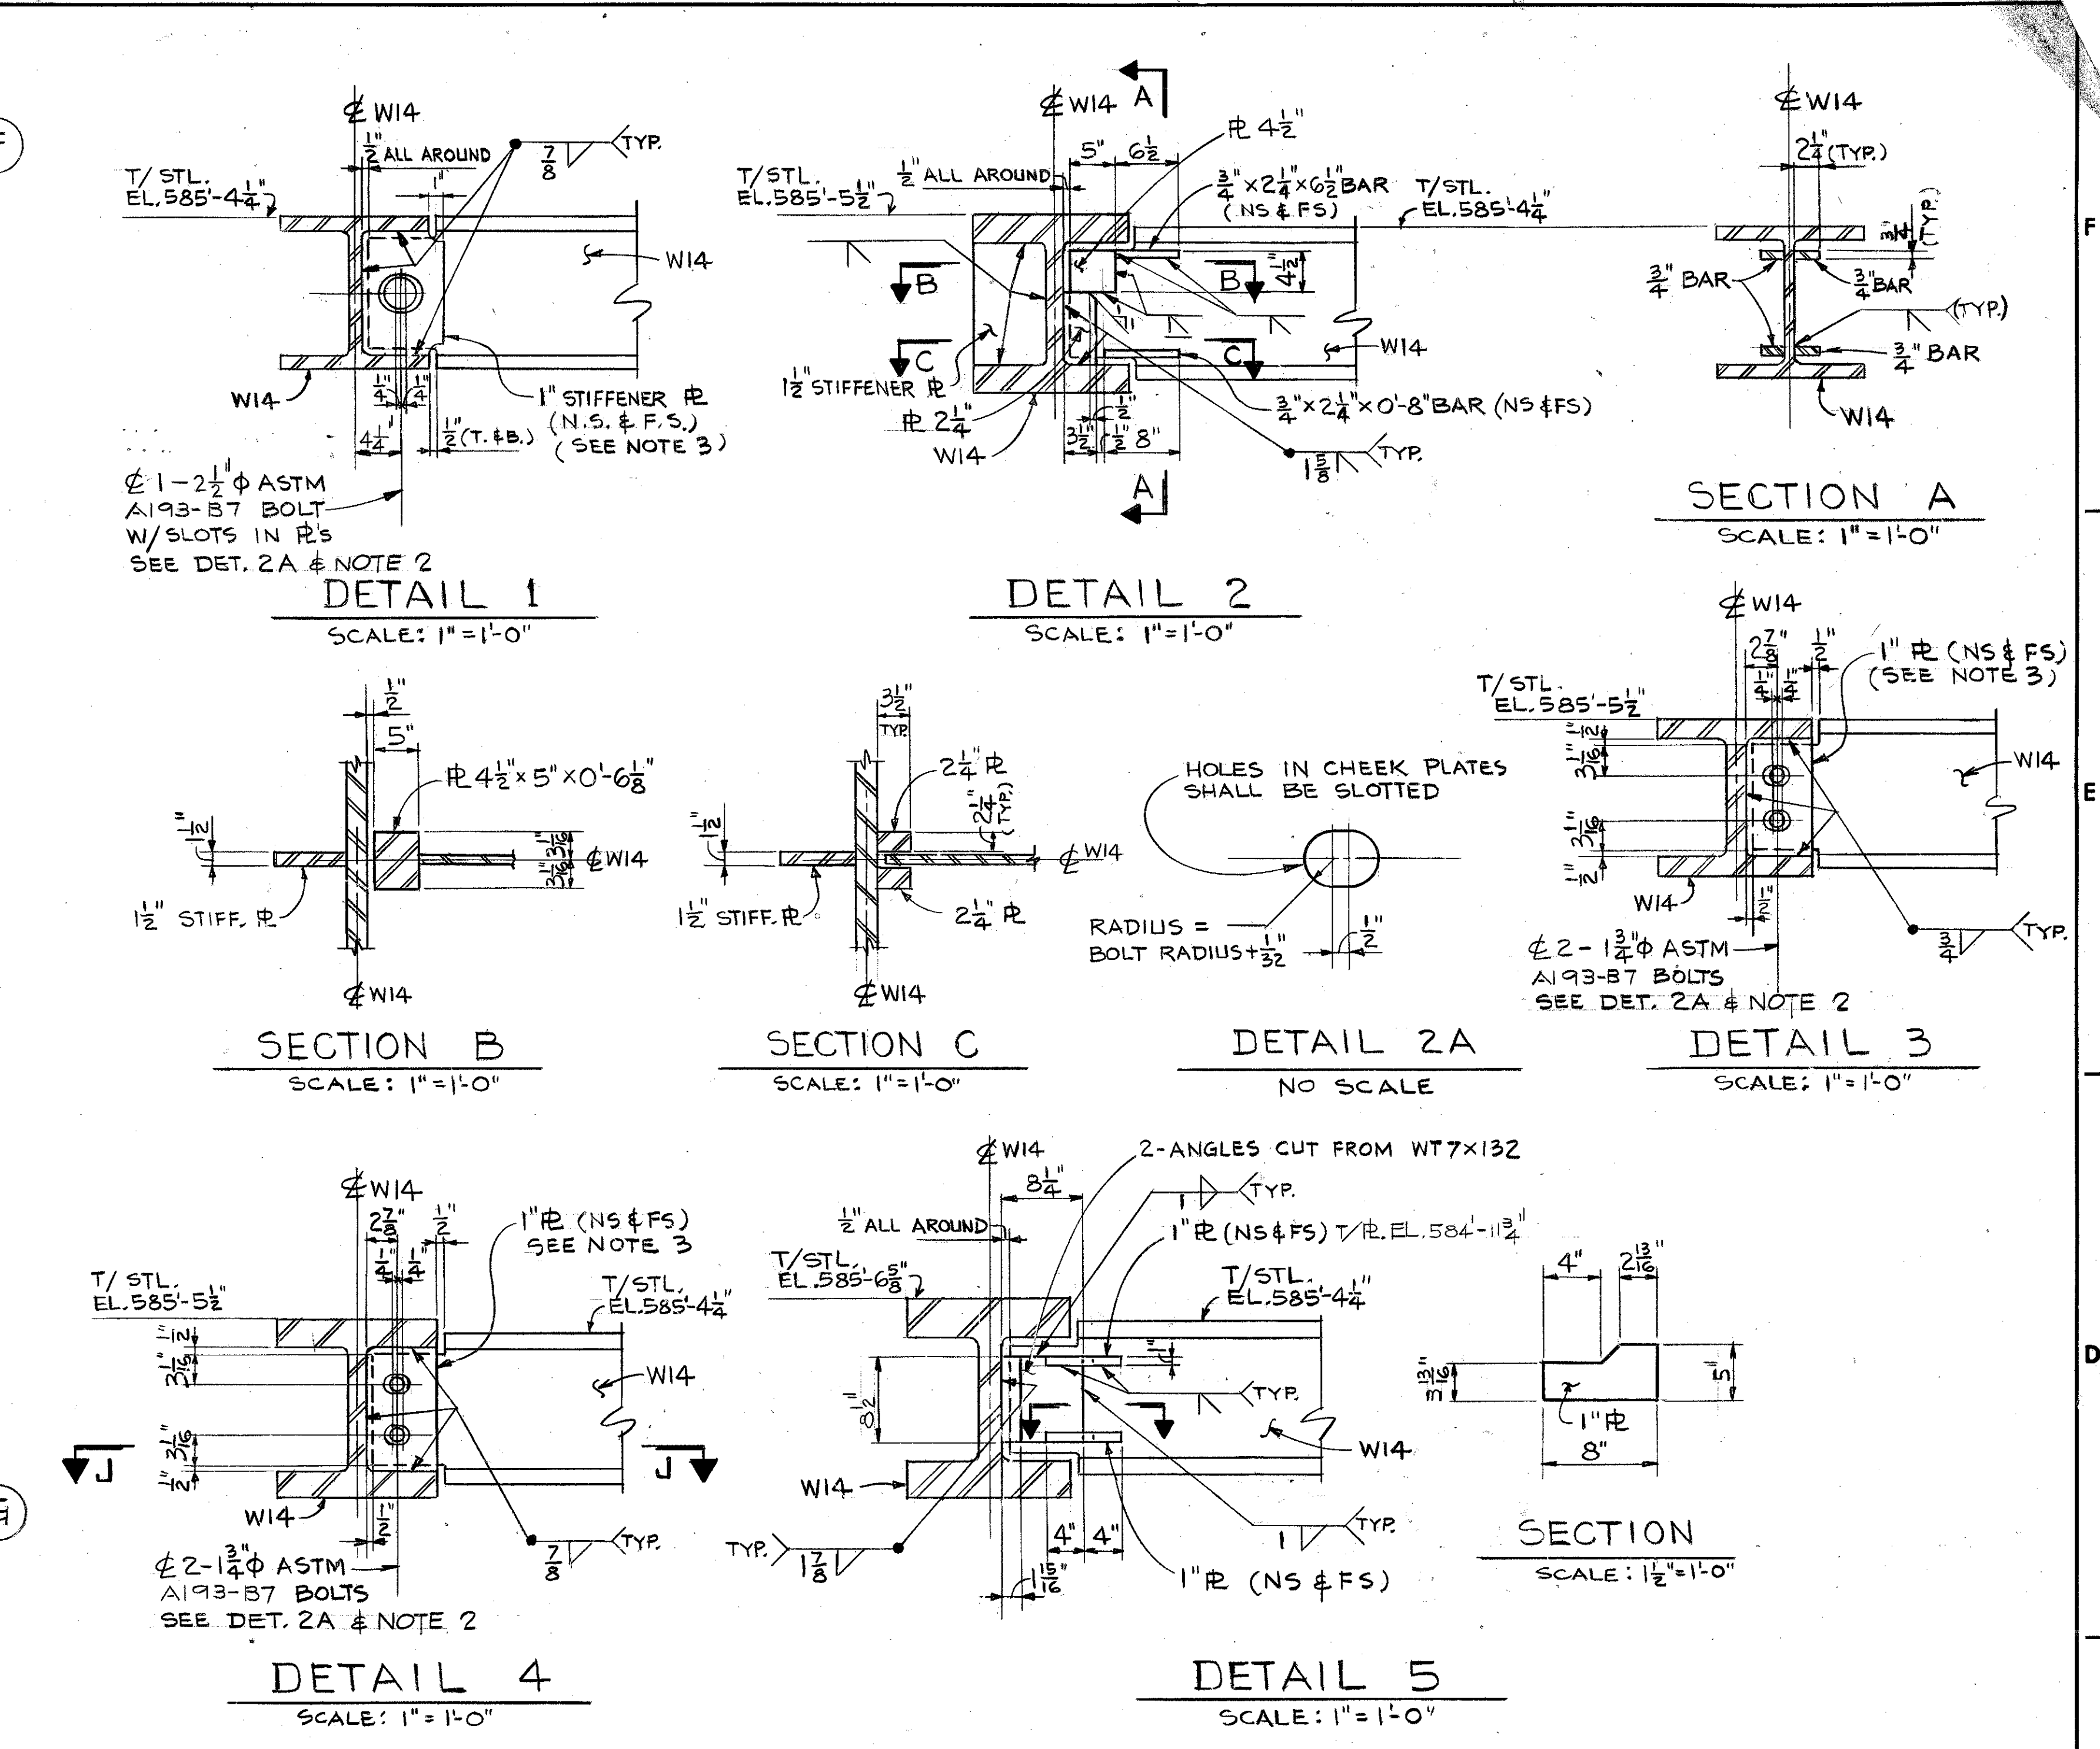
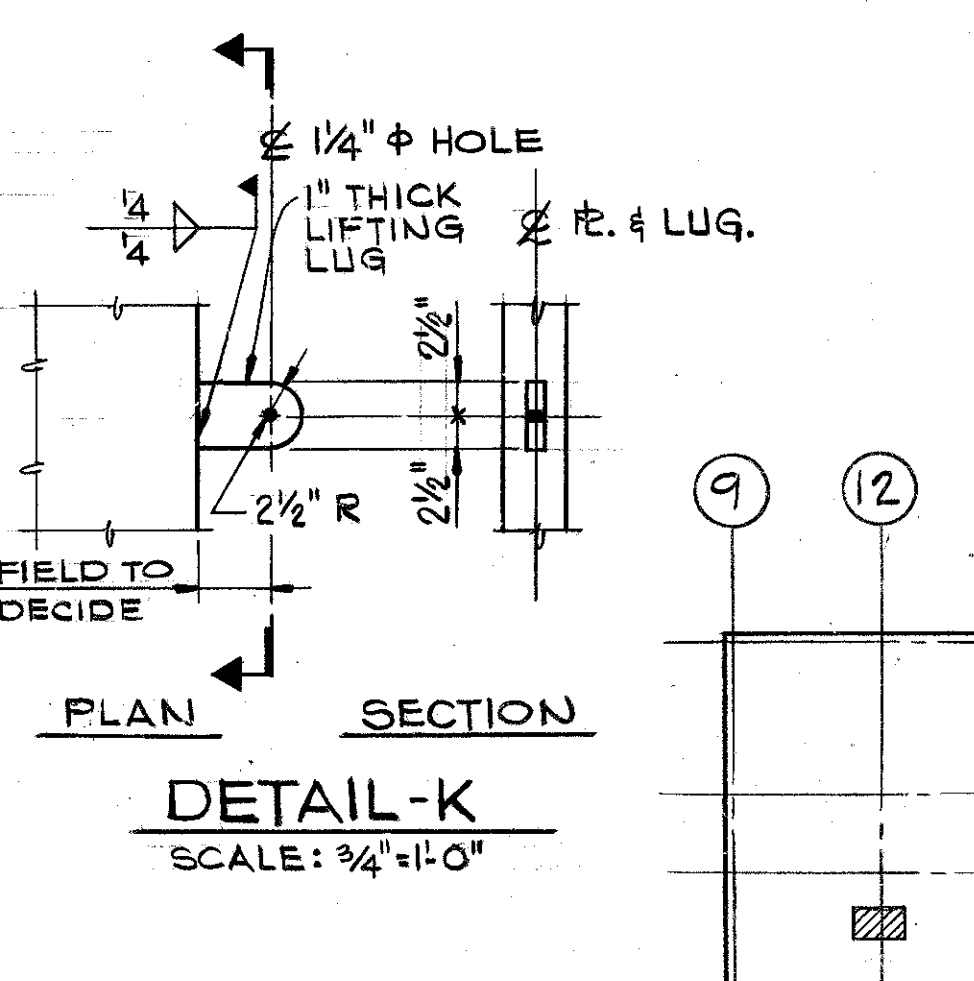
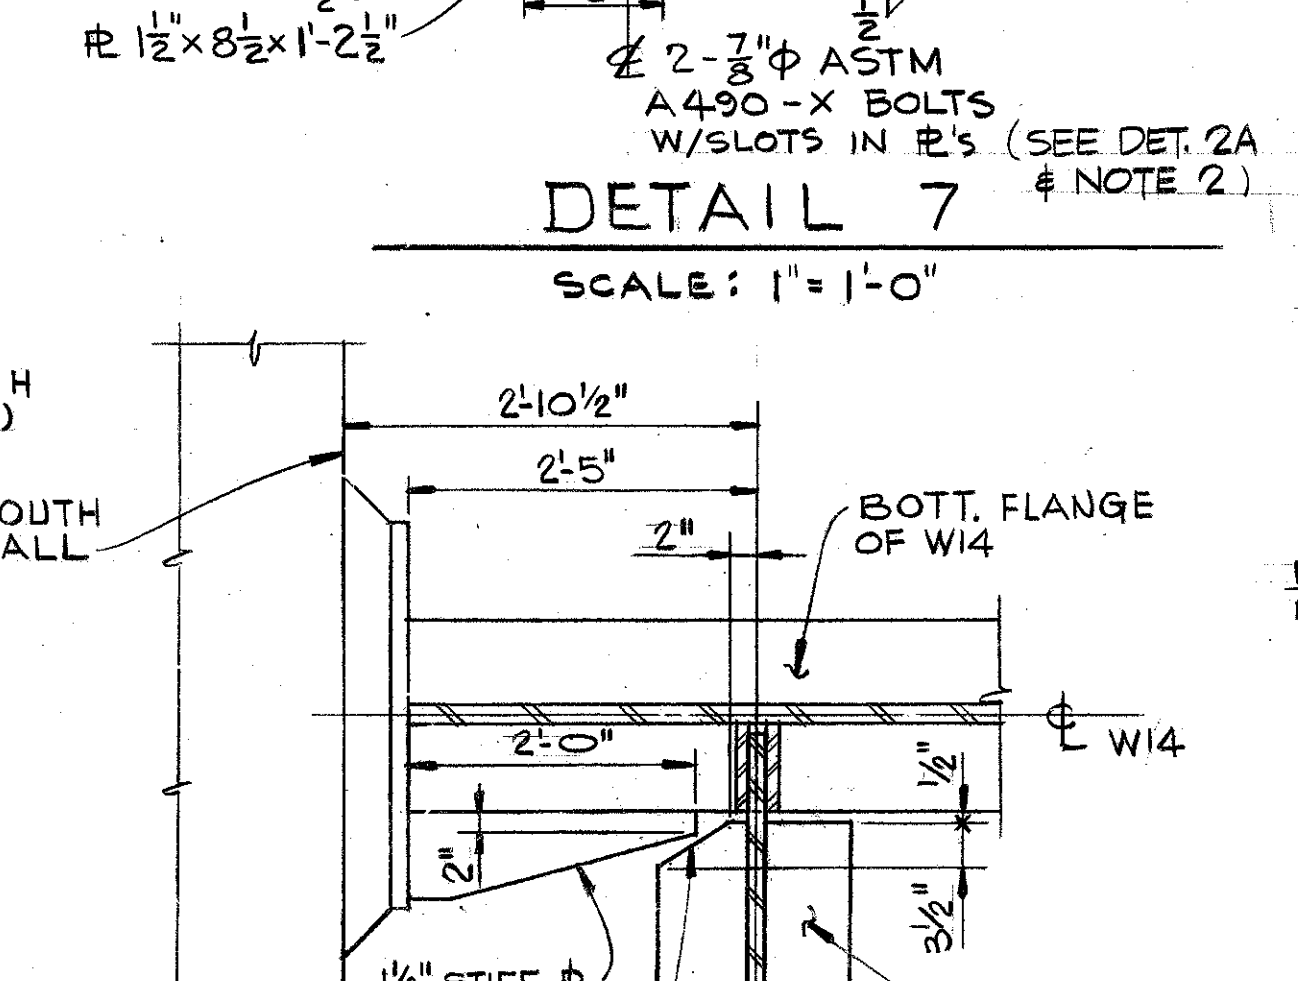
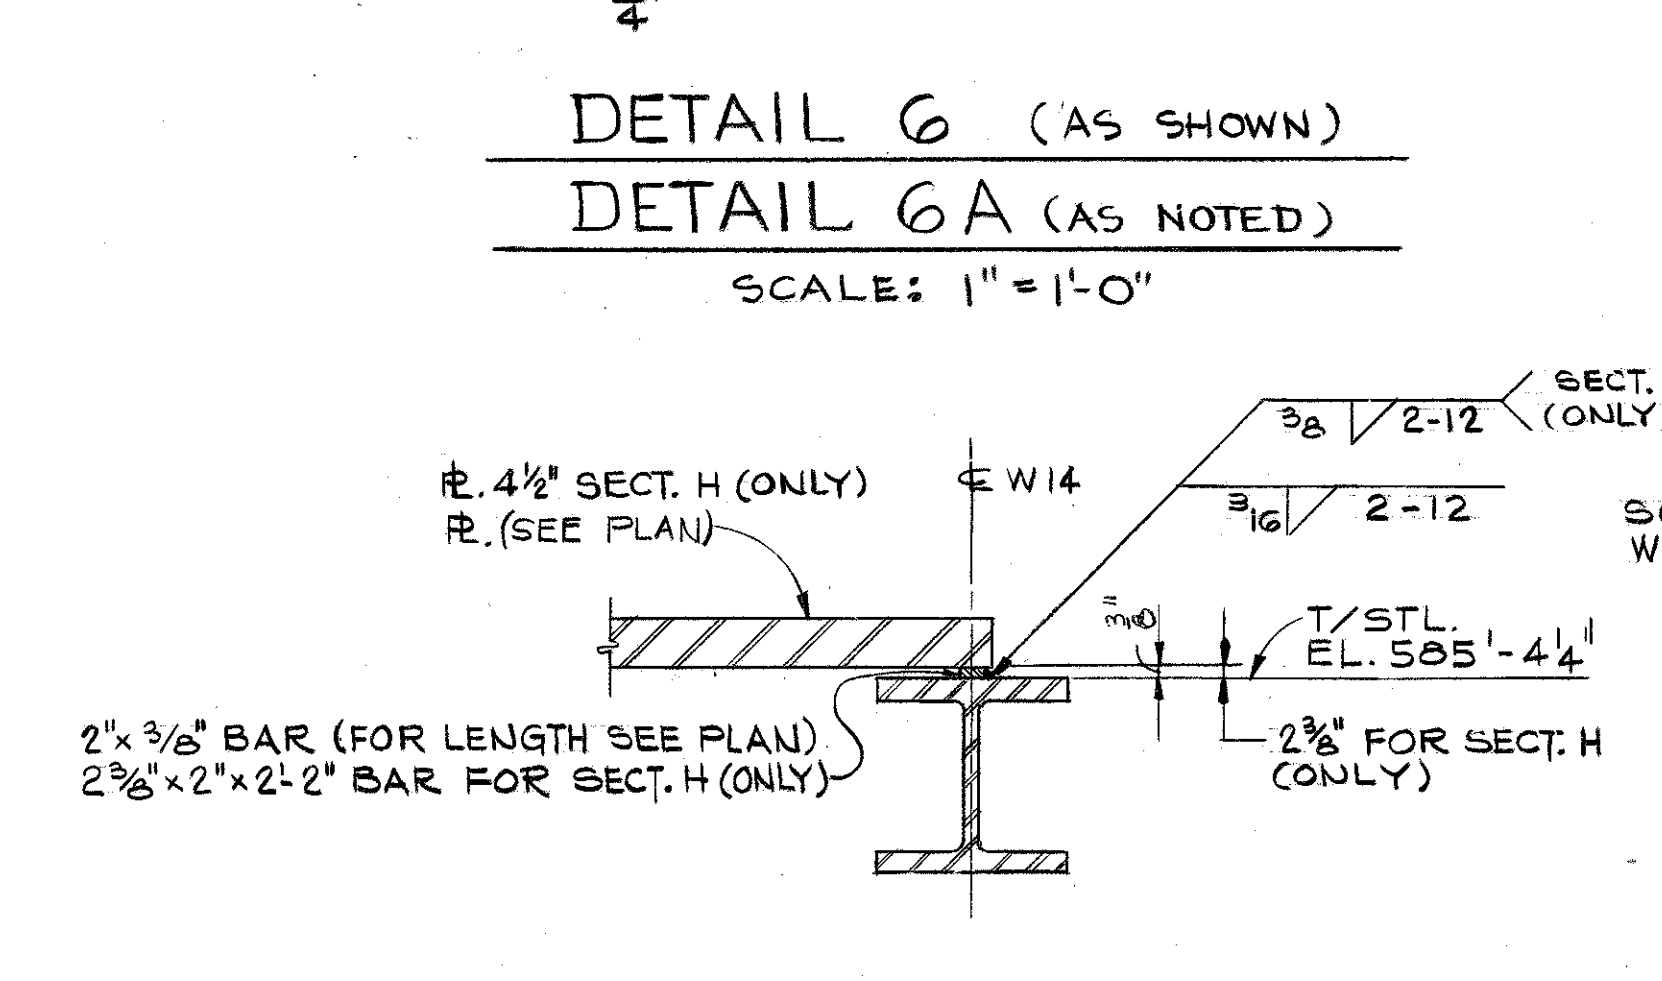
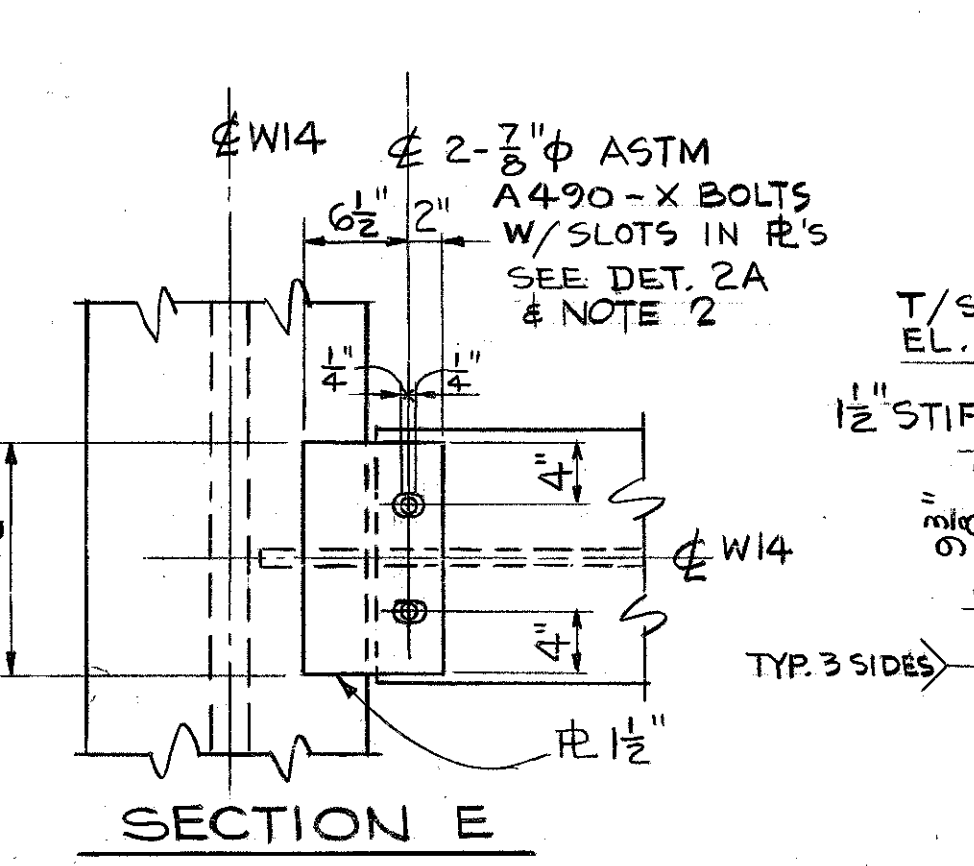


REV.	DATE	DESCRIPTION
1	11/17/77	FOR DETAILING MATERIAL REQUIREMENT

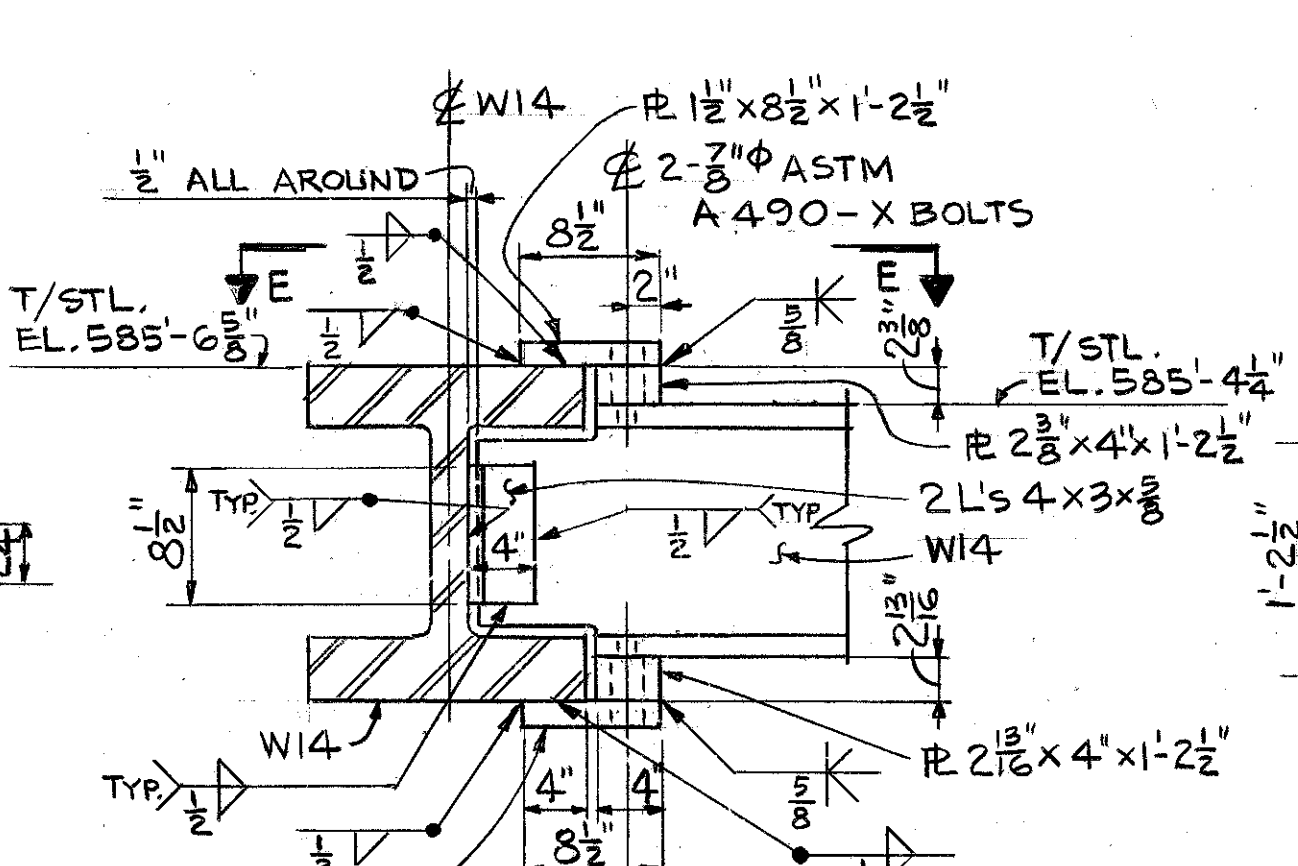

PLAN @ EL. 585'-5 1/2"  
T/STL. EL. 585'-5 1/2"

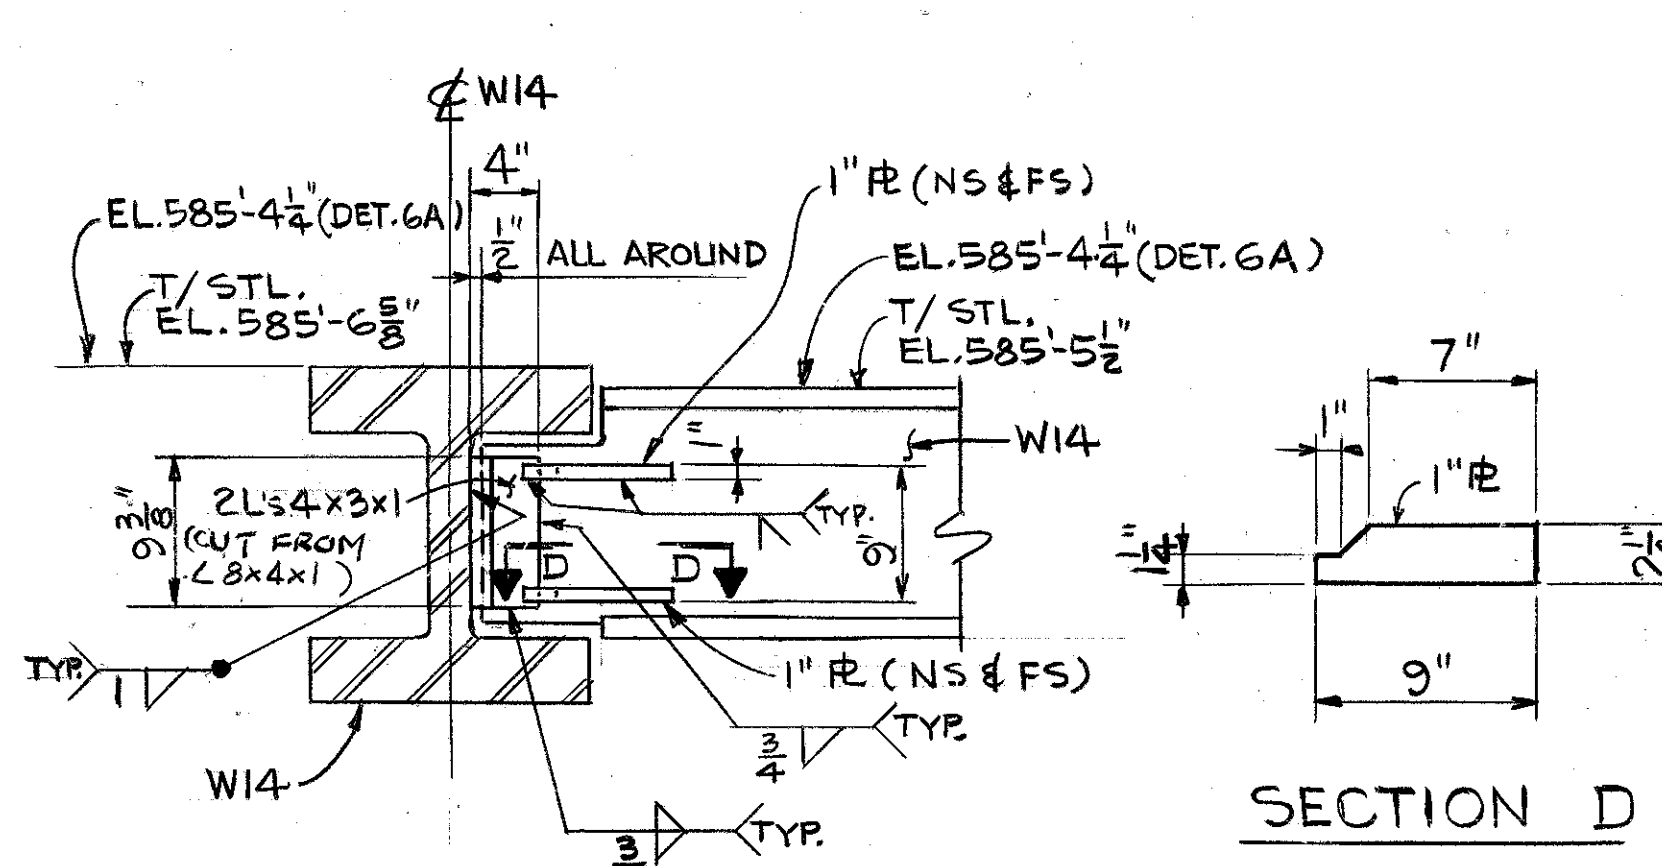

NOTES				REFERENCE DRAWINGS															
<p>1. FOR GENERAL NOTES, SEE DWG. B-400</p> <p>2. ALL BOLTS IN SLIDING CONNECTIONS SHALL BE INSTALLED TO MEET THE REQUIREMENTS OF NOTE 20, DWG. B-400.</p> <p>3. PLATES IN SLIDING BEARING TYPE CONNECTIONS SHALL HAVE 1/2" INCH CLEARANCE ON EACH SIDE OF THE WEB OF THE CONNECTING MEMBER.</p> <p>4. 1/2" OVERSIZE HOLE TO BE DRILLED IN FIELD FOR 3/4" A490 BOLT. BOLTS SHALL BE INSTALLED TO MEET THE REQUIREMENTS OF NOTE 20, DWG. B-400.</p> <p>ALL PREVIOUS REVISIONS TO THIS DOCUMENT HAVE BEEN APPROVED BY EDISON AND ARE IN FILE OF MICROFILM IN DOCUMENT CONTROL.</p>				<p>ARM'S-INFO SYSTEMS DTC-DDDACS DSN C-2540 PAGE REV. PIS December 3, 1985 PIS: 132010 111009 APPROVAL REQ'D YES NO</p>															
<p>REVISIONS:</p> <table border="1"> <tr> <th>NO.</th> <th>DATE</th> <th>DESCRIPTION</th> </tr> <tr> <td>1</td> <td>11/17/77</td> <td>FOR DETAILING MATERIAL REQUIREMENT</td> </tr> </table>				NO.	DATE	DESCRIPTION	1	11/17/77	FOR DETAILING MATERIAL REQUIREMENT	<p>REVISIONS:</p> <table border="1"> <tr> <th>NO.</th> <th>DATE</th> <th>DESCRIPTION</th> </tr> <tr> <td>1</td> <td>11/17/77</td> <td>FOR DETAILING MATERIAL REQUIREMENT</td> </tr> </table>				NO.	DATE	DESCRIPTION	1	11/17/77	FOR DETAILING MATERIAL REQUIREMENT
NO.	DATE	DESCRIPTION																	
1	11/17/77	FOR DETAILING MATERIAL REQUIREMENT																	
NO.	DATE	DESCRIPTION																	
1	11/17/77	FOR DETAILING MATERIAL REQUIREMENT																	
<p>PROJECT: STEAM TUNNEL LOWER PIPE WHIP RESTRAINT-JET IMPINGEMENT SHIELDS, PLAN, SECTIONS &amp; DETAILS UNIT 2</p> <p>LOCATION: ENRICO FERMIL ATOMIC POWER PLANT</p> <p>DOCUMENT CONTROL NO. T22 OF 0 G00 DA 025</p>				<p>ENGINEER: GLEN A. CHAVIN, REGISTERED PROFESSIONAL ENGINEER, No. 22139</p> <p>SCALE: 1" = 1'-0" (unless otherwise noted)</p>															