

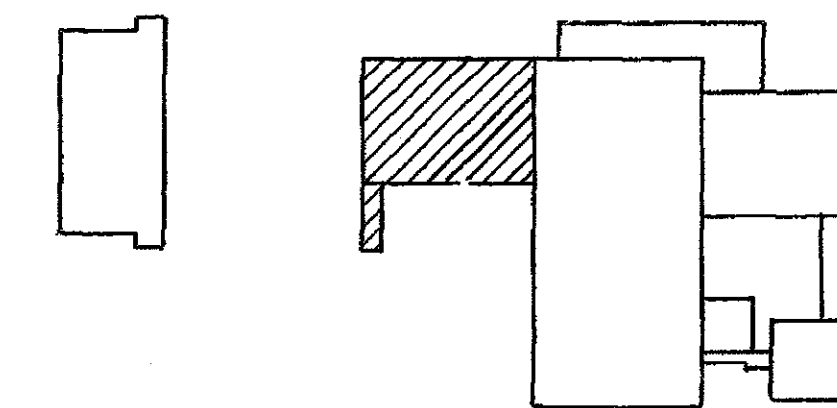




KEY PLAN

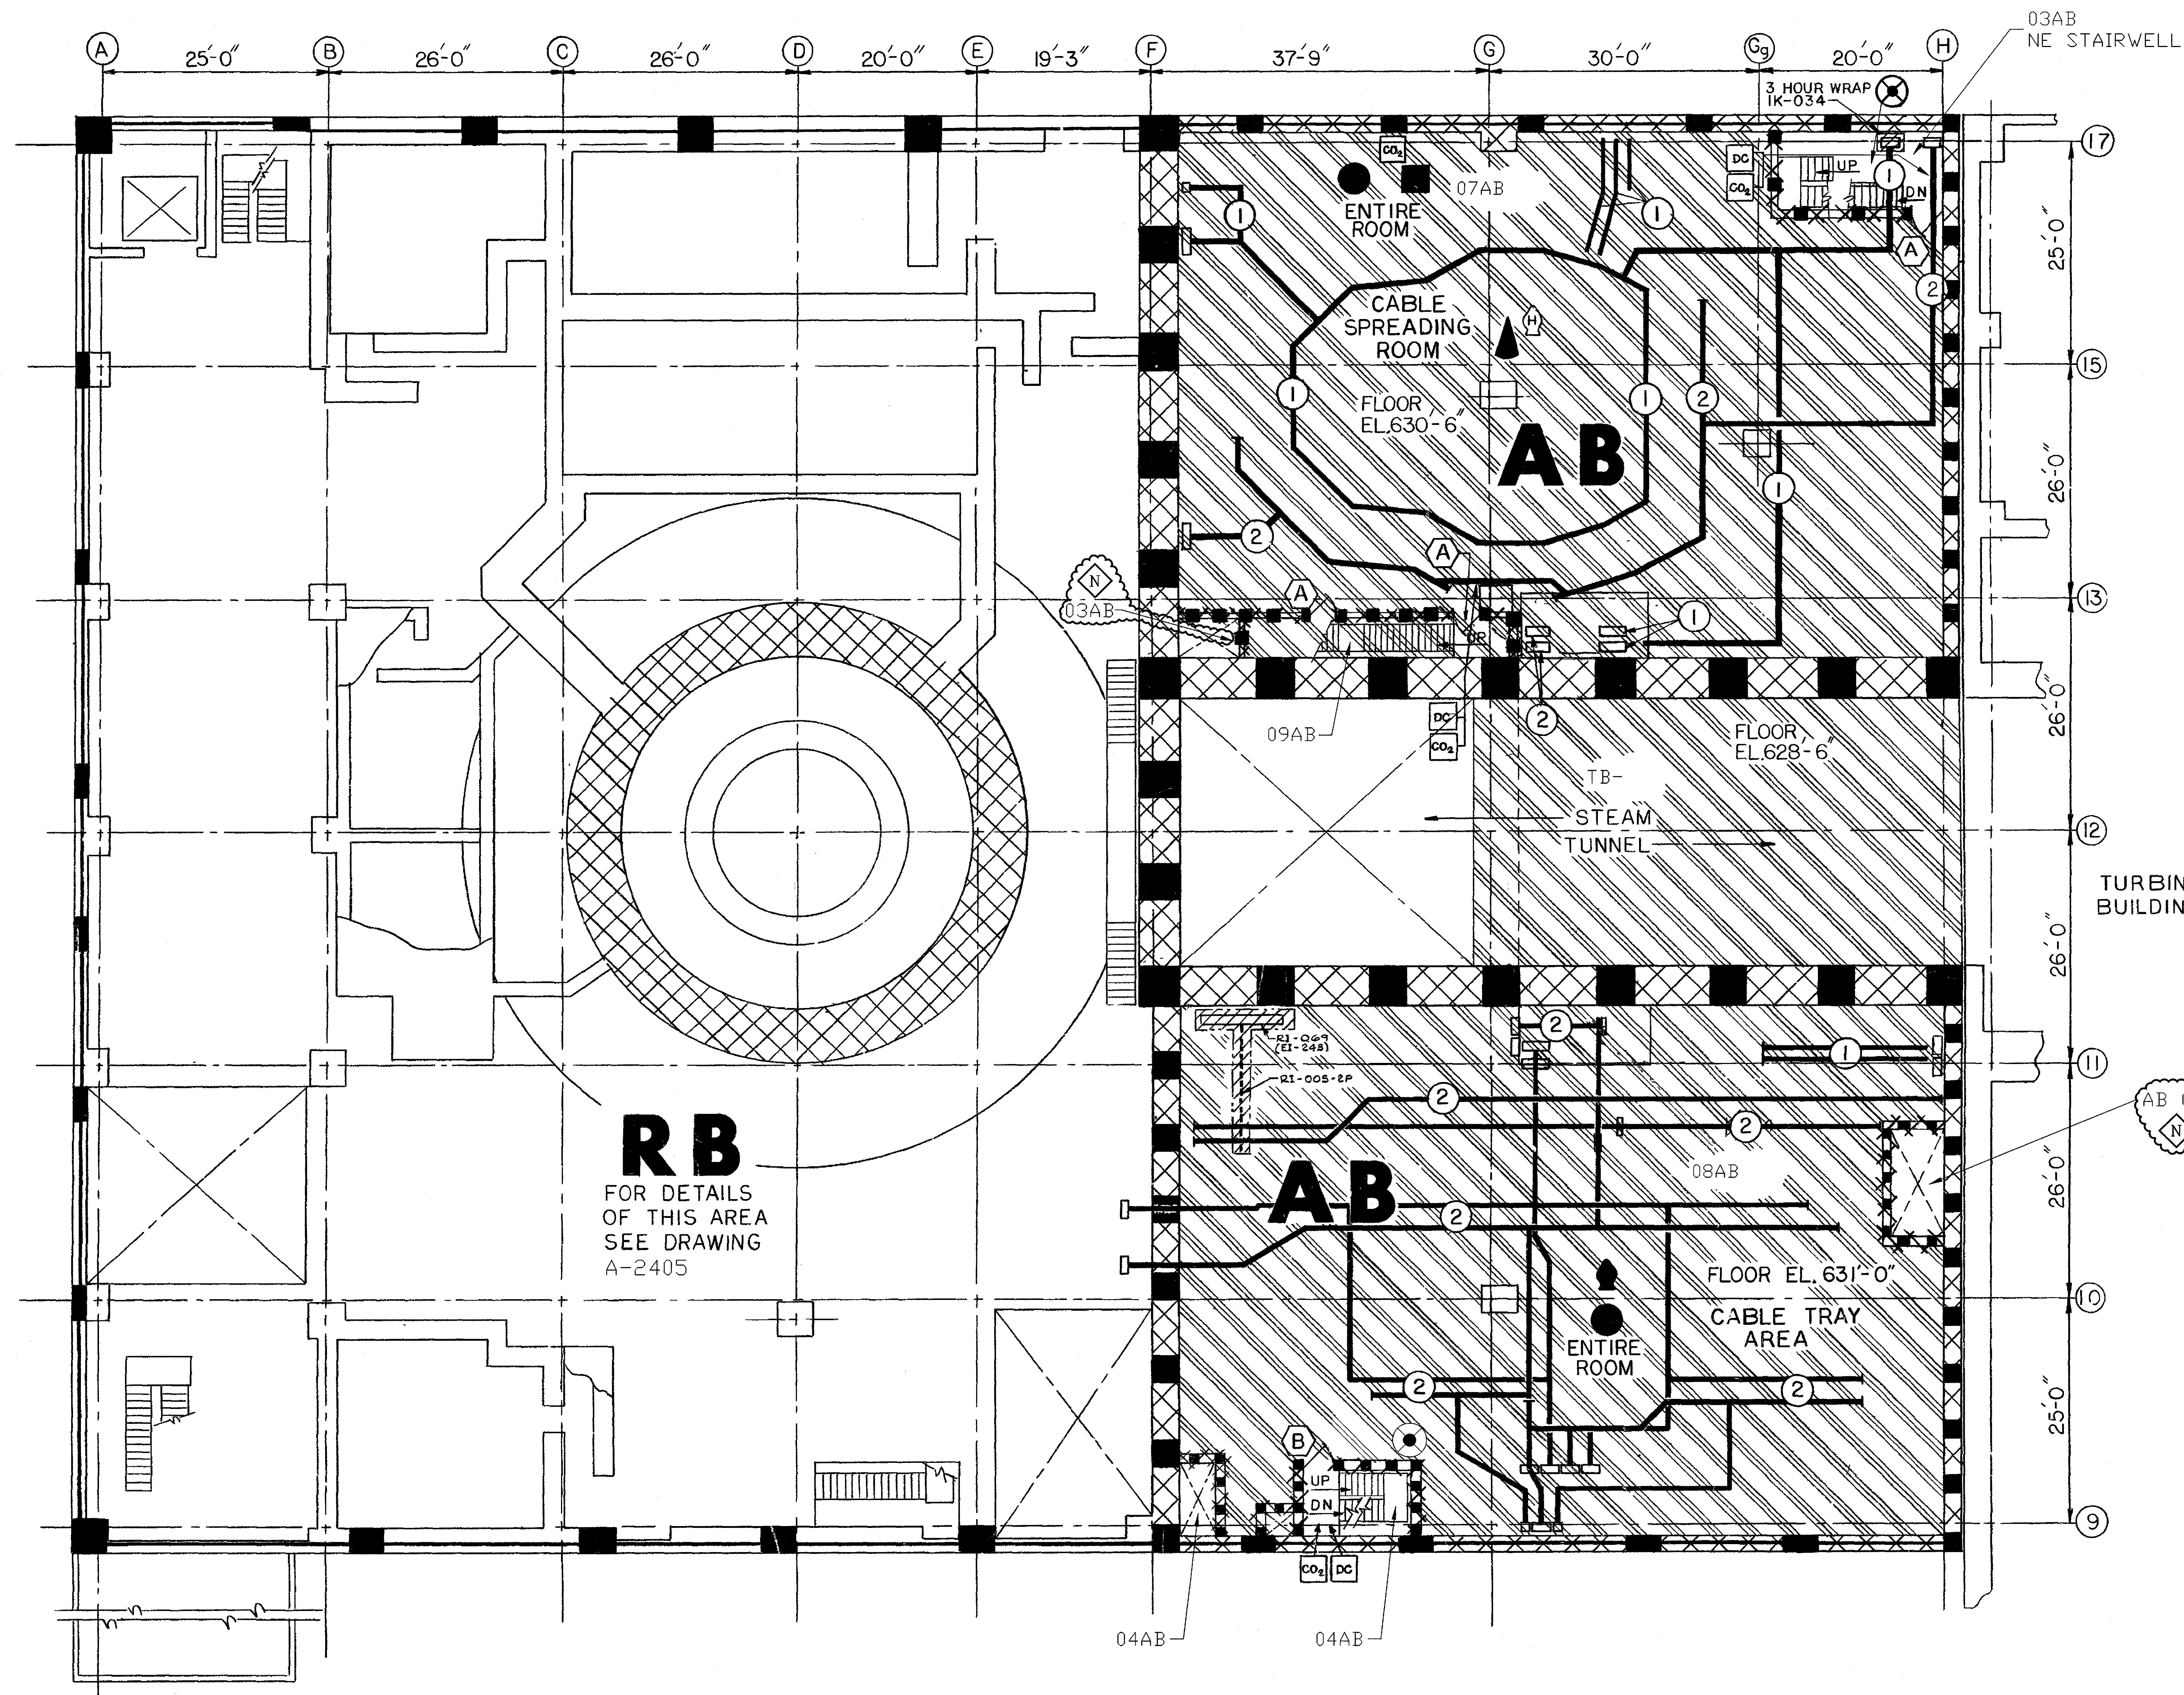

NOTES

1. FOR FIRE PROTECTION LEGEND DESTINATION SEE DWG. A-2400.
2. REFER TO DRAWING A-2400 FOR FIRE DETECTION ZONE VERSUS UFSAR FIRE ZONE CROSS REFERENCE.

6A721-2406
LATEST REVISION N

NON-NUCLEAR SAFETY RELATED

THIS IS A MICROSTATION PRODUCED DRAWING. CHANGES OR REVISIONS MUST BE BROUGHT TO THE ATTENTION OF THE PLANT ENGINEERING DESIGN GROUP TO ENSURE THAT CONFIGURATION CONTROL IS MAINTAINED.

THIS DRAWING WAS REFORMATTED BY MICROSTATION AT REVISION "N". ALL PREVIOUS APPROVAL SIGNATURES ARE ON FILE ON MICROFILM IN DOCUMENT CONTROL.		INC. CODE		Detroit Edison		Fermi 2	
A PORTION OF THIS DRAWING IS AFFECTED BY THE FOLLOWING:		U		TITLE		FIRE PROTECTION EVALUATION REACTOR AND AUXILIARY BUILDINGS CABLE SPREADING AREA PLAN EL. 630'-6"	
OTHER REVISIONS: REVISED PER LCR 03-093-UFS (REF. CARD 05-264880)		TC		CHANGED DOCUMENT		APPROVED BY	
PREPARED BY C. BRZUSTEWICZ		DATE		11/22/05		DATE	
CHECKED BY J. Williams		DATE		11/29/05		DATE	
APPROVED BY R. L. Tressell		DATE		1/16/06		DATE	
SIGN PORTING ENTRIES REQUIRE THE ADDITION OF THE SIGNATURE CODE EITHER "AC" OR "AP"		OTHER APPROVALS		DATE		DATE	
APERTURE CARD TITLE FIRE PROT EVAL RB & AUX EL. 630'-6"		PLANT IDENTIFICATION SYSTEM NUMBER 18000, 10000		DOCUMENT TYPE CODE DDDACs		NUC OPS FILE NO. 1801	
DRAWING NUMBER 6A721-2406		DATE ISSUED TO IS 12-7-05		REV. N		REV.	