

Security - Related Information Withheld Under 10 CFR 2.390

A	BYRON / BRAIDWOOD STATION FIRE PROTECTION REPORT	A
	FIGURE 2.3-19 FUEL HANDLING FLOOR ELEVATION 426'-0"	
	(SHEET 1 OF 1)	

Security - Related Information Withheld Under 10 CFR 2.390

BYRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT

FIGURE 2.3-20
FUEL HANDLING BUILDING
EL. 401'-0"
(SHEET 1 OF 1)

| 2.3-20


BYRON / BRAIDWOOD STATION FIRE PROTECTION DESIGN

Security - Related Information Withheld Under 10 CFR 2.390

OFFICE	OFFICE		<p>BYRON / BRAIDWOOD STATION FIRE PROTECTION DESIGN FIGURE 2.3-21 SECTION "A-A" (SHEET 1 OF 2)</p>
--------	--------	--	--

Security - Related Information Withheld Under 10 CFR 2.390

Security - Related Information Withheld Under 10 CFR 2.390

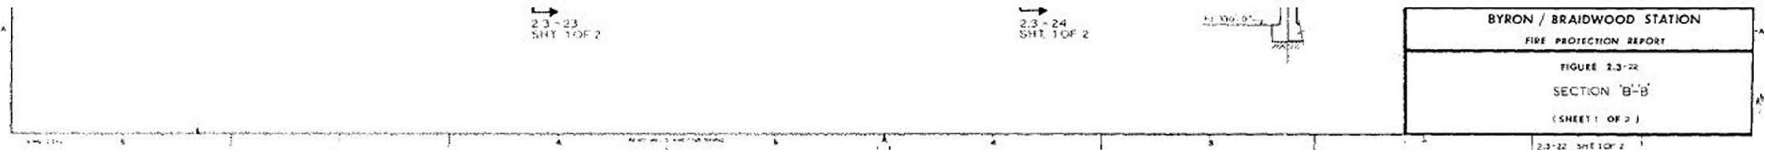

Security - Related Information Withheld Under 10 CFR 2.390

BYRON / BRAIDWOOD STATION
SIDE BONDING AREA
FIGURE 2.3-22
SECTION 'B-B'
CHECK - 04 - 0

Blurred header text at the top of the page, likely containing document identification or classification information.

Security - Related Information Withheld Under 10 CFR 2.390

BYRON / BRAIDWOOD STATION FIRE PROTECTION REPORT
FIGURE 2.3-05 SECTION 'C/C'
(SHEET 1 OF 2)

Security - Related Information Withheld Under 10 CFR 2.390

BYRON / BRAIDWOOD STATION	
FIRE PROTECTION REPORT	BT
FIGURE 2.3-23	
SECTION 2.3.1	
SHEET 1 OF 1	

Security - Related Information Withheld Under 10 CFR 2.390

|

STRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT
RBD078 8.1-04
SECTION "D-3"
PAGE 1 OF 1
T

Security - Related Information Withheld Under 10 CFR 2.390

BYRON / BRAIDWOOD STATION
FIRE PROTECTION SYSTEM
FIGURE 2.3-24
SECTION 'D-D'
SCALE: 1" = 10'-0"

BYRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT
FIGURE 2.3-25
SECTION 'C-C'
(SHEET 1 OF 2)

Security - Related Information Withheld Under 10 CFR 2.390




Security - Related Information Withheld Under 10 CFR 2.390

EVAN / BRAINWOOD STATION
FIRE PROTECTION REPORT


FIGURE 2.3-25
SECTION E-E'

(SHEET 2 OF 2)

Security - Related Information Withheld Under 10 CFR 2.390

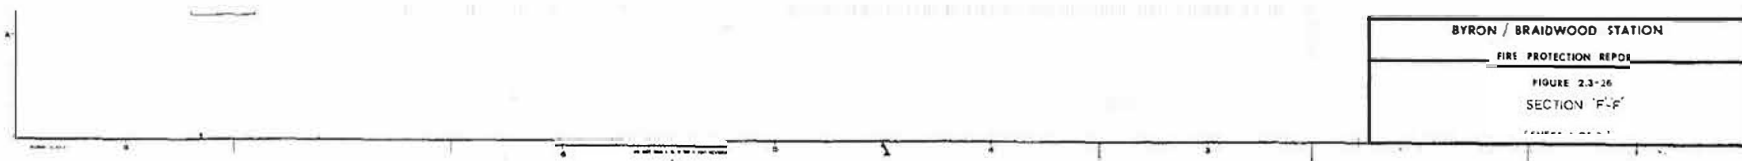

Security - Related Information Withheld Under 10 CFR 2.390

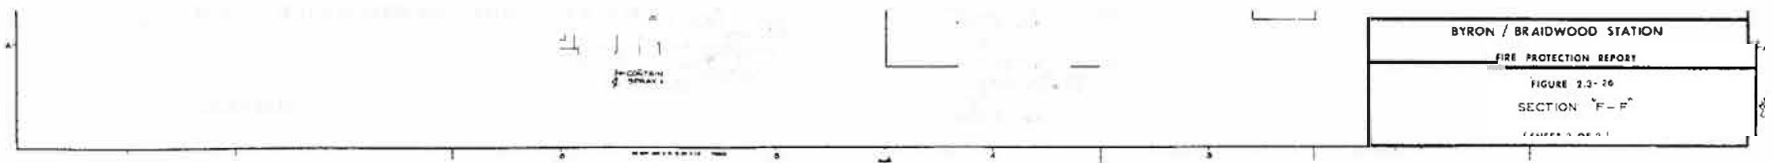

Security - Related Information Withheld Under 10 CFR 2.390

BYRON / STATION
FIGURE 2.3-27
PLAN & SECTION
CIRCULATING WATER PUMP HOUSE
(SHEET 1 OF 1)

Security - Related Information Withheld Under 10 CFR 2.390



Security - Related Information Withheld Under 10 CFR 2.390

BYRON / STATION
FIRE PROTECTION REPORT
FIGURE 2.3-29
PLANS & SECTION
RIVER SCREEN HOUSE
(SHEET 1 OF 1)



Security - Related Information Withheld Under 10 CFR 2.390



Security - Related Information Withheld Under 10 CFR 2.390

BYRON	STATION
FIRE PROTECTION REPORT	
ESSENTIAL SERVICE COOLING TOWER	
[SHEET 1 OF 2]	

Security - Related Information Withheld Under 10 CFR 2.390

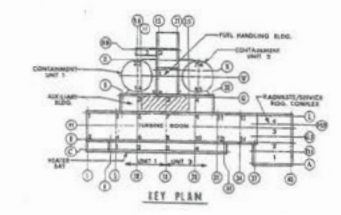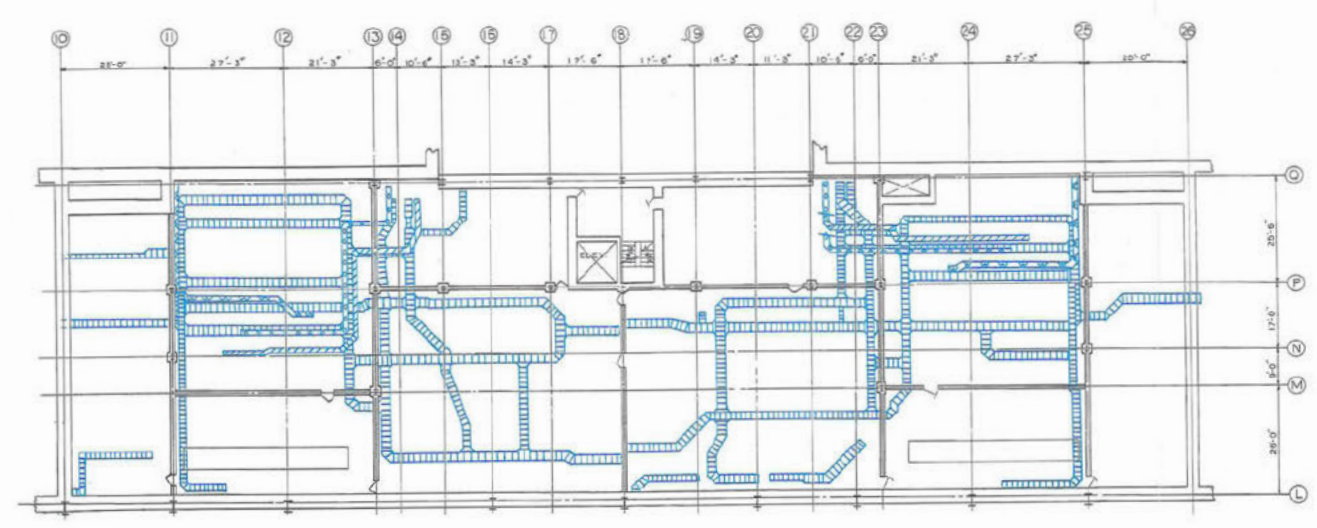

BYRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT
FIGURE 2.3-32
CABLE TRAY INSTALLATION
EL. 483-472
(SHEET 1 OF 1)

Security - Related Information Withheld Under 10 CFR 2.390



BYRON / BRAIDWOOD STATION

FIRE PROTECTION REPORT

FIGURE 2.3-33


CABLE TRAY INSTALLATION AT EL 451'-0"

(SHEET 1 OF 2)

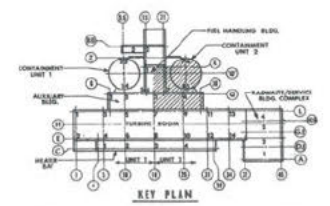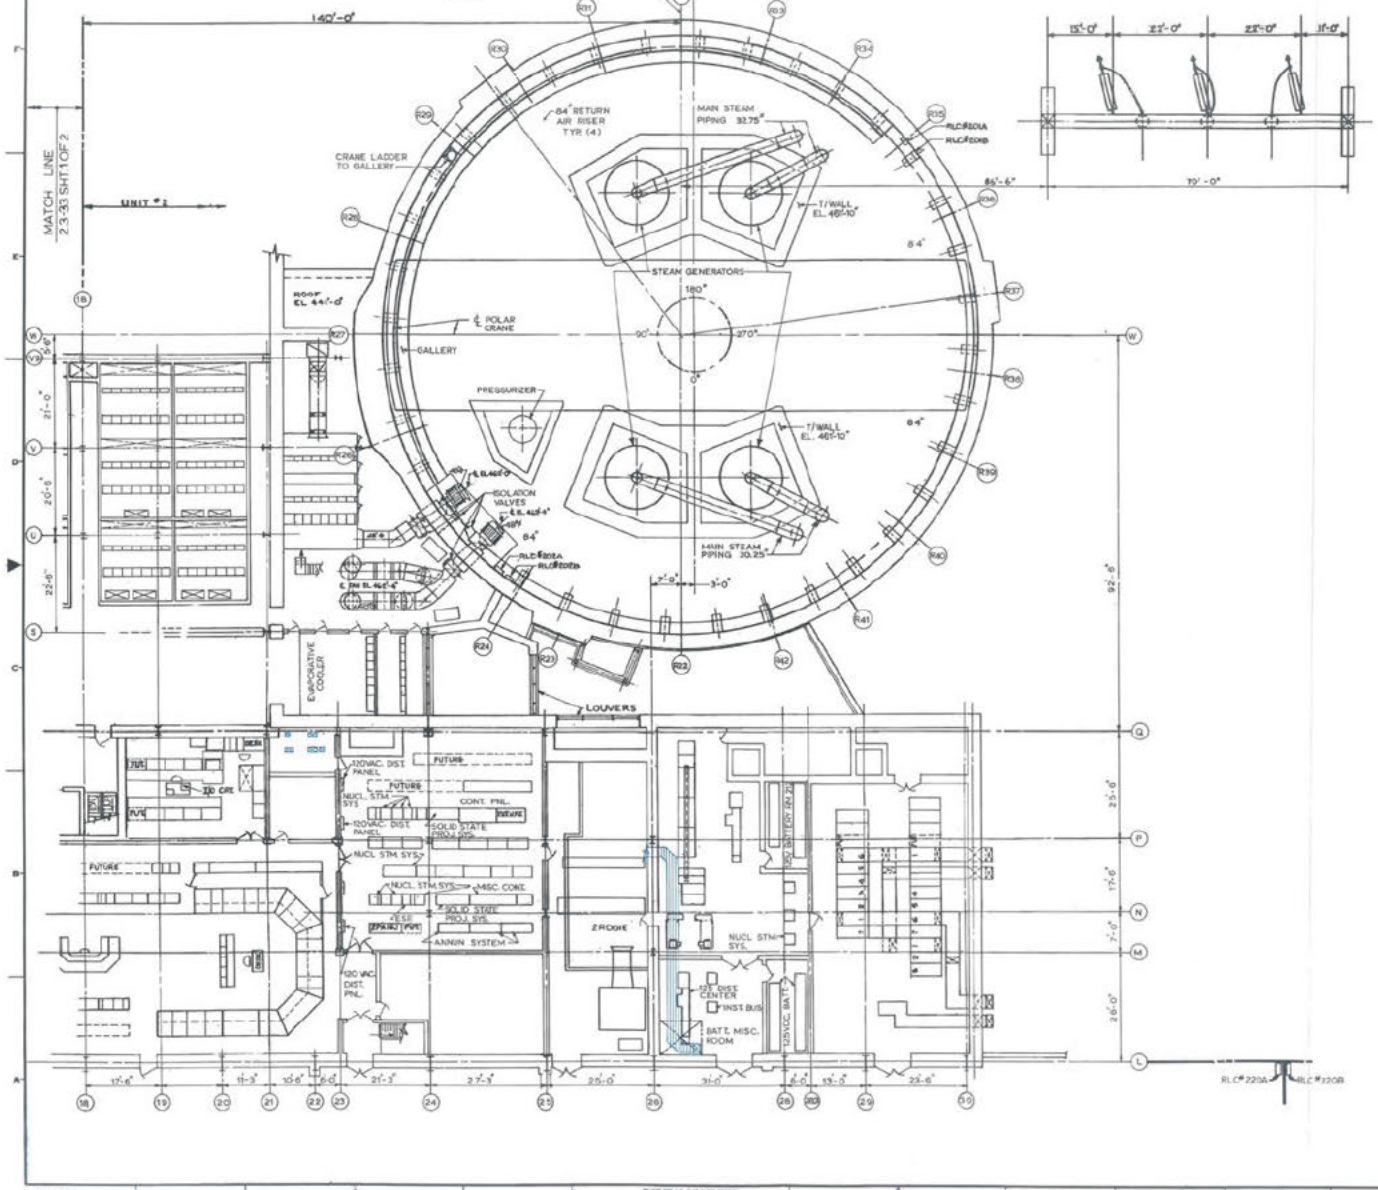

BYRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT
FIGURE 2.3-33
CABLE TRAY INSTALLATION - EL. 451'-0"
 (SHEET 2 OF 2)

Security - Related Information Withheld Under 10 CFR 2.390

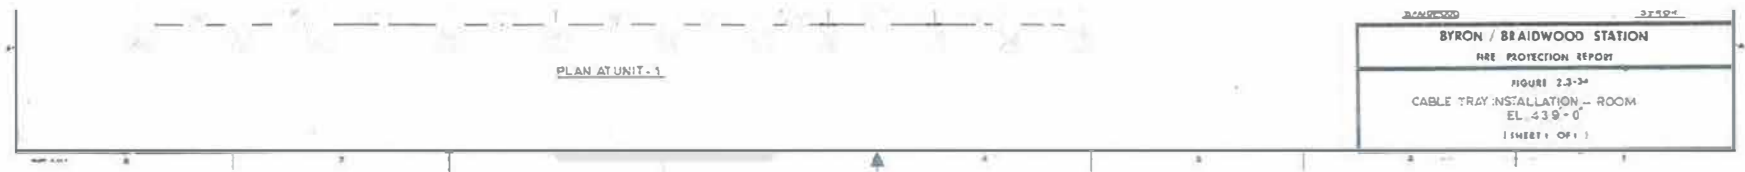

Security - Related Information Withheld Under 10 CFR 2.390

|

BYRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT

FIGURE 2.3-35

(SHEET 1 OF 2)

Security - Related Information Withheld Under 10 CFR 2.390



Security - Related Information Withheld Under 10 CFR 2.390

FIGURE 2.3-36
CABLE TRAY INSTALLATION
EL. 401'-0"
(SHEET 1 OF 2)

Security - Related Information Withheld Under 10 CFR 2.390



BYRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT
FIGURE 2.3-35
CABLE TRAY INSTALLATION ELADU-0'
[SHEET 1 OF 2]

Security - Related Information Withheld Under 10 CFR 2.390

BYRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT
ENCLOSURE 4.9.1
CABLE TRAY INSTALLATION - EL. 383'-0"
EXHIBIT 1 OF 2

Security - Related Information Withheld Under 10 CFR 2.390



BYRON / BRAIDWOOD STATION
FIRE PROTECTION REPORT
FIGURE 2.3-37
CABLE TRAY INSTALLATION-EL383-
(SHEET 2 OF 2)

Security - Related Information Withheld Under 10 CFR 2.390






Security - Related Information Withheld Under 10 CFR 2.390



Security - Related Information Withheld Under 10 CFR 2.390

Security - Related Information Withheld Under 10 CFR 2.390



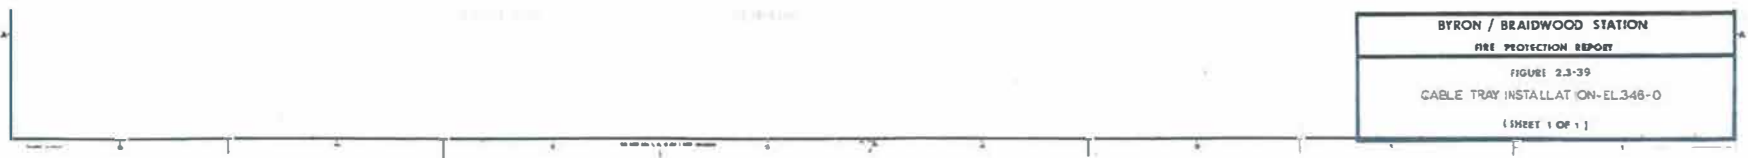


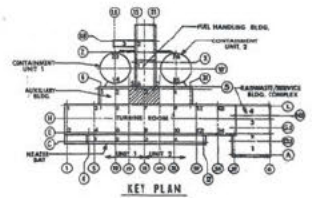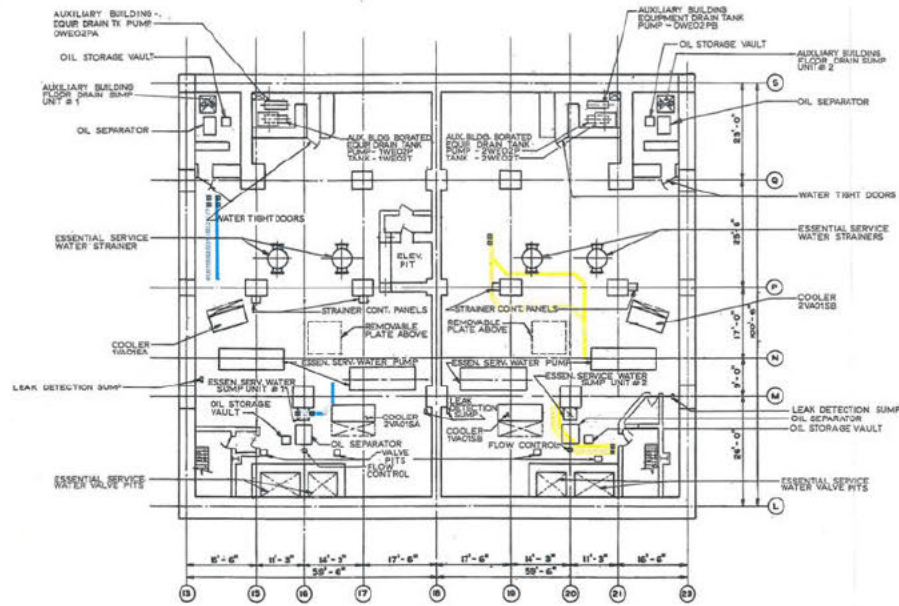

BYRON / BRADWOOD STATION
FIRE PROTECTION REPORT
 FIGURE 2.3-40
 CABLE TRAY INSTALLATION
 E.L. 330'-0"
 (SHEET 1 OF 1)

Security - Related Information Withheld Under 10 CFR 2.390



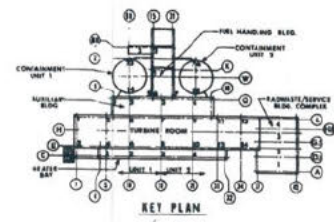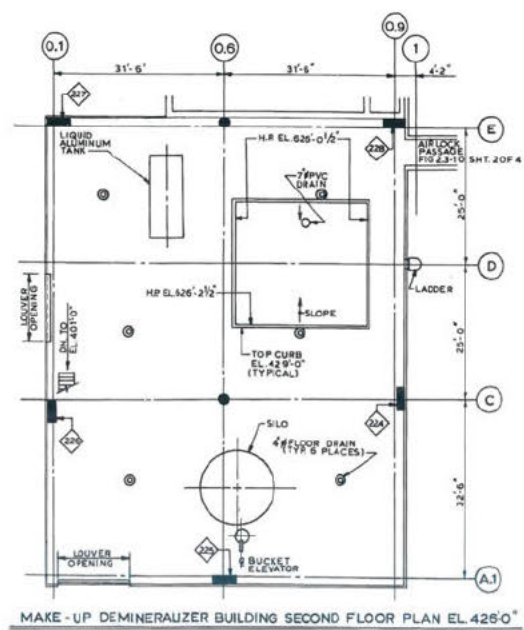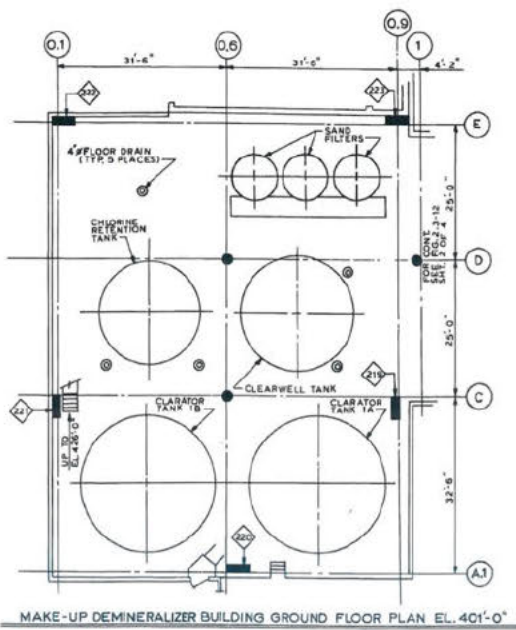

BRAIDWOOD STATION
FIRE PROTECTION REPORT

FIGURE 2.3-42
MAKE-UP DEMINERALIZER BUILDING

(SHEET 1 OF 1)