


| SYS. OPER. DATA | |
|-----------------|--------|
| 1 | 199958 |
| 2 | 34087 |

| SYS. DESIGN DATA | |
|-------------------|----------------|
| 1 | 125 |
| 2 | 125 |
| EXT. STAT. PRESS. | IN. WATER COL. |

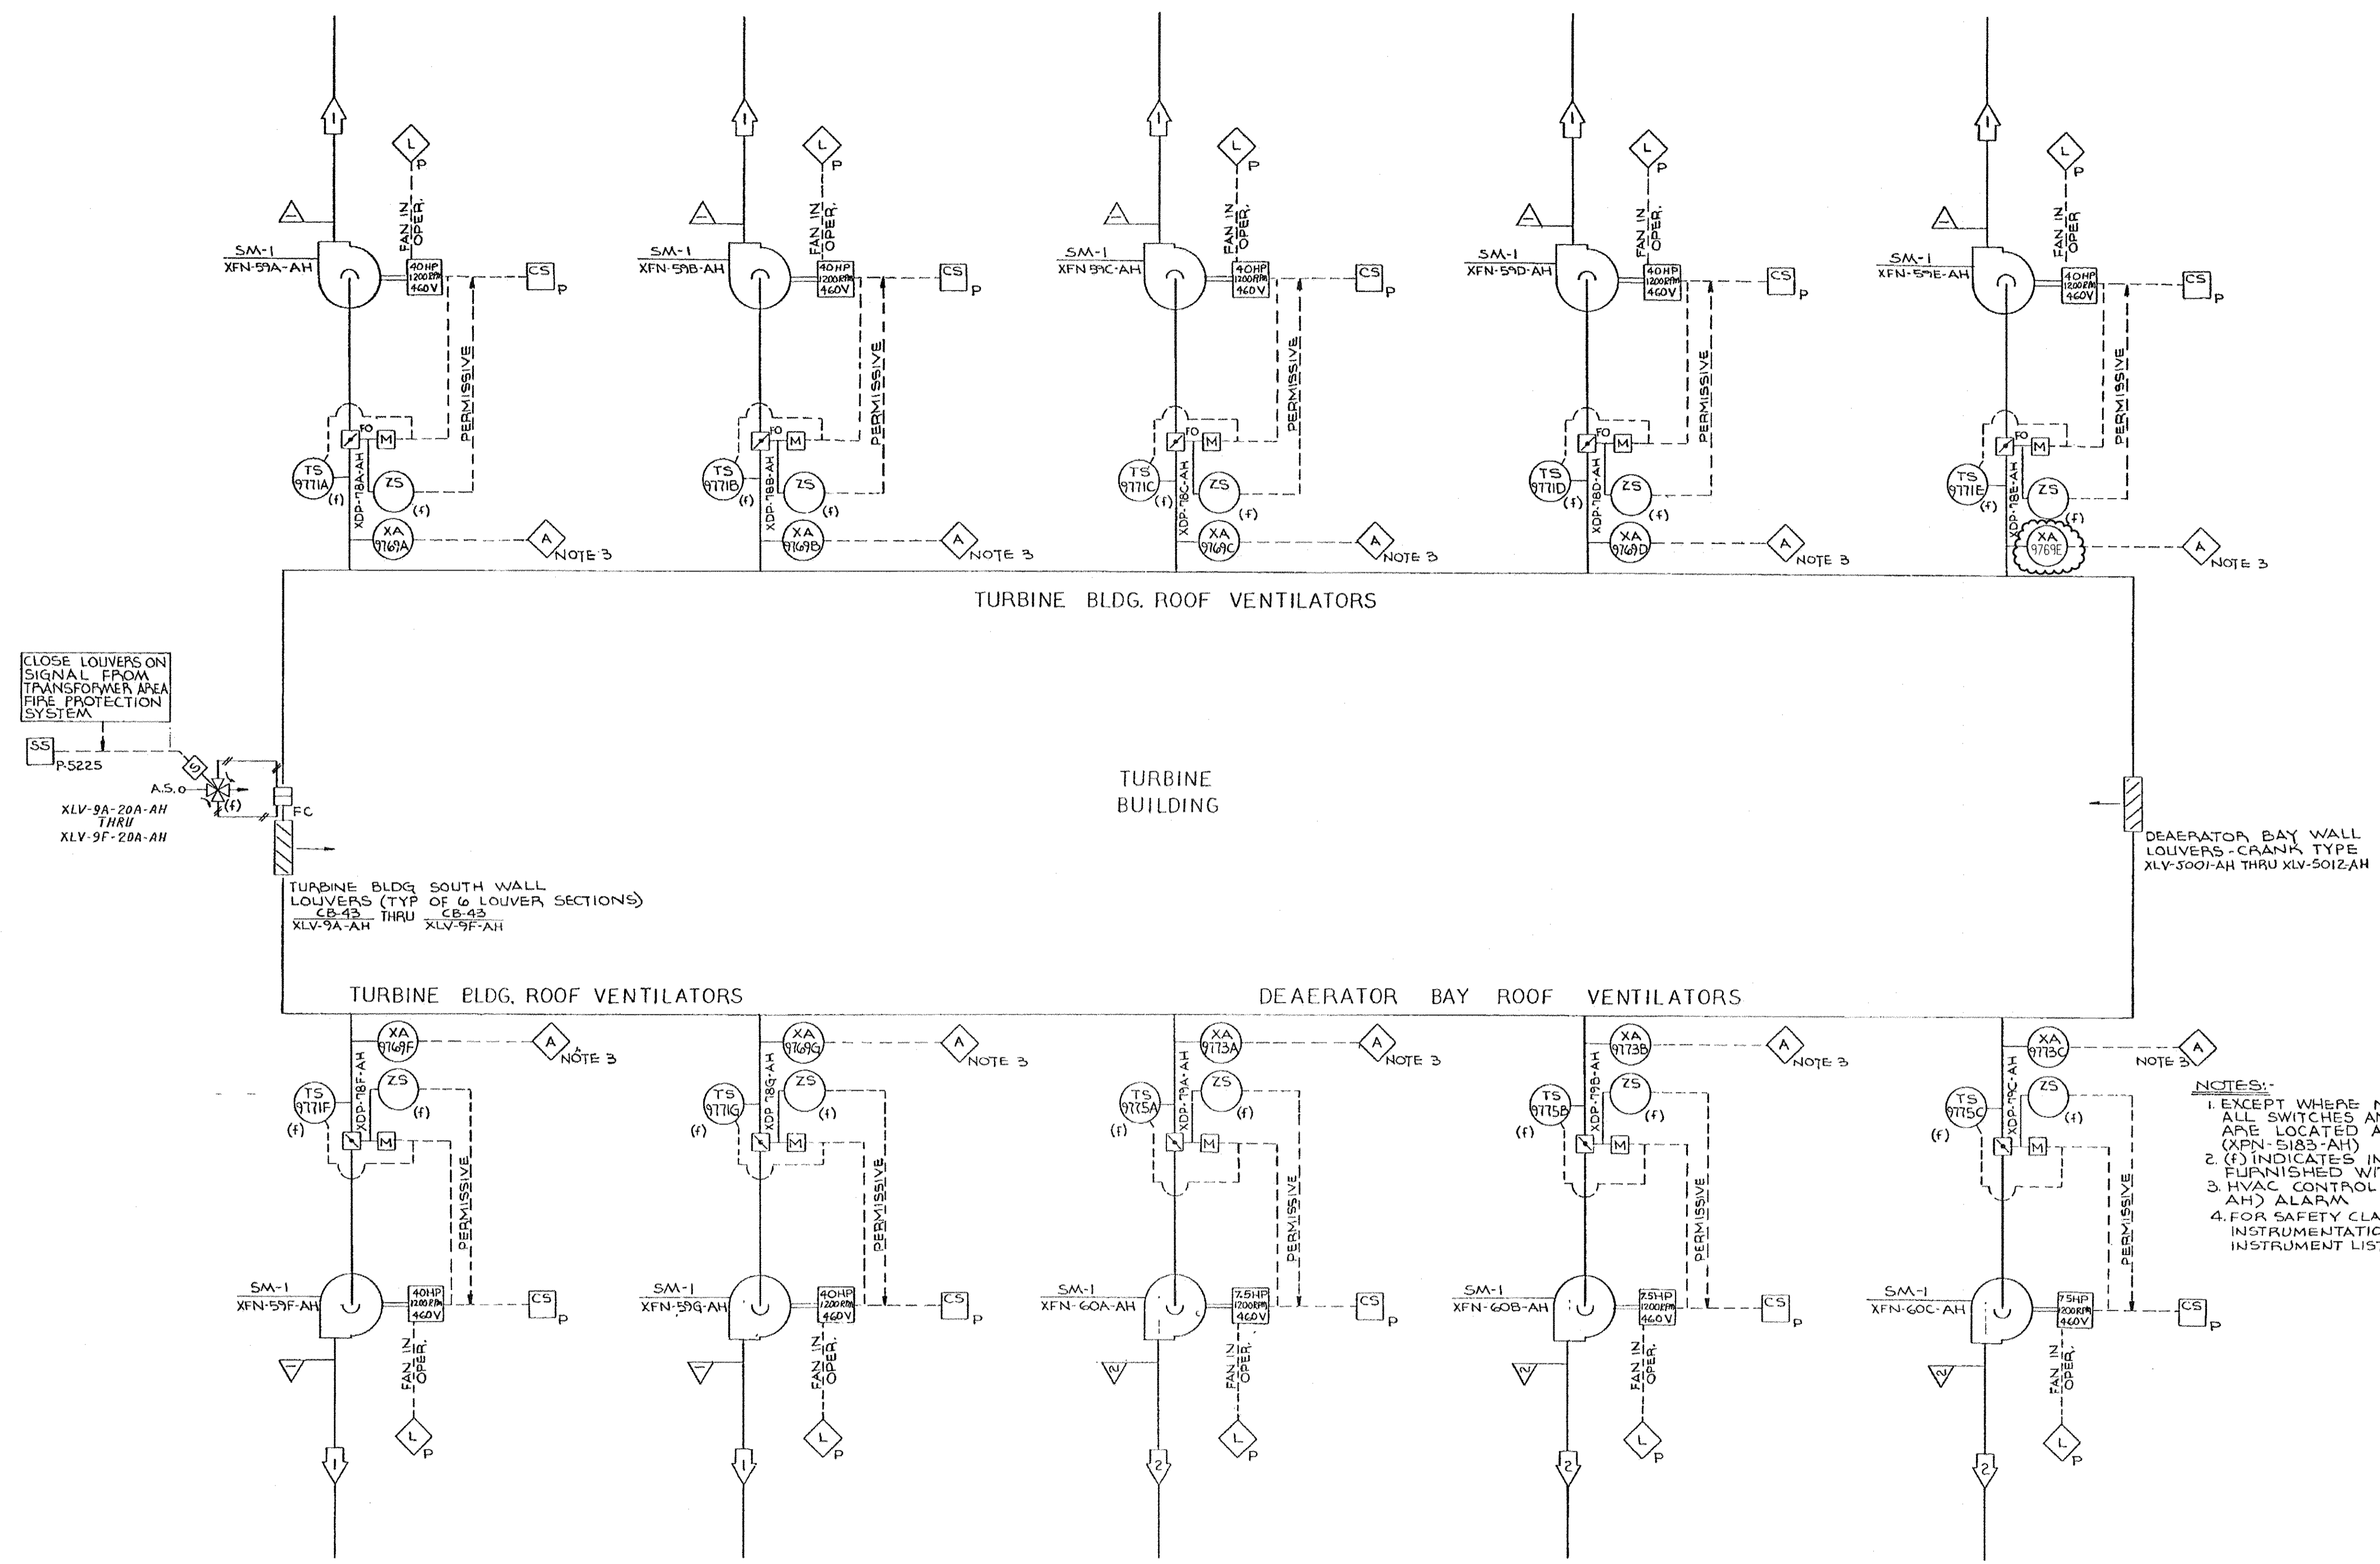

- NOTES:
- EXCEPT WHERE NOTED OTHERWISE ALL SWITCHES AND INDICATING LIGHTS ARE LOCATED AT LOCAL PANEL (XPN-5183-AH)
 - (F) INDICATES INSTRUMENT IS FURNISHED WITH EQUIPMENT
 - HVAC CONTROL BOARD (XCP-6210-AH) ALARM
 - FOR SAFETY CLASSIFICATION OF INSTRUMENTATION, SEE THE INSTRUMENT LIST.

ALL SYSTEM COMPONENTS ARE NON-NUCLEAR SAFETY

ESSENTIAL

DRAWING LEGIBILITY CLASS 1
SCE&G CAD ENHANCED

| | | | |
|---|-----|-----|--|
| FSAR Figure 9.4-12 | | | |
| SOUTH CAROLINA ELECTRIC & GAS COMPANY | | | |
| VIRGIL C. SUMMER NUCLEAR STATION | | | |
| BUILDING SERVICE SYSTEM FLOW DIAGRAM | | | |
| TURBINE BUILDING VENTILATION SYSTEM | | | |
| DESIGN ENGINEERING | | | |
| V. C. SUMMER NUCLEAR STATION, JENKINSVILLE, S. C. | | | |
| 1 | 2 | 3 | |
| DDJ | MGR | DDJ | |
| D-912-160 | | | |
| DRAWING NUMBER | | | |
| 8 | | | |
| SHEET NUMBER | | | |

| NO. | DATE | BY | REVISION | CHKD. BY | APPROVAL |
|-----|----------|-----|-----------------------|----------|----------|
| 8 | 4/26/84 | TGB | REVISED PER ECR-71946 | MGR | KH |
| 7 | 11/04/81 | DDJ | REVISED PER ECR-70028 | MGR | DDJ |