
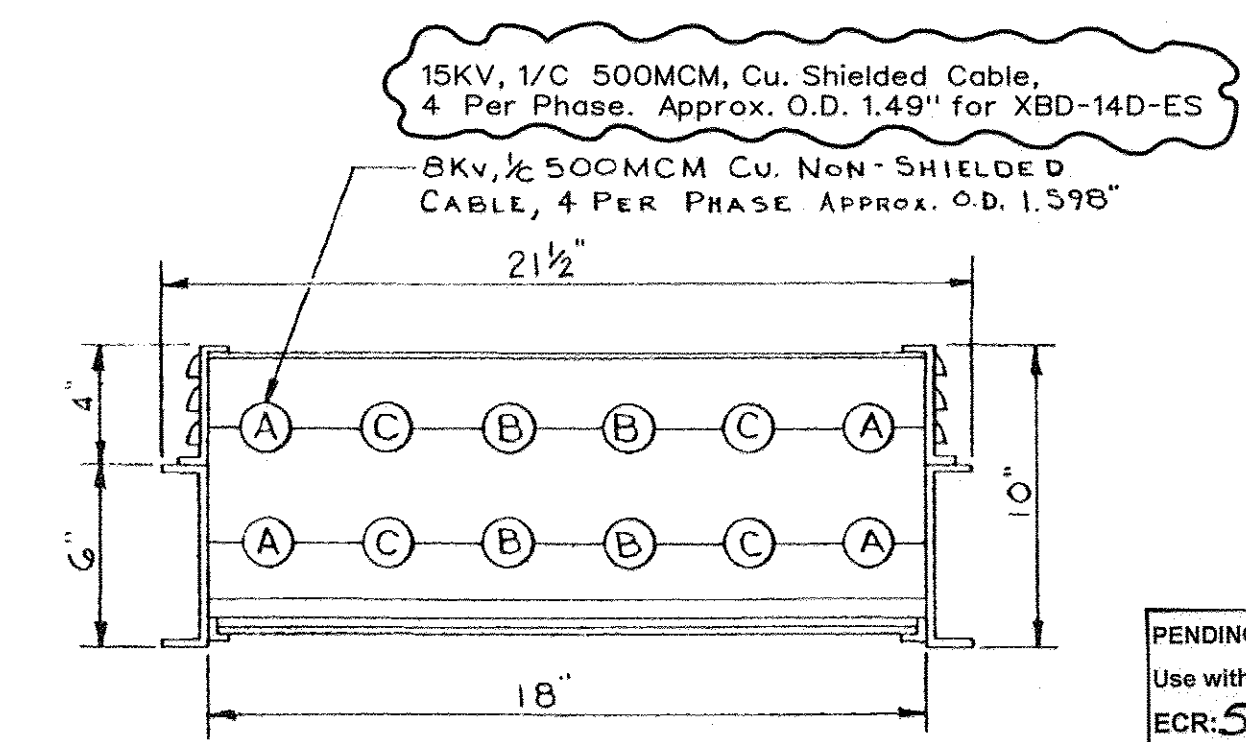


SEE DWG. 916400-108 FOR ANCHOR BOLT PLAN

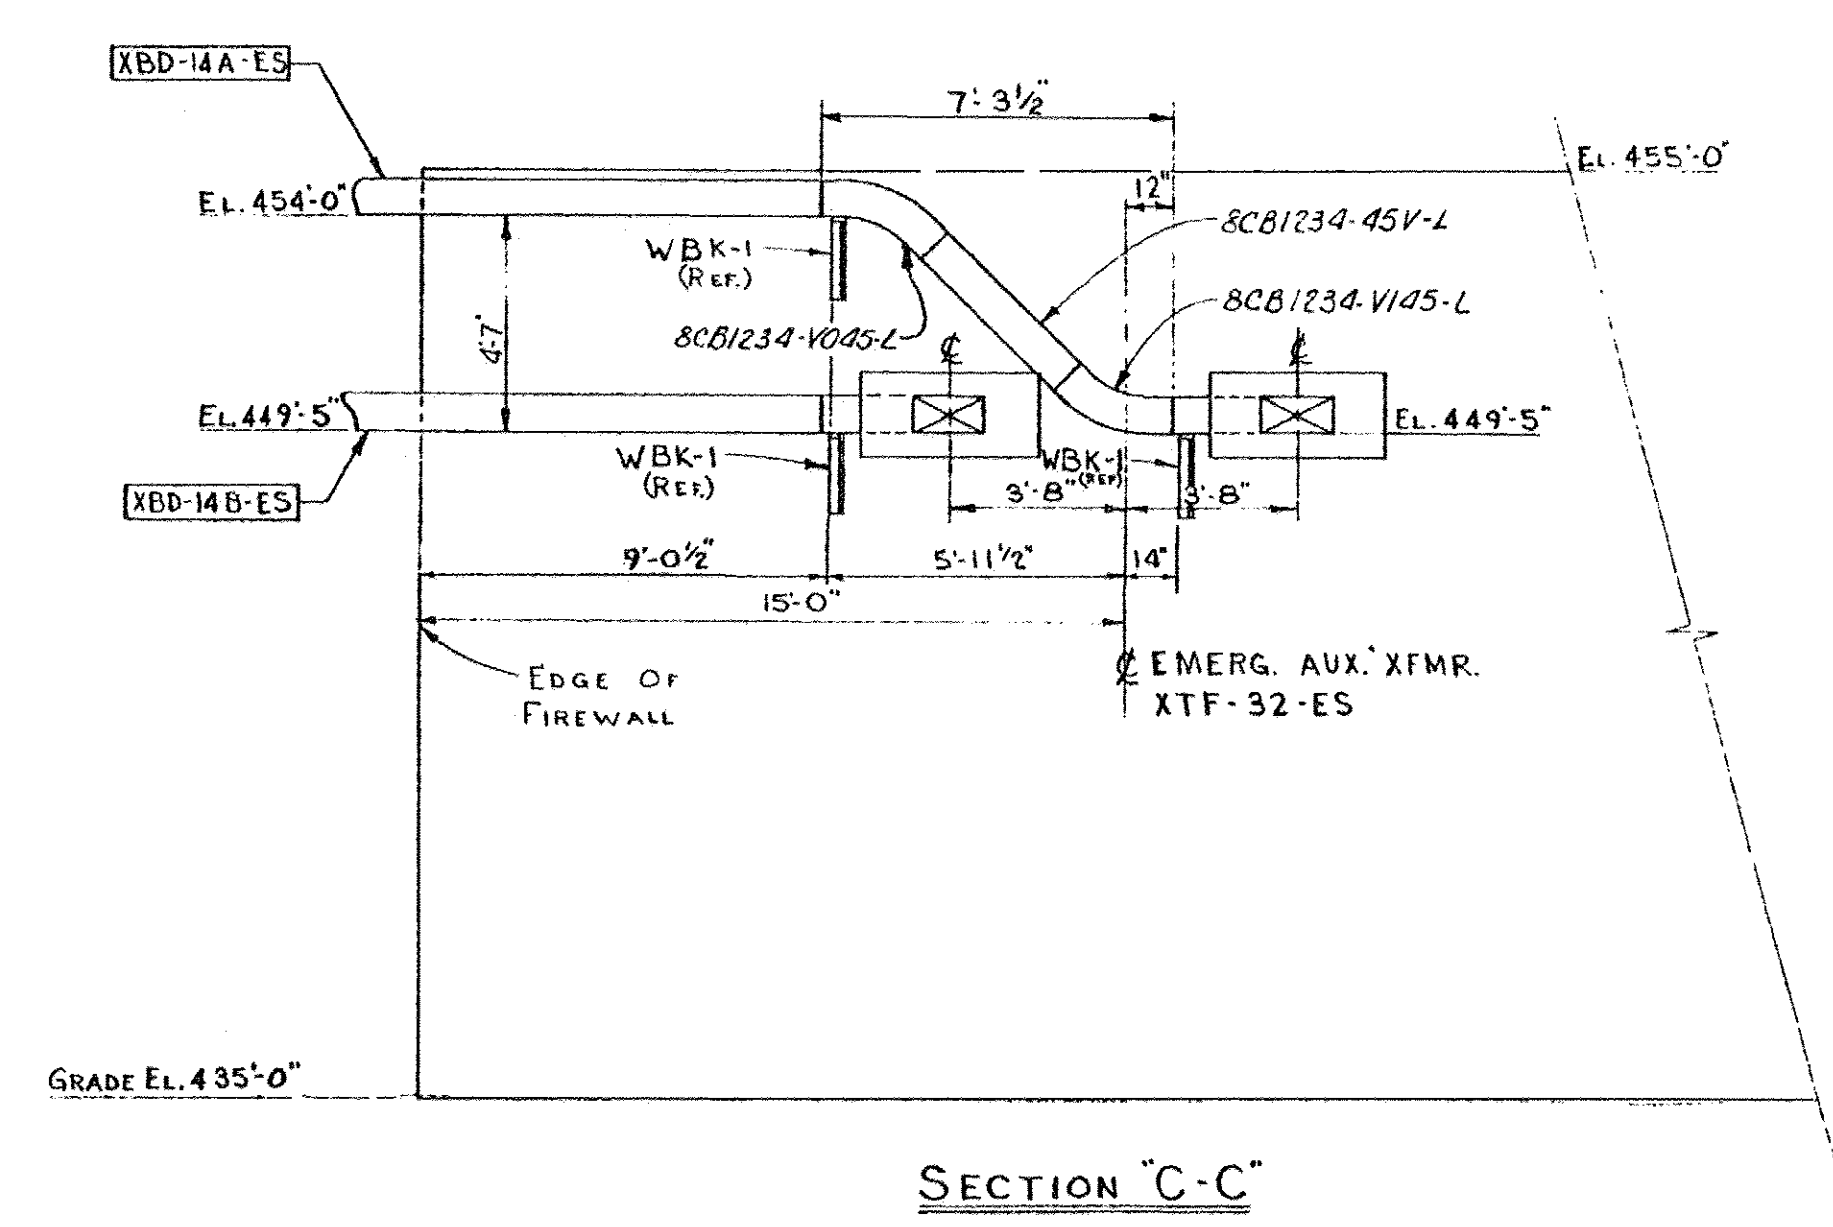

2000A BKV 3Ø-3W SYSTEM
 CATALOG No. 8CB1234-()-L
 APPROX. Wt. PER FT. 44 LBS.

SOUTH CAROLINA ELECTRIC & GAS CO.
 VIRGIL C. SUMNER NUCLEAR STATION UNIT No. 1
 APPROVED
 NOTED
 RETURNED FOR CORRECTION
 GILBERT ASSOCIATES, INC.
 BY: R.T. STRAUSSER
 B/M ITEM No. ED-1 DATE: 5/19/77

PENDING/HOLD CHG
 Use with reference to
 ECR: 50757
 DATE: 08/10/11
 INITIALS: CNT

FSAR Figure 8.3-0
 OUTDOOR CABLE BUS LAYOUT & SECTIONS
 EMERGENCY AUXILIARY TRANSFORMER AREA
 VENDOR/DRAWING NO. HUSKY PRODUCTS INC.
 916400-100

DESIGN ENGINEERING		V.C. SUMNER NUCLEAR STATION, JENKINSVILLE, S.C.	
1. MADE	2. CHECKED	3. LE APPROVAL	
4. 08/18/77 JTS	REVISED PER ECR-50719	AME JRC	DDJ MGR DDJ
3. 10/01/01 DDJ	REVISED PER ECR-70028	MGR DDJ	
NO. DATE BY	REVISION	CHK. BY APPROVAL	LE
			IMS-33-007
			4

