


BALTIMORE
GAS & ELECTRIC CO.
Calvert Cliffs
Nuclear Power Plant

REACTOR COOLANT PUMP FLOW
TEST INSTRUMENTATION

Figure A
Rev. 18

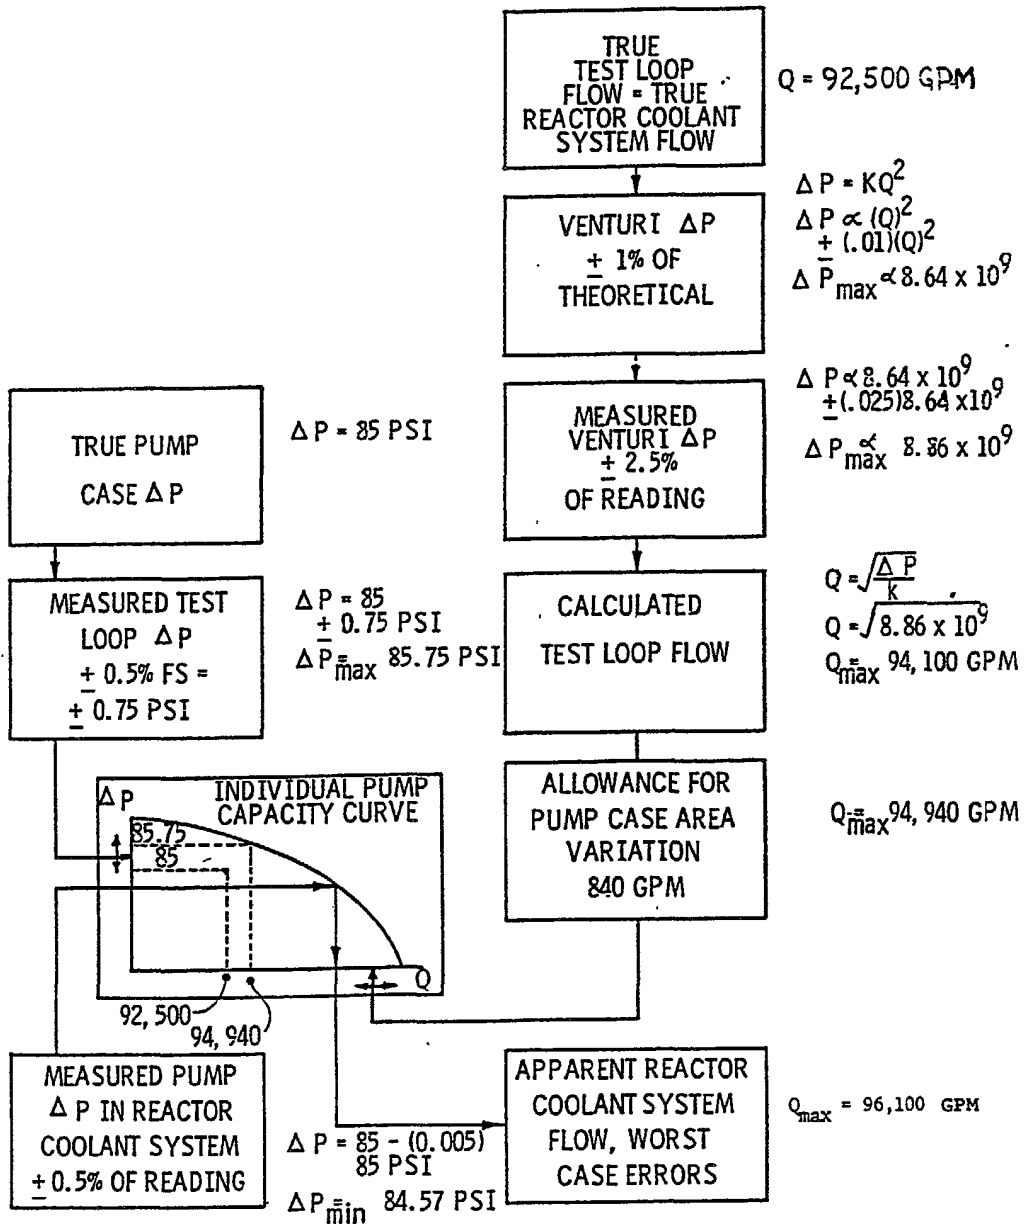

BALTIMORE
 GAS & ELECTRIC CO.
 Calvert Cliffs
 Nuclear Power Plant

ERROR IN ESTABLISHMENT OF FLOW

Figure B
 Rev. 18