


E
D
C
B
A

E
D
C
B
A

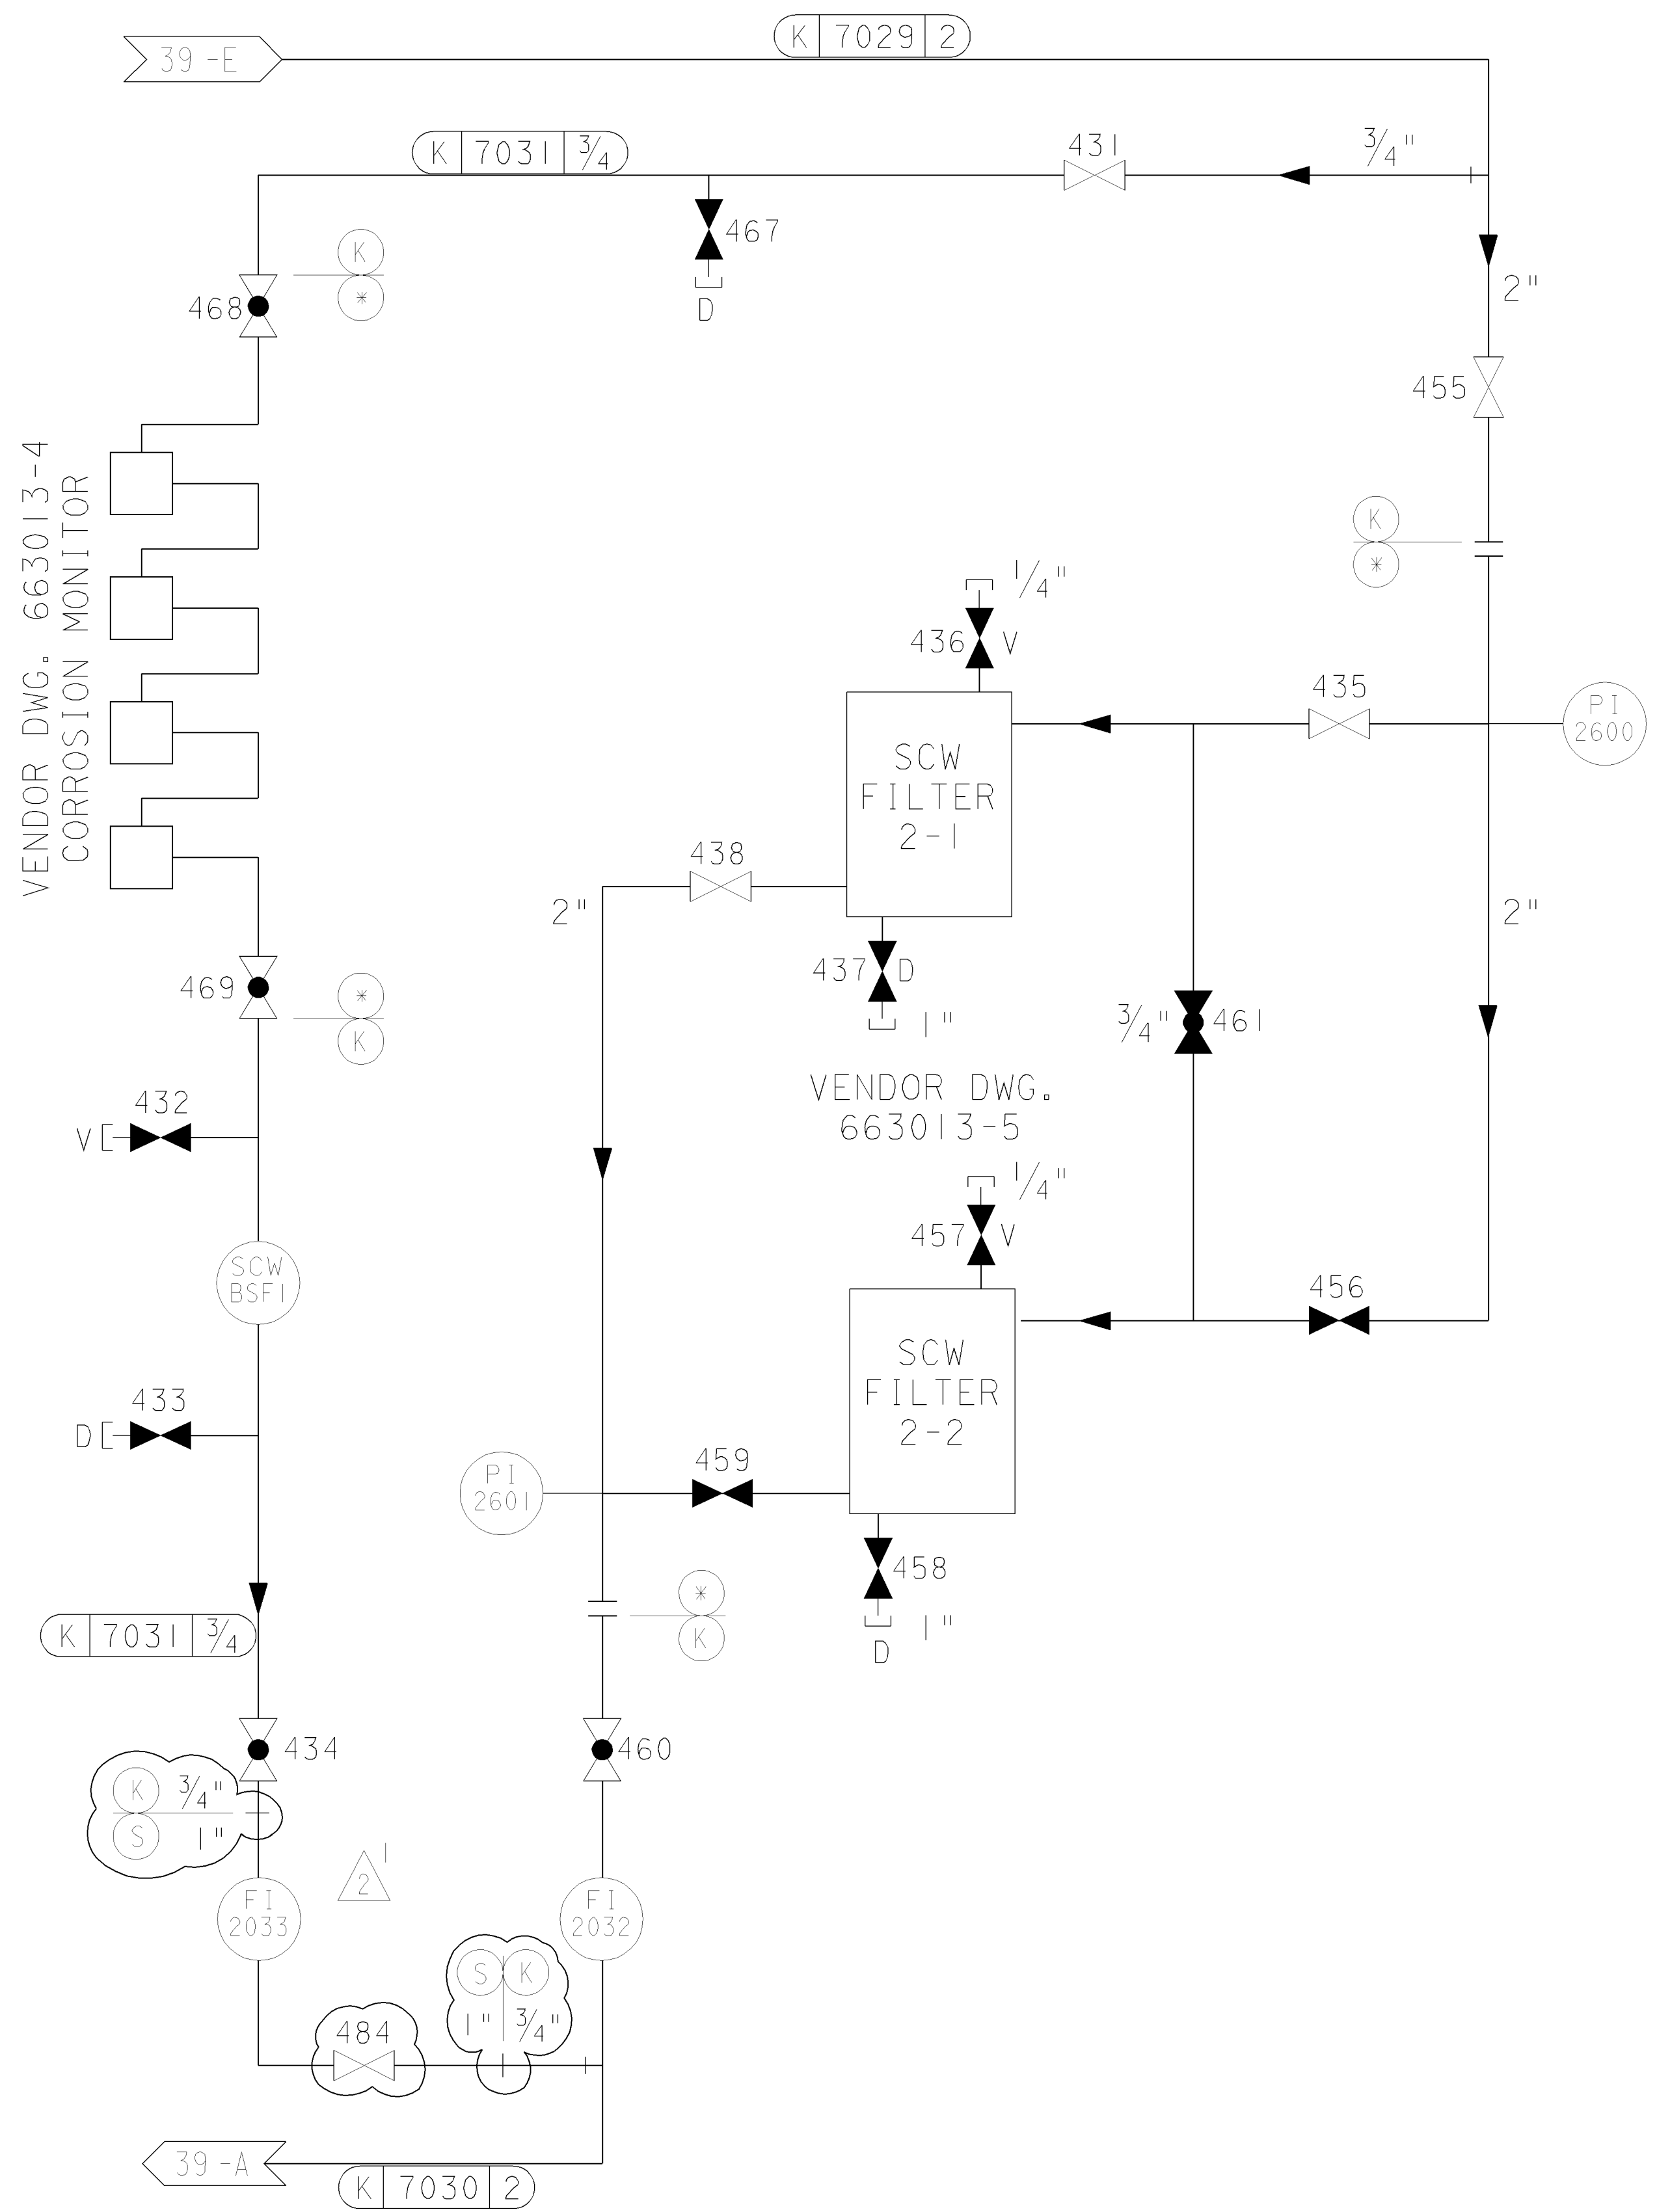

NOTES:
 1. ALL PIPING ON THIS DWG. SHALL BE P.G.&E. CLASS "E".
 2. ALL DRAIN AND VENT VALVES, DESIGNATED "D" & "V", ARE 3/4" U.N.O.

UNIT 2

DIABLO CANYON POWER PLANT - PG&E CO.			
SERVICE COOLING WATER SYSTEM			
DRAWING	SHEET	PAGE	REV
108015	3A	0	2

RASTER=108015s3A.dgn
 DCN=108015s3A.dgn
 CAD User: AJFJ Date: 03-15-2011

03-15-2011	AJFJ	FAZI		KERSI J. DALAL	MECHANICAL	M 16690	3/31/2012	REVISED PER DDT-4*499
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	