


NOTES:

- 1. [] INDICATES PG&E PIPING CODE CLASS
- 2. * DENOTES MANUFACTURER SUPPLIED INSTRUMENTS & EQUIPMENT. IT IS ACCEPTABLE TO REPLACE MANUFACTURER SUPPLIED INSTRUMENT TUBING WITH PG&E SUPPLIED S-SPEC STAINLESS STEEL TUBING
- 3. [] MANUFACTURER NUMBER IDENTIFICATION
- 4. ** PIPING TO BE INSTALLED UNDER SPEC.8711 & PROVIDED UNDER DC-663084-1 51/52-B,C&D
- 5. MOUNTED ON ENGINE CONTROL PANEL 58 C
- 6. DIESEL GENERATOR EXHAUST SILENCER SEISMICALLY QUALIFIED FOR HOSGRI CRITERIA. EQUIPMENT SUPPORTS FOR THE DIESEL GENERATOR EXHAUST SILENCER SEISMICALLY QUALIFIED IN ACCORDANCE WITH DESIGN CRITERIA MEMORANDUM M-72 54-C

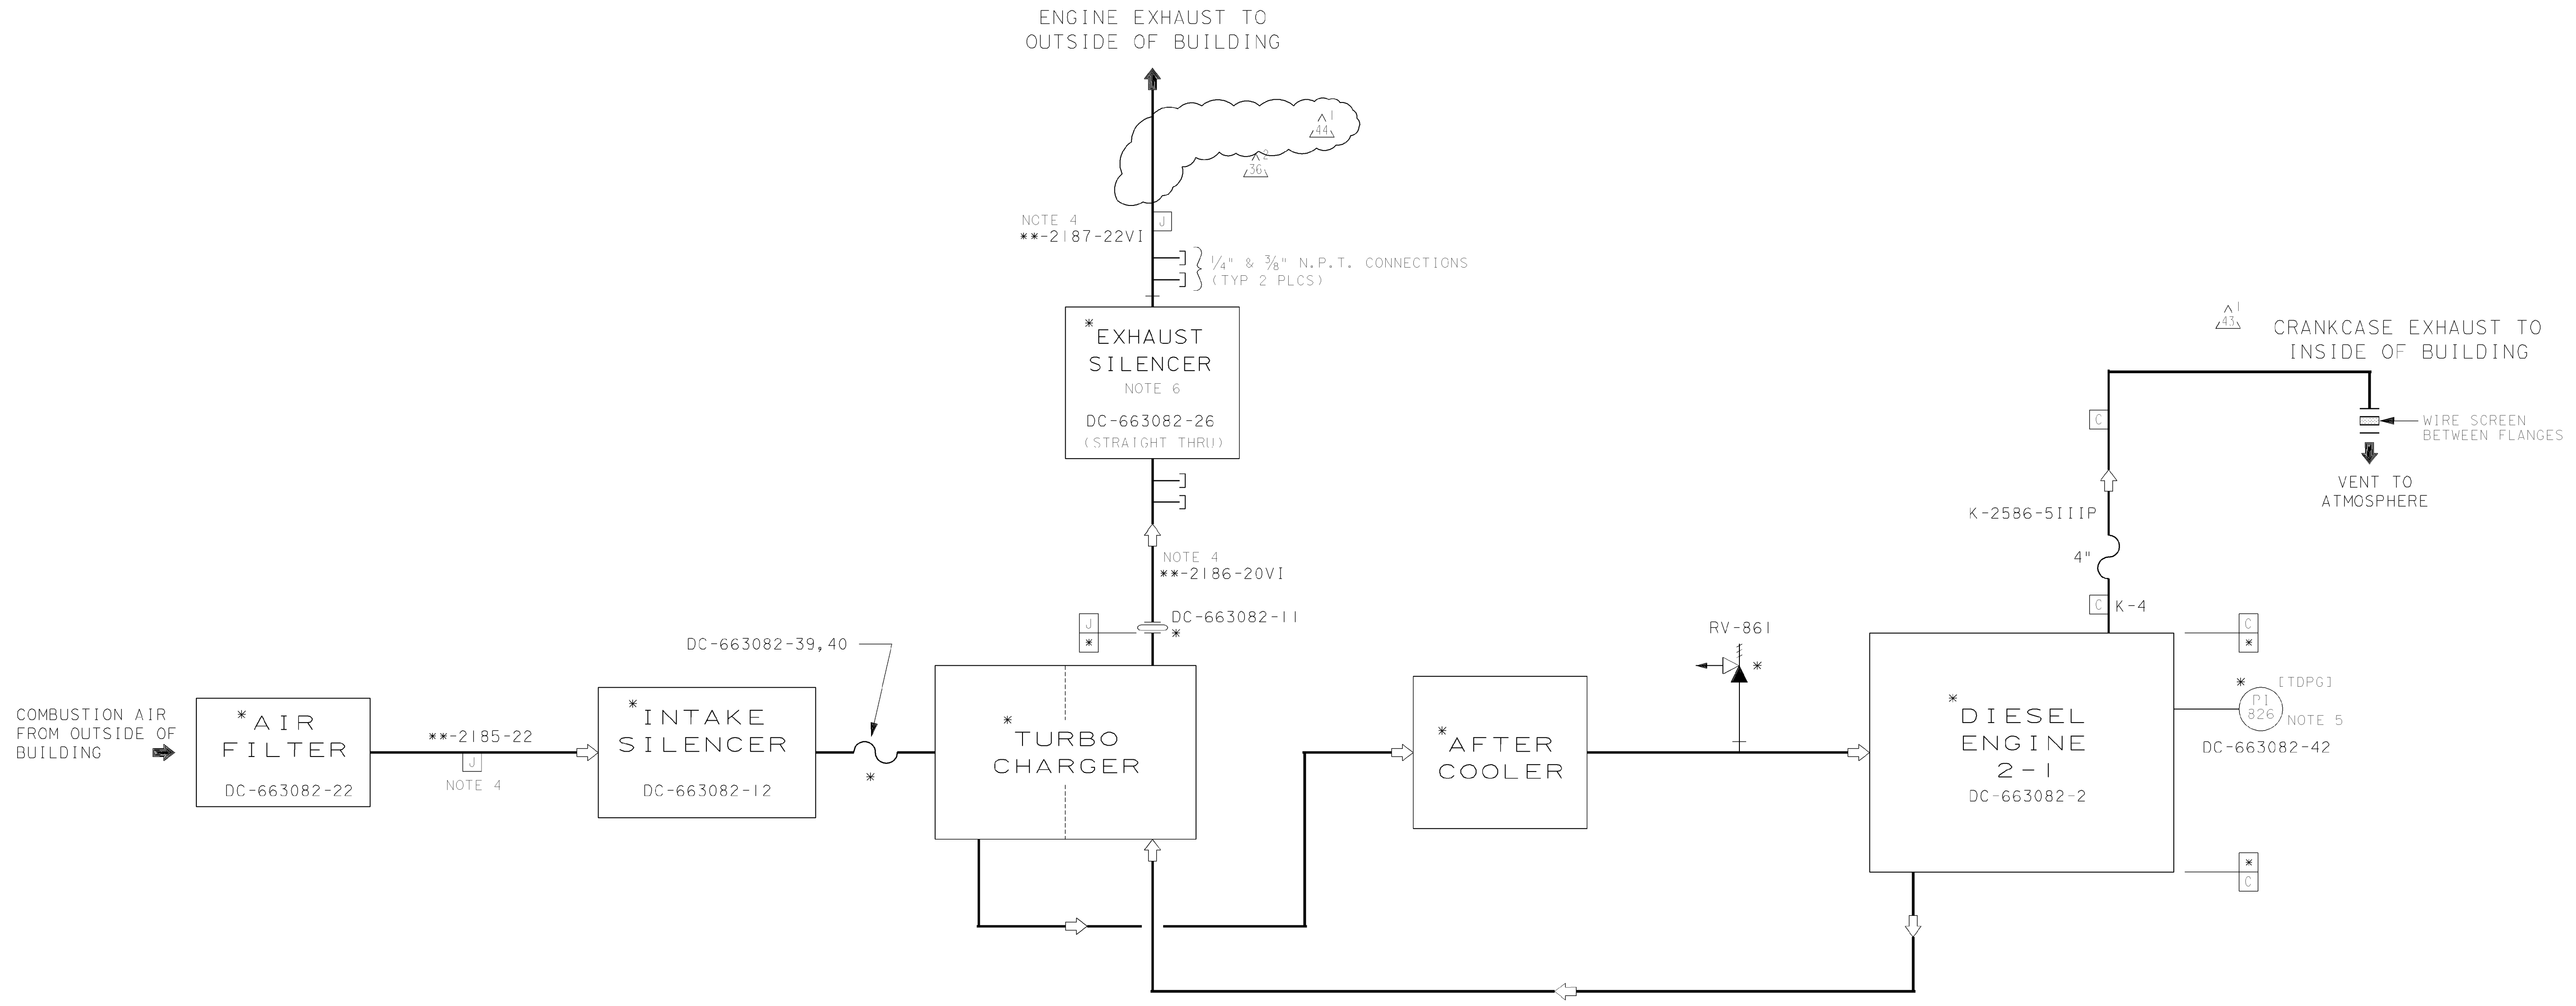

COMBUSTION AIR AND EXHAUST SYSTEM 2-1

UNIT 2

P G & E CO.	108021	REV.	44
SHEET 5	PAGE 0		

12/17/03	AJL2	RMDI	-	KERSI J. DALAL	MECHANICAL	M 16690	3/31/2004	Revised per FCT 028077
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	

CAD User: AJL2 Date: 12-6-2003 DCN=802155.DGN