

NOTES:

- 1. EXHAUST SHAFT PASSES VERTICALLY UP THROUGH ELEVATIONS 85' (THIS SHEET), 100' & 115' (SHEET 14), AND 128' & 140' (SHEET 13) TO E-28 EXHAUST FAN ROOM ON ROOF (SHEET 13).
- 2. EXHAUST BACKDRAFT DAMPER IS DESIGN CLASS I. 159-B
- 3. FOR LEGEND, ABBREVIATIONS, INDEX, AND GENERAL NOTES, SEE SHEET 2 (108023) OR SHEET 3 (108001).
- 4.
- 5. SEE DRAWINGS 516103 & 59318 FOR AIR FLOW DIAGRAM.
- 6. AUXILIARY BUILDING ACCESS CONTROL AREA IS COMMON TO BOTH UNIT 1 & UNIT 2, AND IS UNDER SPECIFICATION 8828.
- 7. ASHCROFT MODEL 30E1 INDICATING THERMOMETER.
- 8. ASHCROFT MODEL 1089 PRESSURE GAUGES.


CROSS-HATCHED AREAS ARE NO LONGER UPDATED ON THIS UNIT 2 SHEET. (SEE 102023)

CONTINUED ON SHEET 14

SEPARATE 14" Ø FIBERGLASS DUCT RISERS TO ROOF

EXHAUST SHAFT BY ELEVATOR NO. 1 (NOTE 1)

NOTE 2
EXHAUST INTO UNIT 1 CONTAINMENT PENETRATION AREA GE/GW

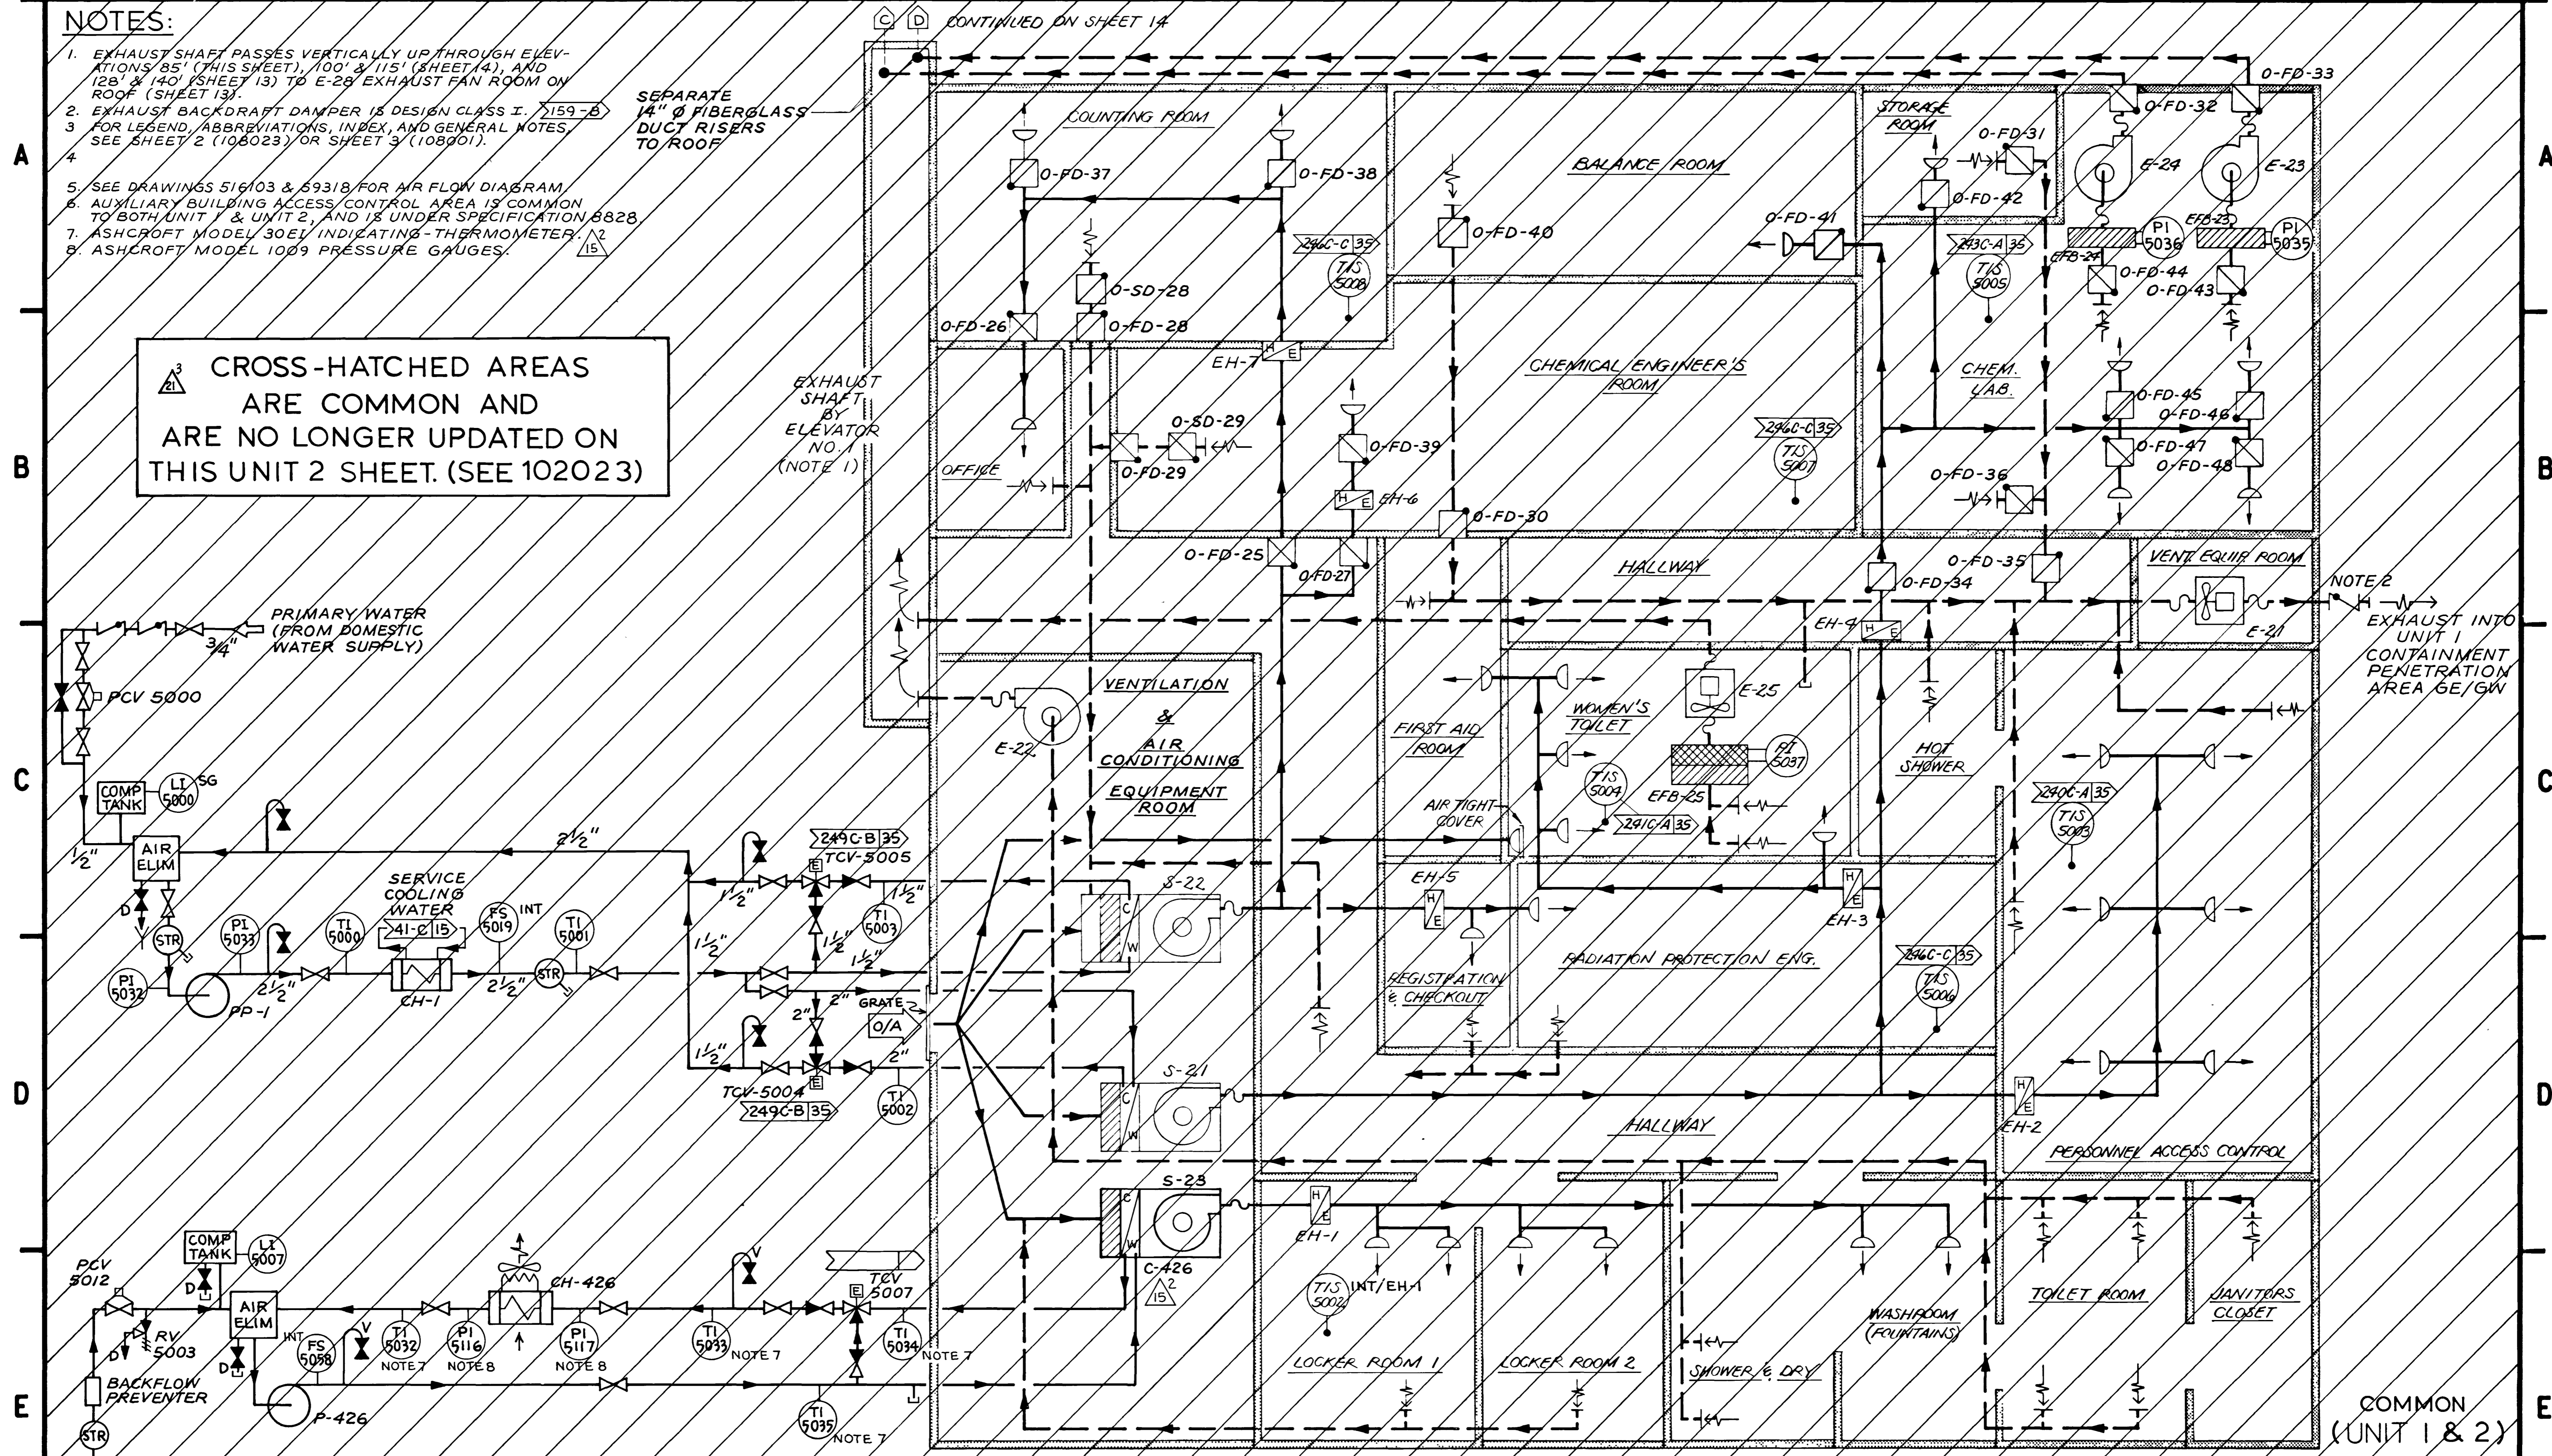

AUXILIARY BUILDING ACCESS CONTROL AREA (EL 85'-0")

P.G.&E. CO.	DRAWING NUMBER	REV
	108023	21
SHEET 15 OF SHEETS	MICROFILM	