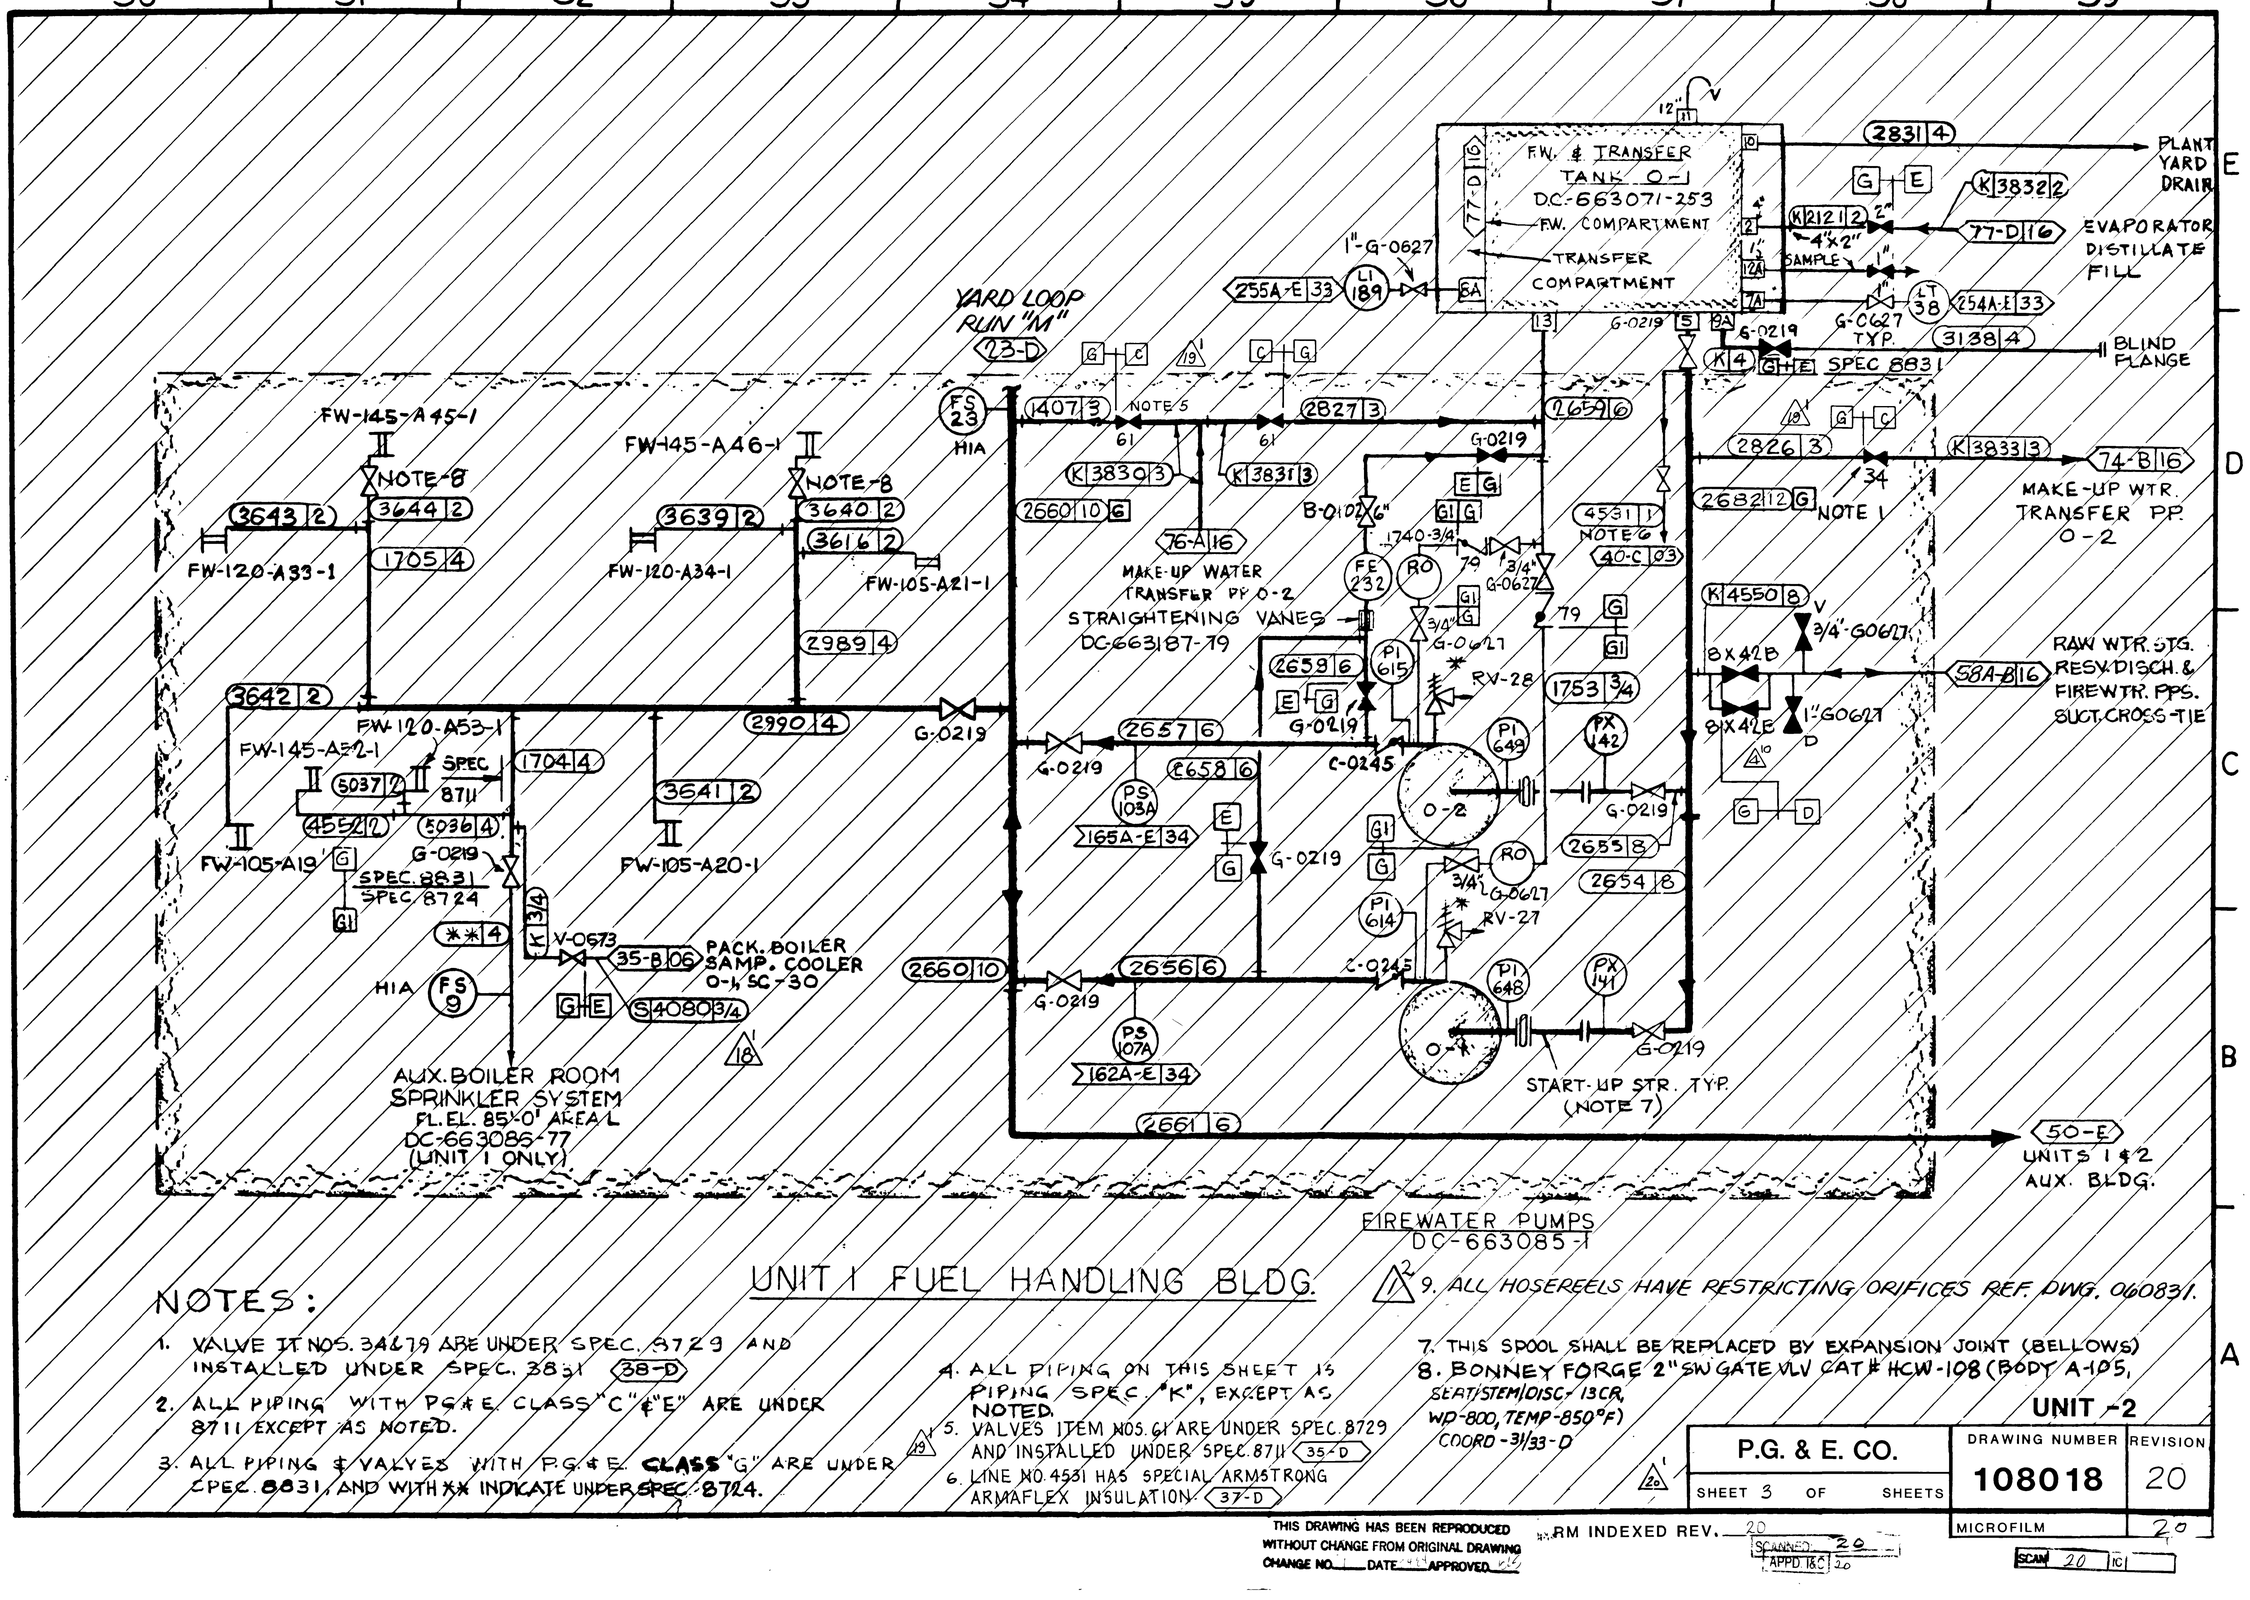

UNIT 1 FUEL HANDLING BLDG.

NOTES:

1. VALVE IT NOS. 34&79 ARE UNDER SPEC. 8729 AND INSTALLED UNDER SPEC. 8831 (38-D)
2. ALL PIPING WITH P.G.&E. CLASS "C" & "E" ARE UNDER 8711 EXCEPT AS NOTED.
3. ALL PIPING & VALVES WITH P.G.&E. CLASS "G" ARE UNDER SPEC. 8831, AND WITH XX INDICATE UNDER SPEC. 8724.
4. ALL PIPING ON THIS SHEET IS PIPING SPEC. "K", EXCEPT AS NOTED.
5. VALVES ITEM NOS. 61 ARE UNDER SPEC. 8729 AND INSTALLED UNDER SPEC. 8711 (35-D)
6. LINE NO. 4531 HAS SPECIAL ARMSTRONG ARMAFLEX INSULATION (37-D)
7. THIS SPOOL SHALL BE REPLACED BY EXPANSION JOINT (BELLOWS)
8. BONNEY FORGE 2" SW GATE VLV CAT # HCW-108 (BODY A-105, SEAT/STEM/DISC - 13CR, WP-800, TEMP-850°F) COORD - 31/33 - D
9. ALL HOSEREELS HAVE RESTRICTING ORIFICES REF. DWG. 060831.

UNIT -2

P.G. & E. CO.	DRAWING NUMBER	REVISION
SHEET 3 OF SHEETS	108018	20
	MICROFILM	20

THIS DRAWING HAS BEEN REPRODUCED WITHOUT CHANGE FROM ORIGINAL DRAWING
CHANGE NO. ___ DATE ___ APPROVED ___
RM INDEXED REV. 20
SCANNED 20
APPD I&C 20
SCAN 20 IC1