

A

B

C

D

E


A

B

C

D

E

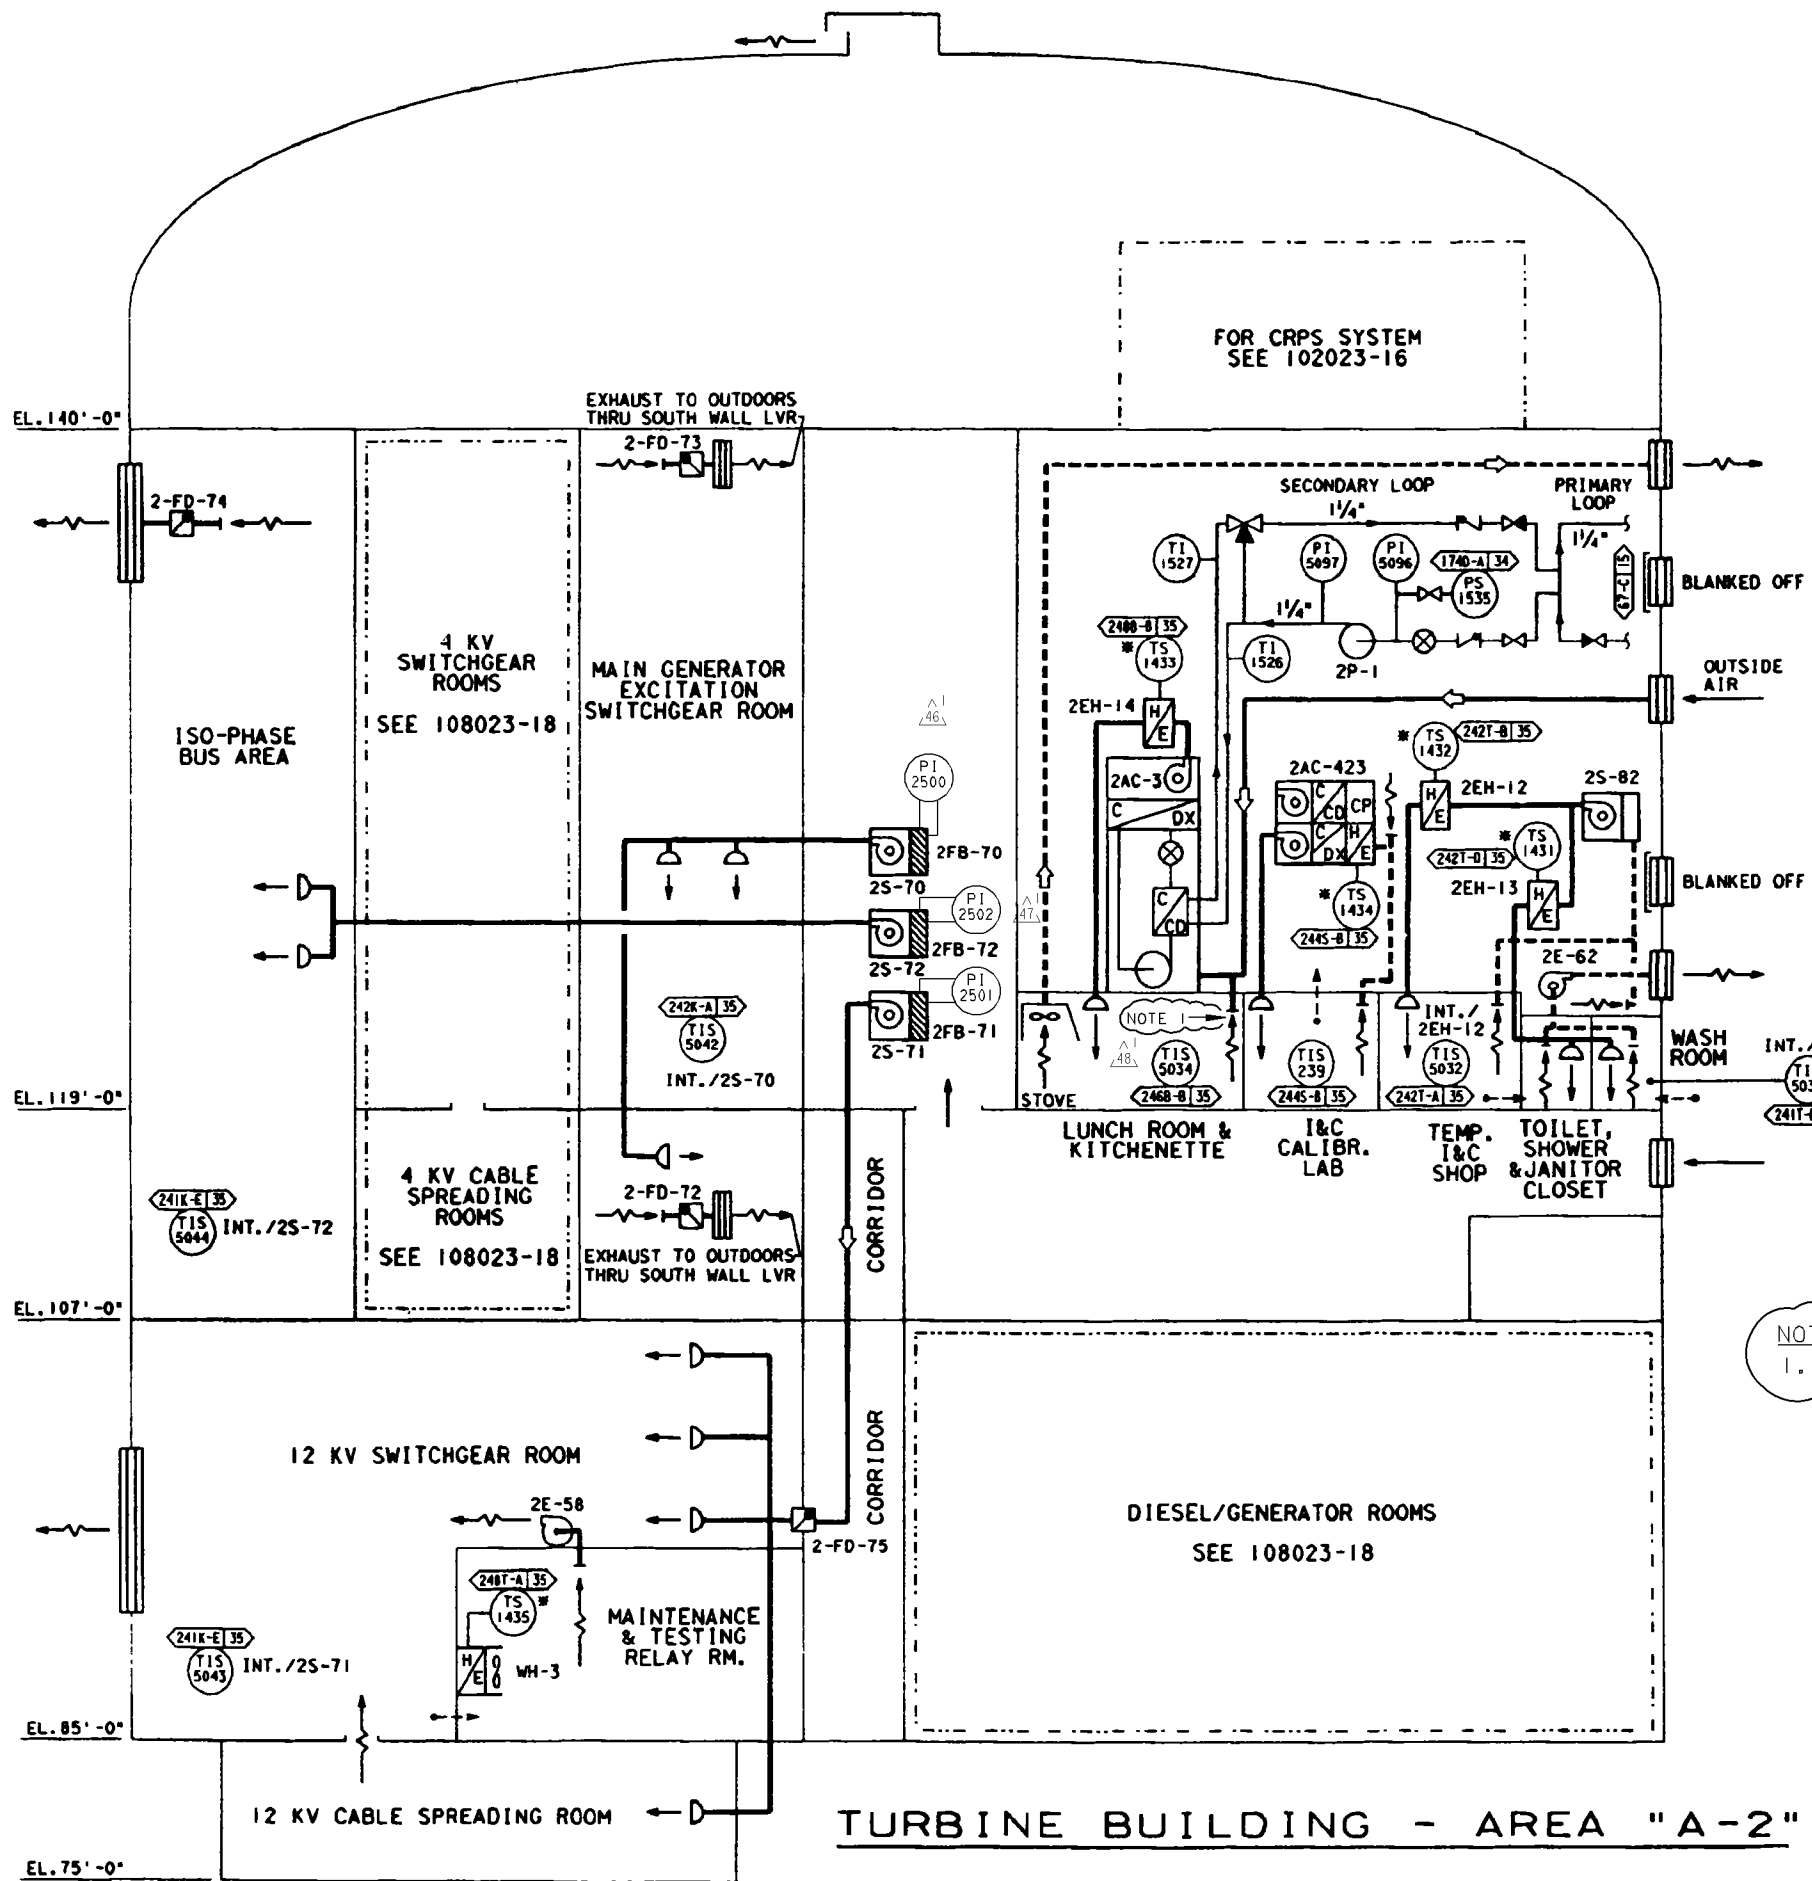

FOR CRPS SYSTEM SEE 102023-16

NOTES:
 1. 30 X 18" FILTER INSTALLED OUTSIDE OF REGISTER ^{△2}₄₈

UNIT 2

DIABLO CANYON POWER PLANT - PG&E CO.			
VENTILATION & AIR CONDITIONING SYSTEMS			
DRAWING	SHEET	PAGE	REV
108023	18A	0	48

RASTER=8023s18a.dgn
 DGN=8023s18a.dgn
 CAD User: JAR0 Date:03-13-2008

INPGIC
1 Size

03-13-2008	JAR0	Fxc2		KERSI J. DALAL	MECHANICAL	M 16690	3/31/2008	REVISED PER FCT-33309
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	