


NOTES:

1. [ ] INDICATES PG&E PIPING CODE CLASS
2. \* DENOTES MANUFACTURER SUPPLIED INSTRUMENTS & EQUIPMENT. IT IS ACCEPTABLE TO REPLACE MANUFACTURER SUPPLIED INSTRUMENT TUBING WITH PG&E SUPPLIED S-SPEC STAINLESS STEEL TUBING
3. [ ] MANUFACTURER NUMBER IDENTIFICATION
4. \*\* PIPING TO BE INSTALLED UNDER SPEC.8711 & PROVIDED UNDER DC-663084-1 51A/54A-B,C&D
5. MOUNTED ON ENGINE CONTROL PANEL 58A-C
6. DIESEL GENERATOR EXHAUST SILENCER SEISMICALLY QUALIFIED FOR HOSGRI CRITERIA. EQUIPMENT SUPPORTS FOR THE DIESEL GENERATOR EXHAUST SILENCER SEISMICALLY QUALIFIED IN ACCORDANCE WITH DESIGN CRITERIA MEMORANDUM M-72 54A-C

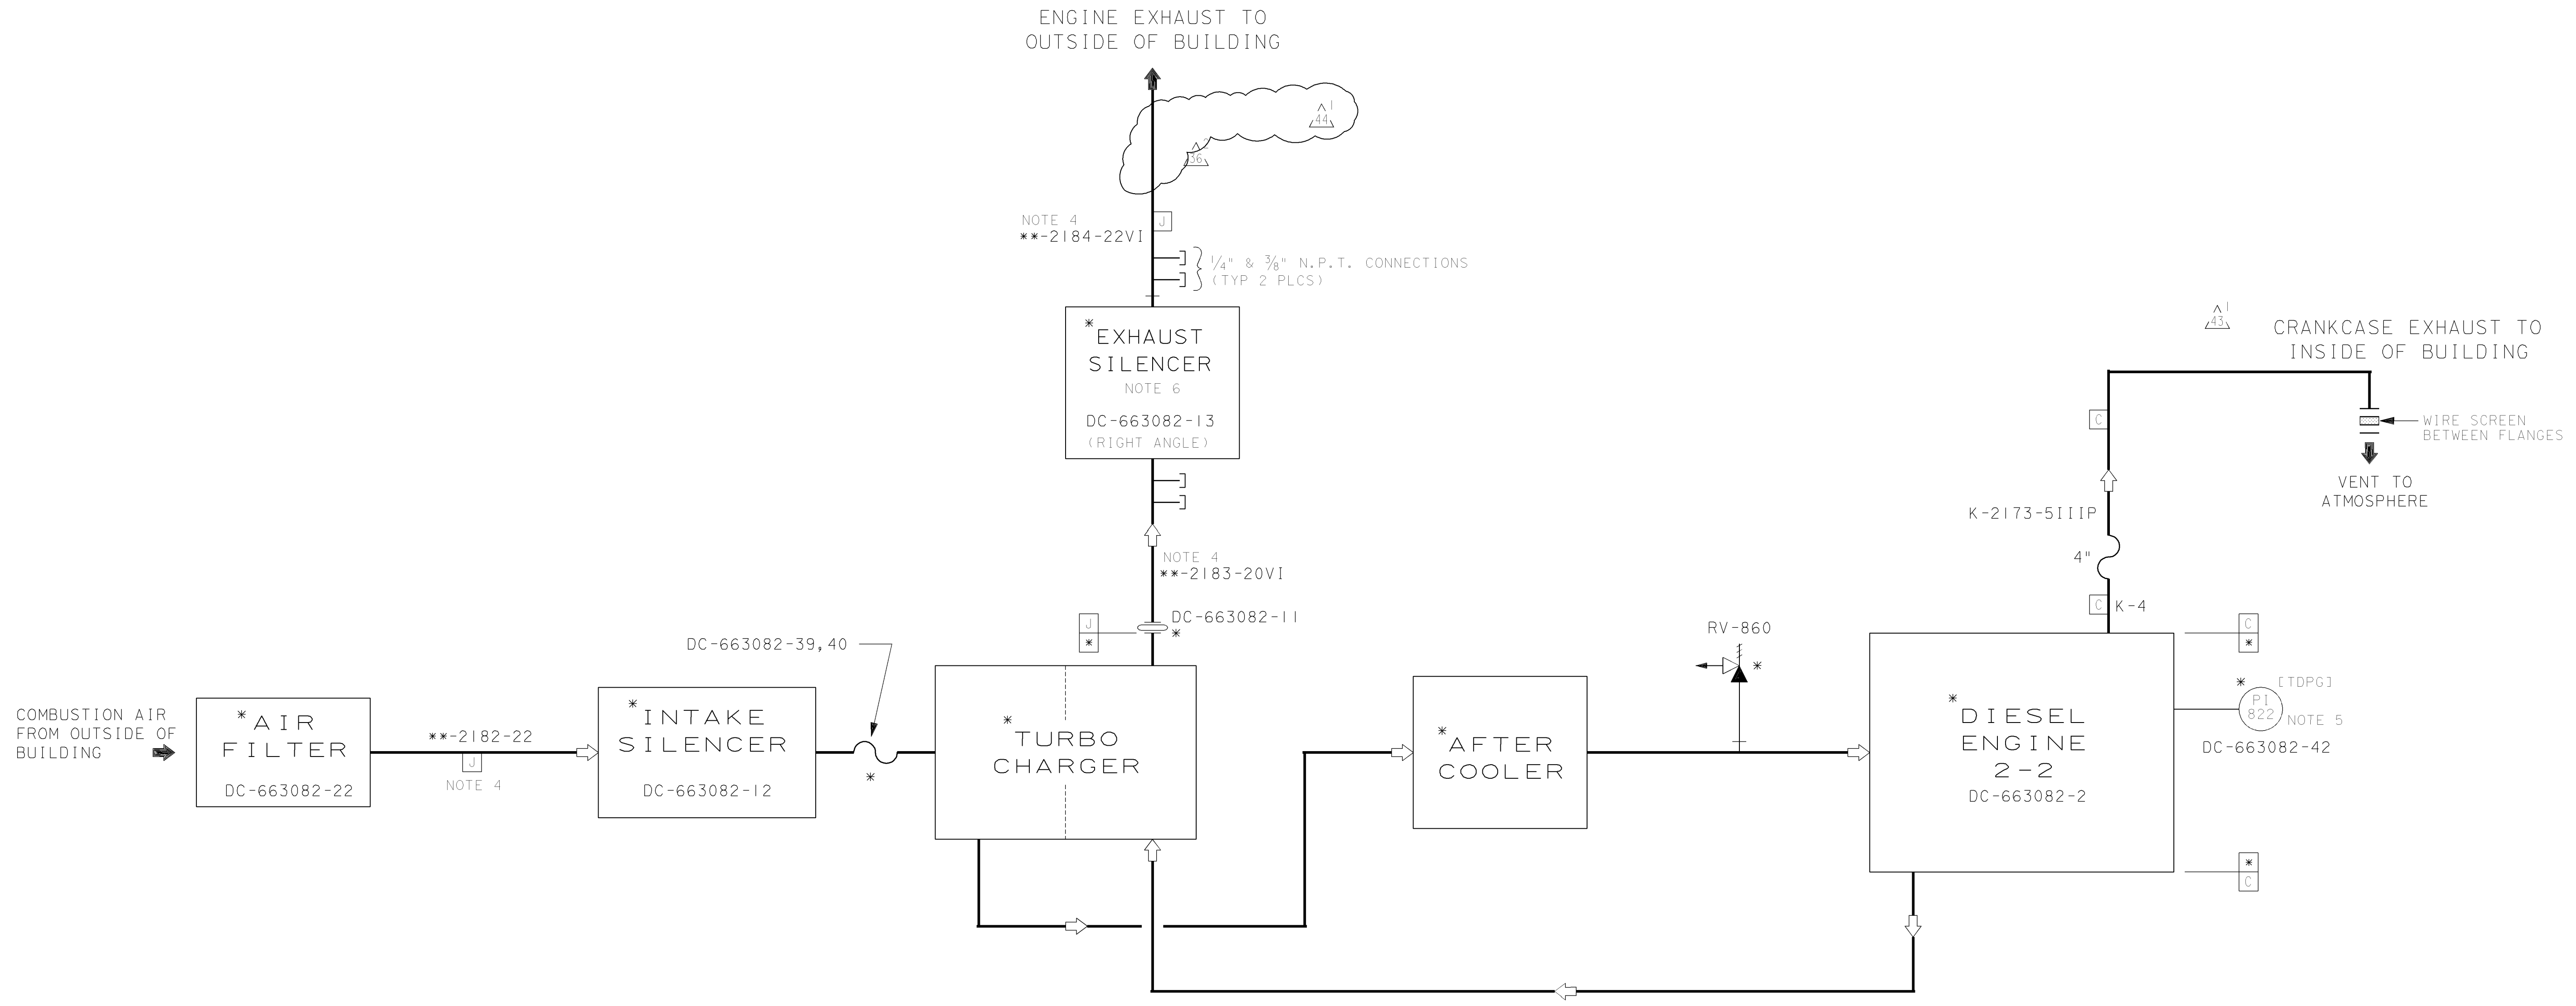

COMBUSTION AIR AND EXHAUST SYSTEM 2-2

UNIT 2

|             |        |         |
|-------------|--------|---------|
| P G & E CO. | 108021 | REV. 44 |
| SHEET 5A    | PAGE 0 |         |

|          |      |      |    |                       |            |         |           |                        |
|----------|------|------|----|-----------------------|------------|---------|-----------|------------------------|
| 12/17/03 | AJL2 | RMDI | -  | KERSI J. DALAL        | MECHANICAL | M 16690 | 3/31/2004 | Revised per FCT 028077 |
| DATE     | DWN  | RE   | IV | PROFESSIONAL ENGINEER | PE DISC.   | PE#     | PE EXP.   |                        |

CAD User: AJL2 Date: 12-16-2003 DCN=802155A.DGN