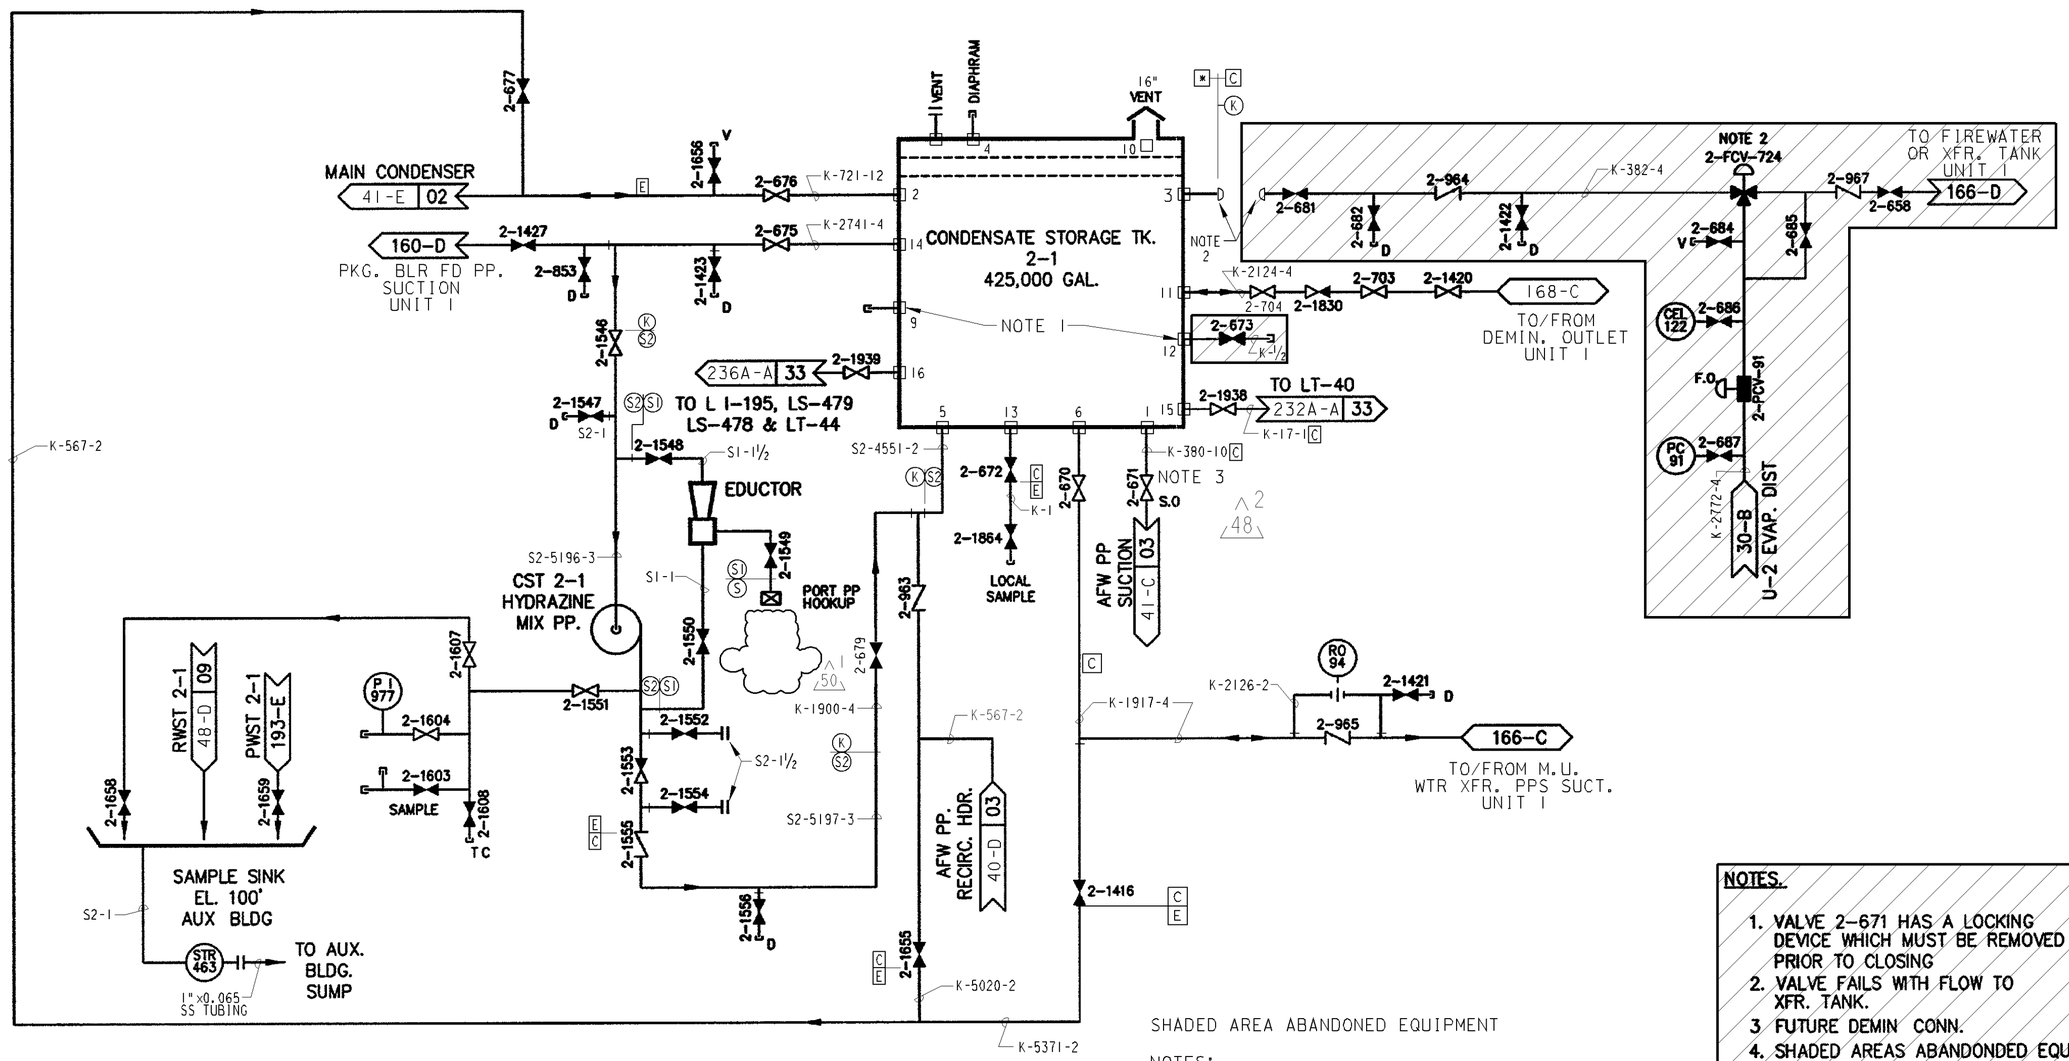

SHADED AREA ABANDONED EQUIPMENT

NOTES:

1. NOZZLES 9 & 12 ARE PLUGGED INSIDE TANK
2. NOZZLE N3 IS PLUGGED (BLIND PLATE WELDED INSIDE PIPE) AND ABANDONED LINE K-382-4 IS CAPPED AND BOTH ARE EMBEDDED.
3. VALVE 2-671 HAS A LOCKING DEVICE WHICH MUST BE REMOVED PRIOR TO CLOSING.

NOTES.

1. VALVE 2-671 HAS A LOCKING DEVICE WHICH MUST BE REMOVED PRIOR TO CLOSING
2. VALVE FAILS WITH FLOW TO XFR. TANK.
3. FUTURE DEMIN CONN.
4. SHADED AREAS ABANDONDED EQUIP

UNIT 2

DIABLO CANYON POWER PLANT - PG&E CO.

MAKE-UP WATER SYSTEM

DRAWING	SHEET	PAGE	REV
108016	17	0	50

DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	
03-10-2015	ZNS4	FxC2	SWH2	NOT REQUIRED PER CF3.ID5	-	-	-	REVISED PER DFT-7*2867

RASTER=8016sl7.dgn
DGN=8016sl7.dgn
CAD User: ZNS4 Date: 03-10-2015

INPGIC
I Size