


AUXILIARY BOILER BLOWDOWN & ROOM SUMP DRAINS TO REVERSE OSMOSIS (RO) SUMP

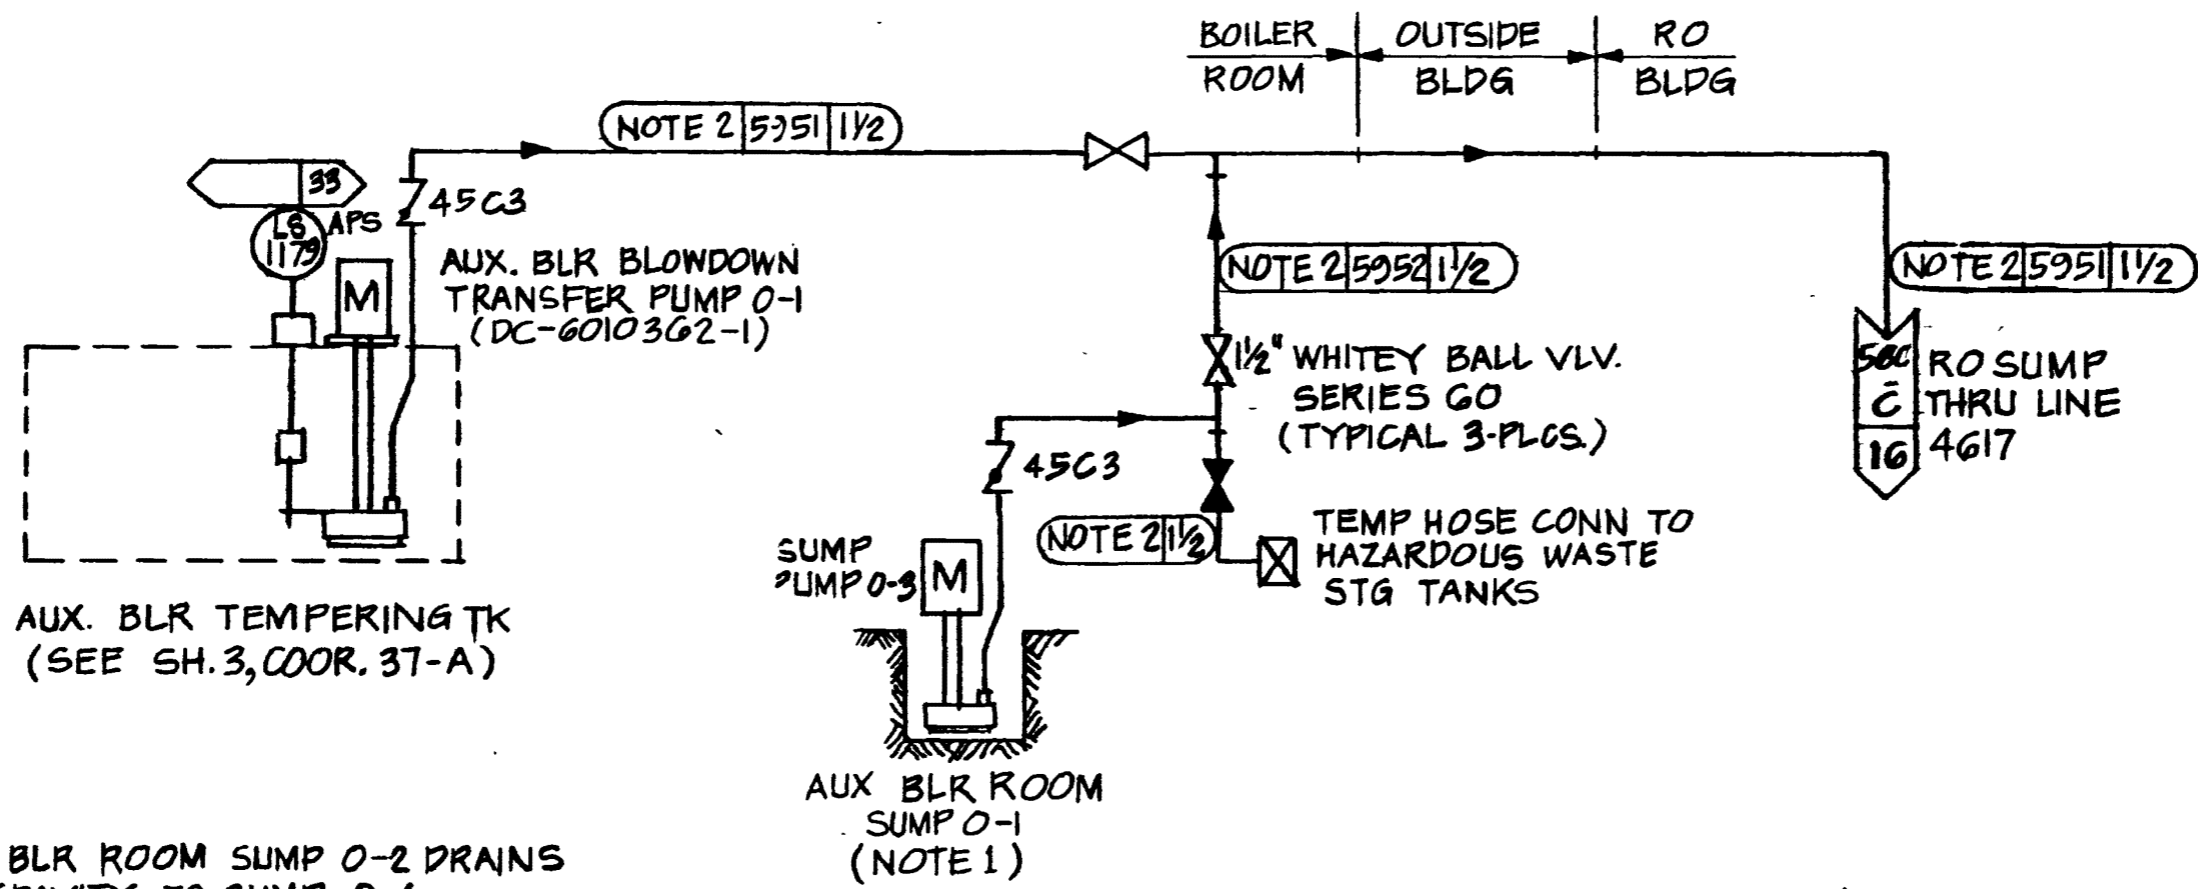

NOTES:

1. AUX BLR ROOM SUMP 0-2 DRAINS BY GRAVITY TO SUMP 0-1.
2. NON-SPEC STAINLESS STEEL TUBING: 0.065" WALL THICKNESS.
3. ALL PIPING ON THIS SHEET IS PG & E CLASS [E] UNLESS NOTED OTHERWISE.

REV. INCORPORATED REV. 33

PG&E CO.	102006	REV. 33
SHEET 3B OF SHEETS		33
MICROFILM		

SCAN 3 IC