
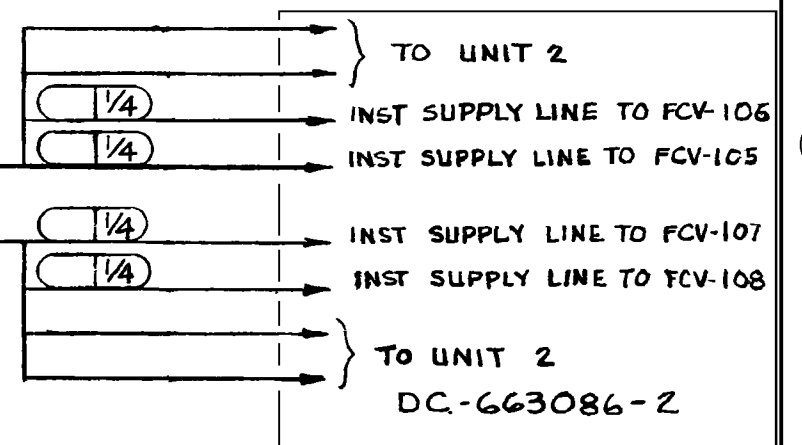


CO₂ BOTTLES 75 LBS

INITIAL DC-663086-6 EXTENDED

- NOTES:**
1. VALVES, PIPING AND INSTRUMENTS ON THIS SHEET ARE UNDER SPEC 8724, EXCEPT AS NOTED.
 2. ODORIZER ASSEMBLY (SPEC K6) AND 1" BALL VALVE, CHEMETRON NO.1-061-0709 WITH LOCKING DEVICE NO.5-061-0772.
 3. FCV-112 AND FCV-113 ARE PILOT OPERATED DISCHARGE HEADS.
 4. DISCHARGE HEADS ON MANIFOLD ARE PRESSURE OPERATED.
 5. FOR UNIT 2 INSTRUMENT SCHEMATIC REFERENCE, SEE SHEET 18A OF DWG 108036.

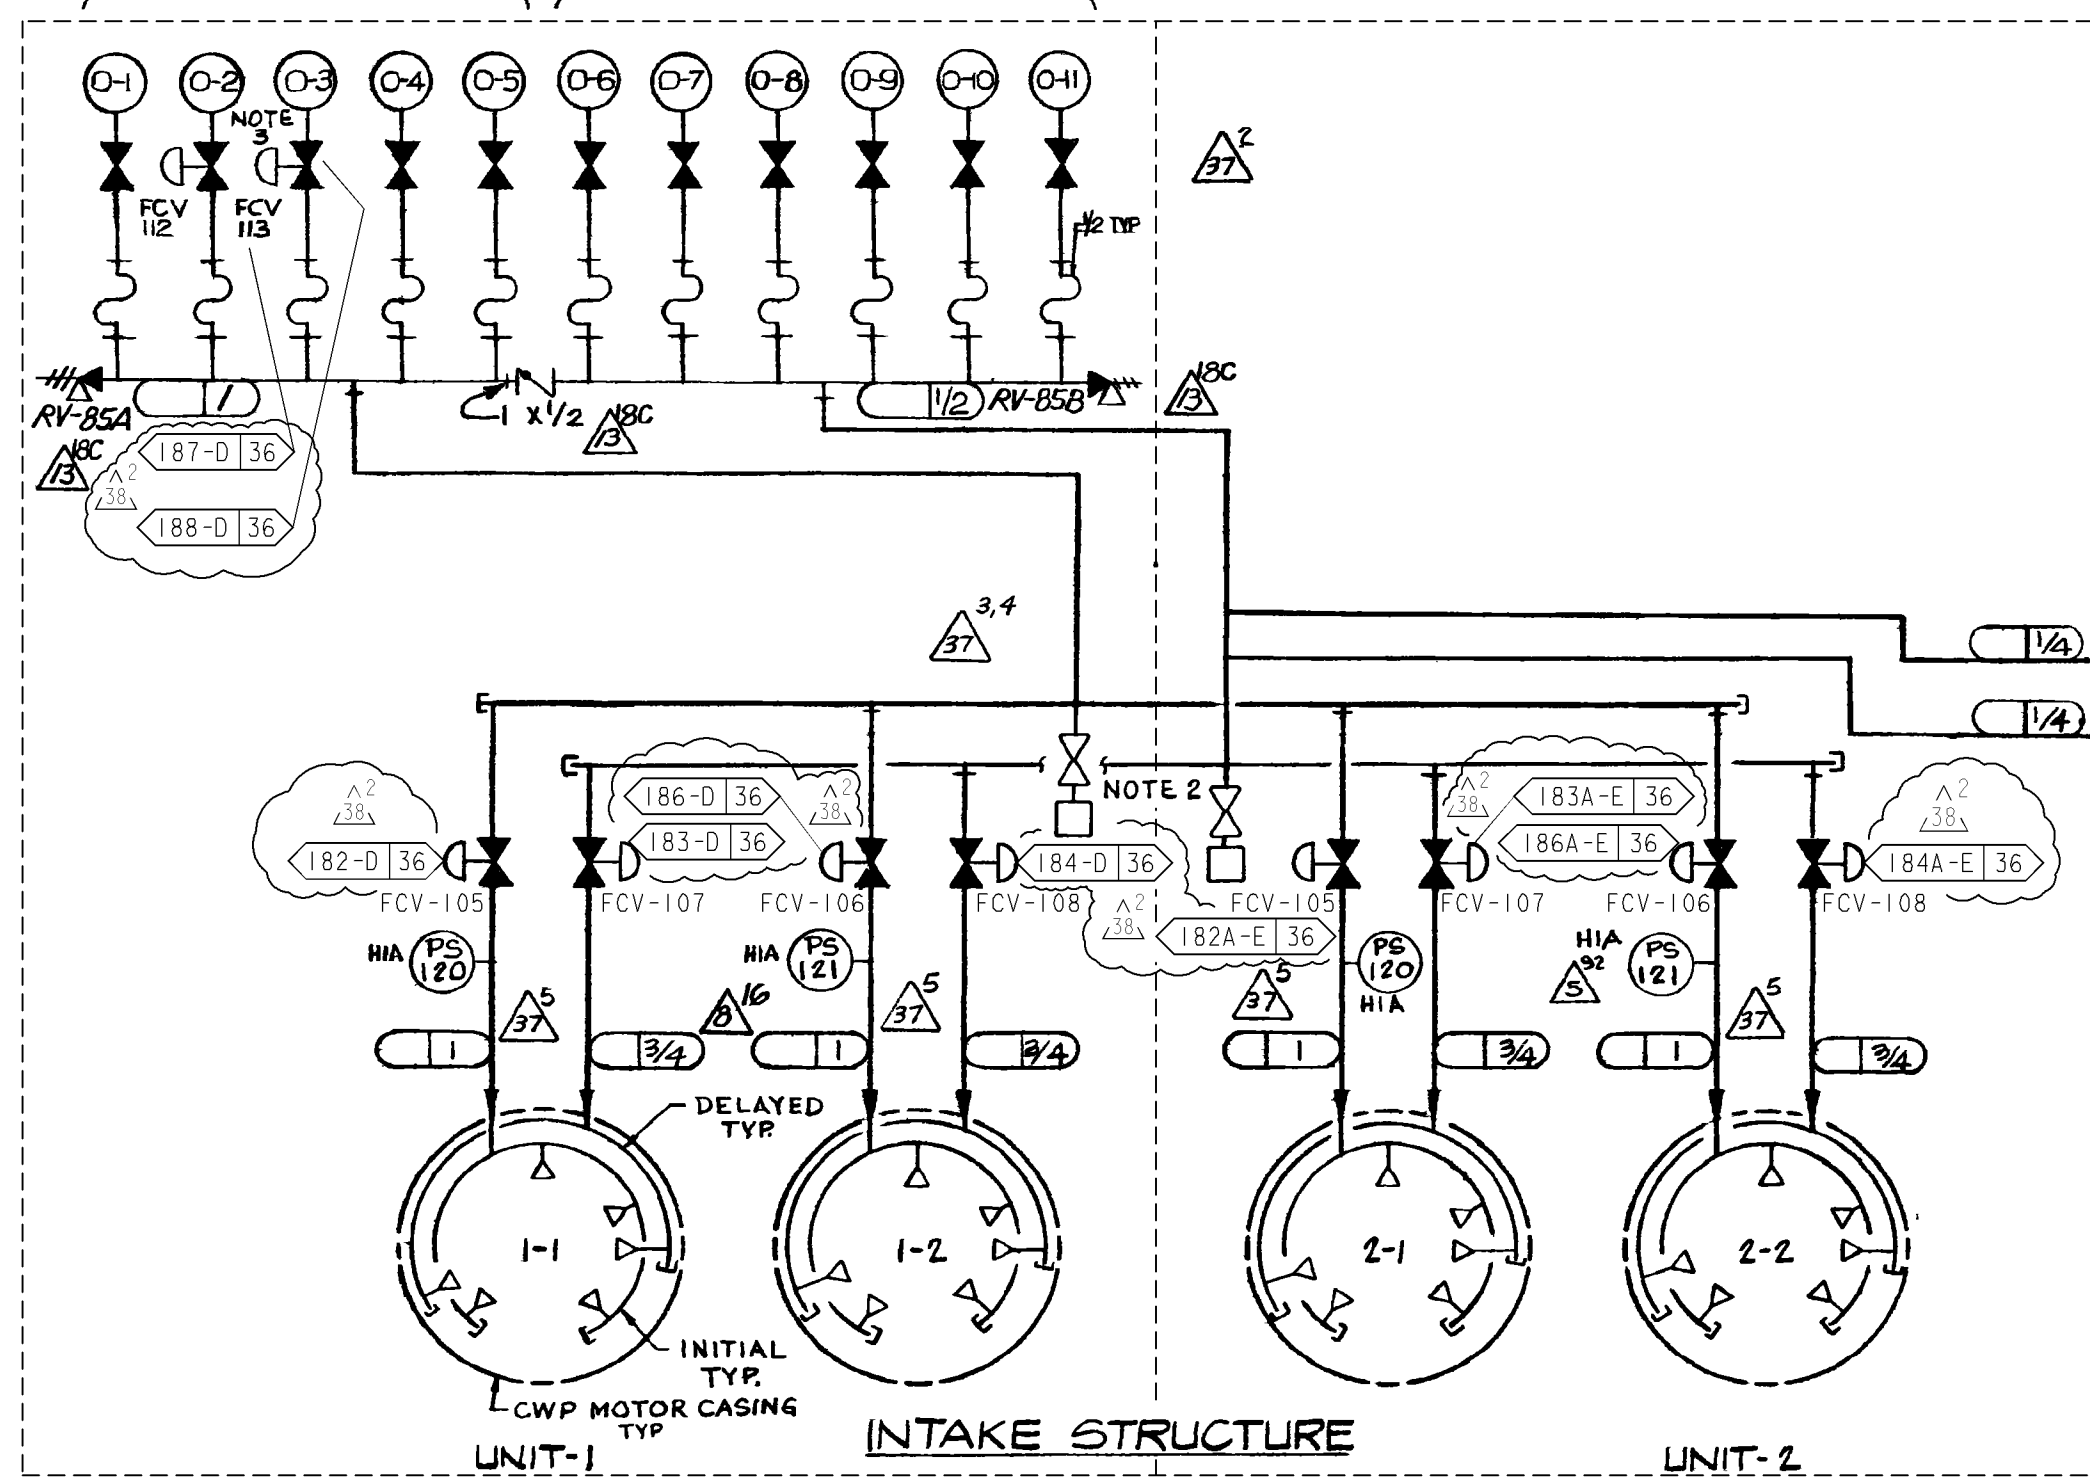

CO₂ PROTECTION SYSTEM FOR INTAKE STRUCTURE

UNIT-1 ⁹/₁₆

P G & E CO.		102018	REV.
SHEET 8	PAGE 0		38

CAD User: AJL2 Date: 9-21-2004
 DGN=102018S8.DGN
 RASTER=102018S8.TIF

TNPG2ND

9/22/04	AJL2	FXC2	-	KERSI J. DALAL	MECHANICAL	M 16690	3/31/2006	Revised per FCT 029332
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	