


RASTER=102792-1-0.dgn  
 DGN=102792-1-0.dgn  
 CAD User: ZNS4 Date: 06-18-2018

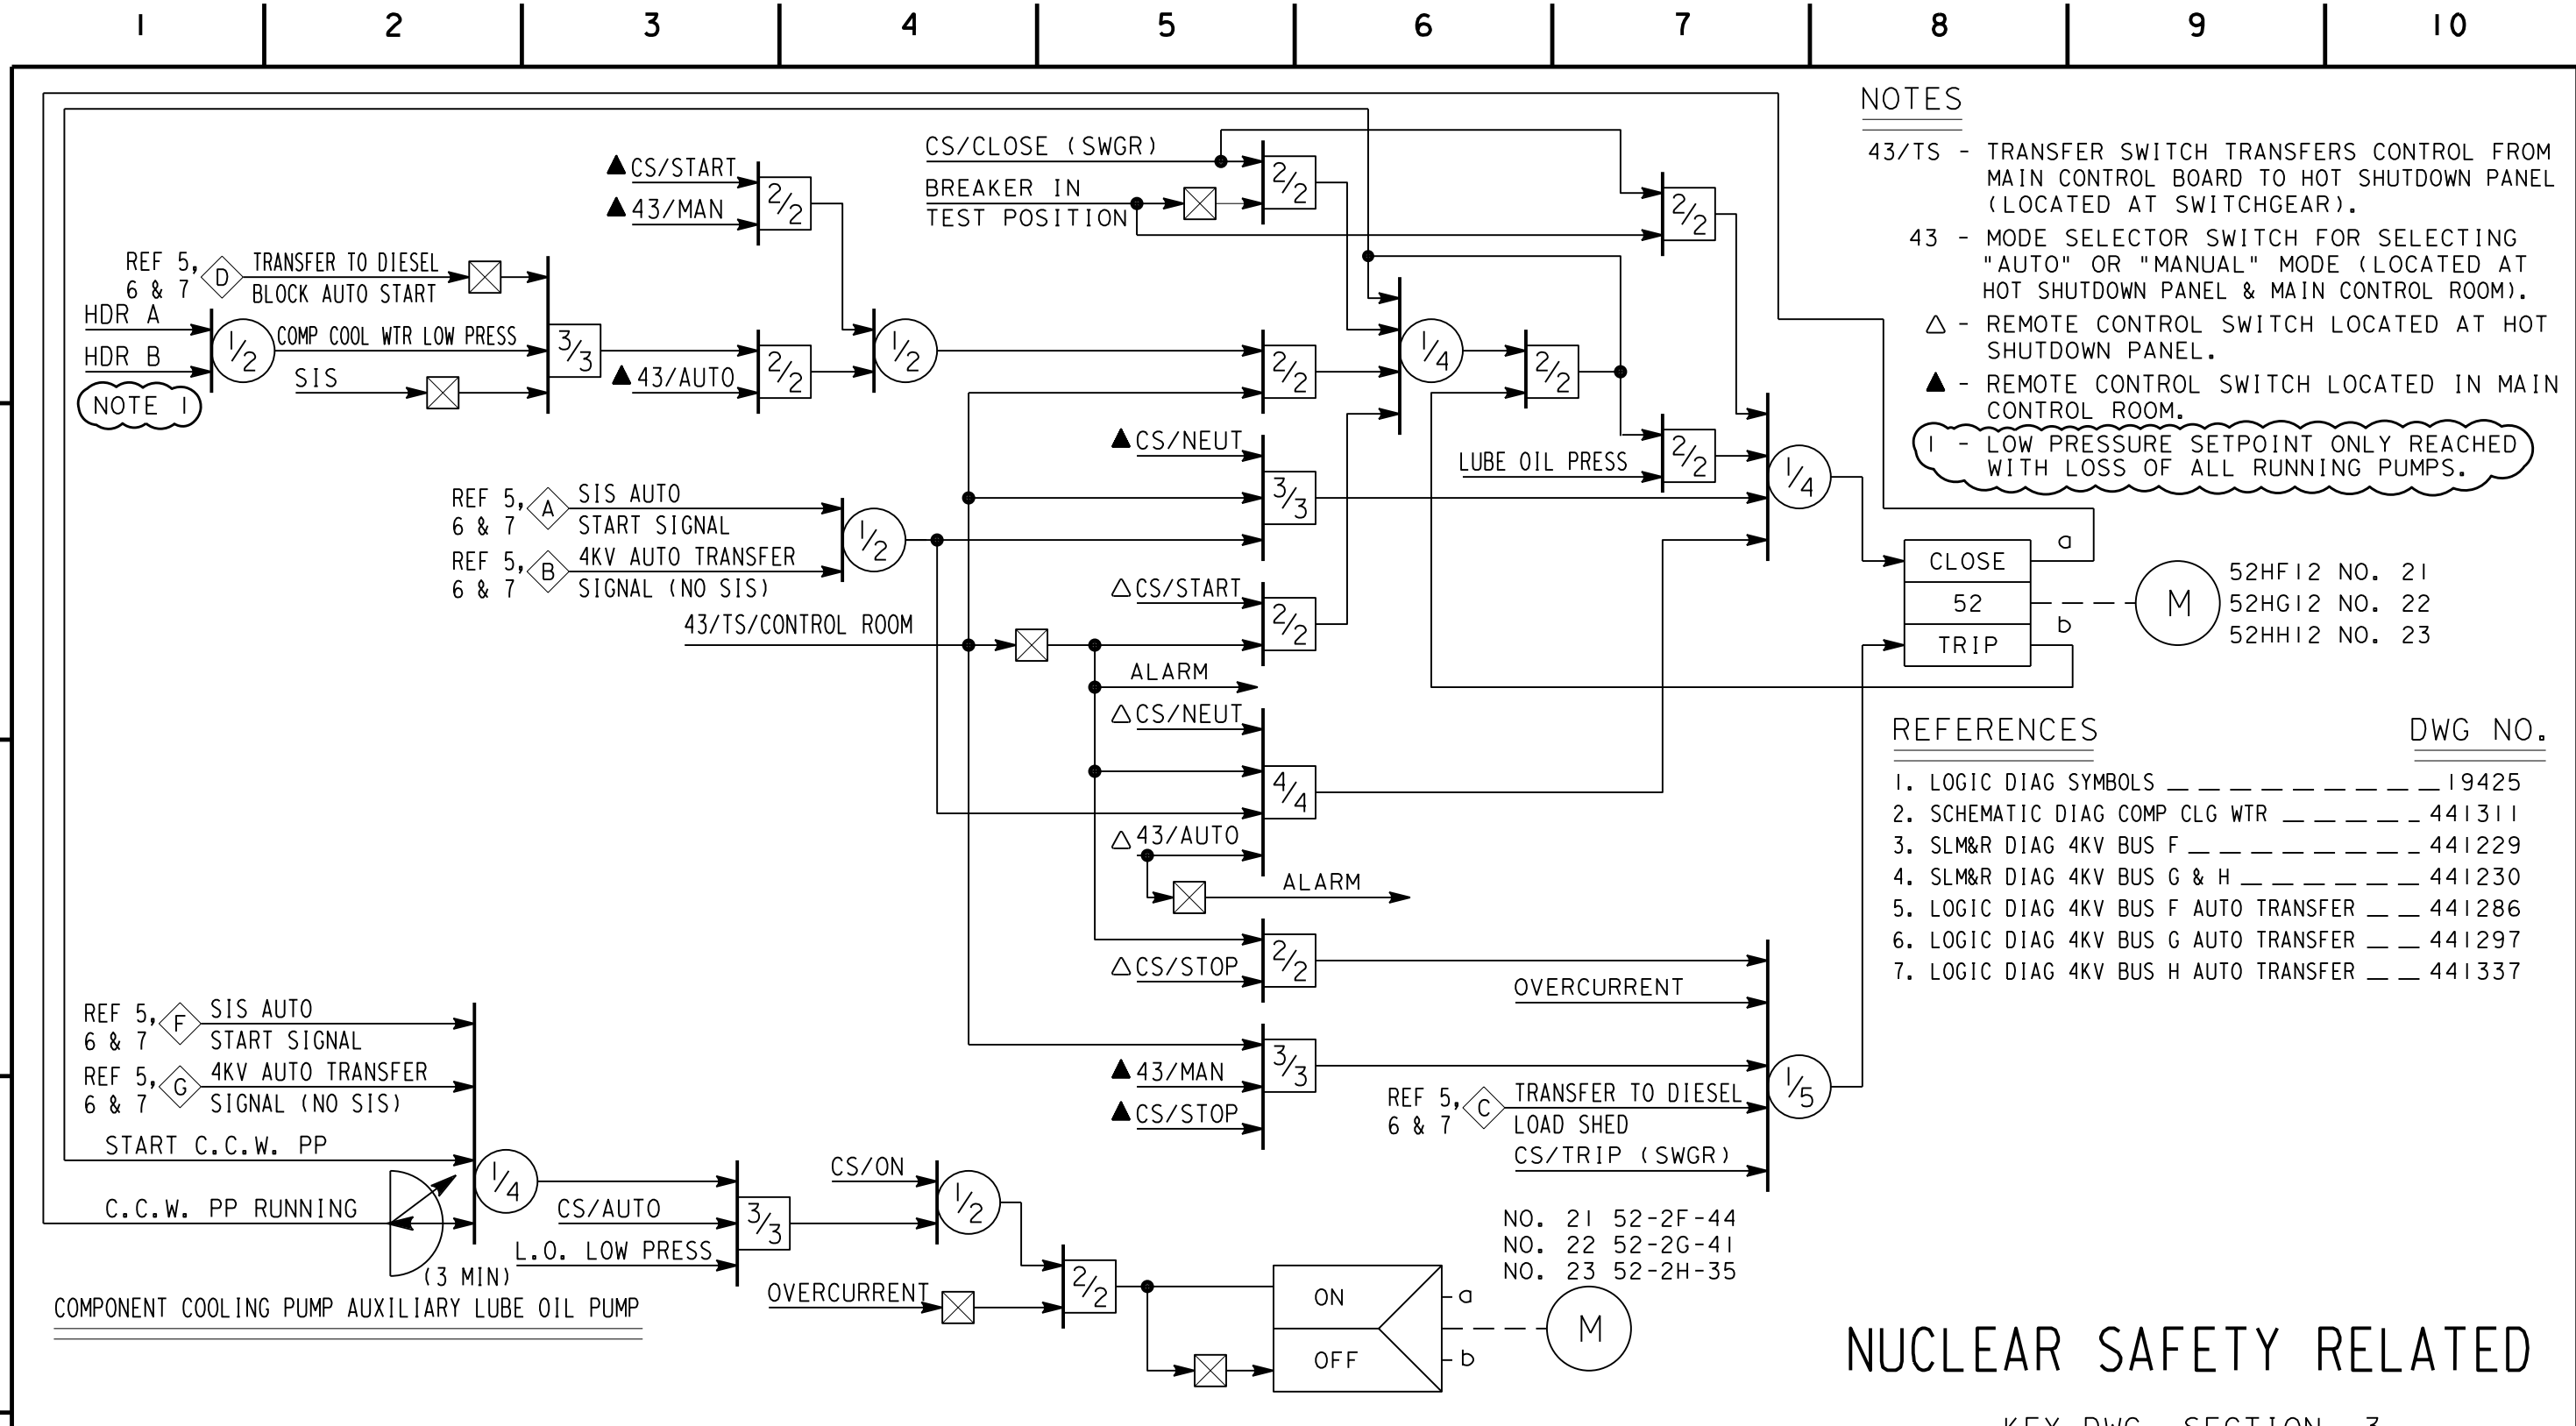

**NOTES**


43/TS - TRANSFER SWITCH TRANSFERS CONTROL FROM MAIN CONTROL BOARD TO HOT SHUTDOWN PANEL (LOCATED AT SWITCHGEAR).

43 - MODE SELECTOR SWITCH FOR SELECTING "AUTO" OR "MANUAL" MODE (LOCATED AT HOT SHUTDOWN PANEL & MAIN CONTROL ROOM).

△ - REMOTE CONTROL SWITCH LOCATED AT HOT SHUTDOWN PANEL.

▲ - REMOTE CONTROL SWITCH LOCATED IN MAIN CONTROL ROOM.

I - LOW PRESSURE SETPOINT ONLY REACHED WITH LOSS OF ALL RUNNING PUMPS.

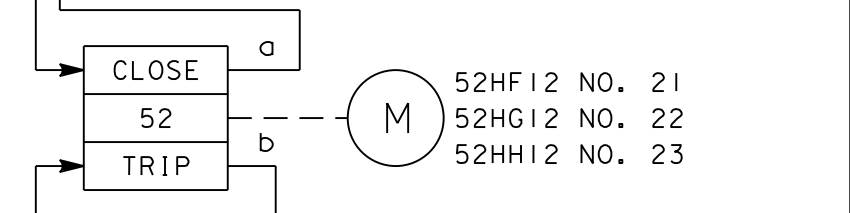

**REFERENCES**

	DWG NO.
1. LOGIC DIAG SYMBOLS	19425
2. SCHEMATIC DIAG COMP CLG WTR	441311
3. SLM&R DIAG 4KV BUS F	441229
4. SLM&R DIAG 4KV BUS G & H	441230
5. LOGIC DIAG 4KV BUS F AUTO TRANSFER	441286
6. LOGIC DIAG 4KV BUS G AUTO TRANSFER	441297
7. LOGIC DIAG 4KV BUS H AUTO TRANSFER	441337

DATE	
06-18-2018	
D. D.	ZNS4
R. E.	FXC2
I. V.	N/A
P. E.	N/A



REVISION DESCRIPTION
Revised Per DDN-2*1867

**ELECTRICAL**  
**LOGIC DIAGRAM**  
**COMPONENT COOLING WATER PUMPS**

DIABLO CANYON POWER PLANT  
**PACIFIC GAS AND ELECTRIC COMPANY**  
 SAN FRANCISCO, CALIFORNIA

DWG SCALE:			
BILL OF MATL:			
SUPSDS:			
SUPSD BY:			
DRAWING	SHEET	PAGE	REV
102792	1	0	5

**NUCLEAR SAFETY RELATED**

UNIT 2

KEY DWG. SECTION 3