

E

D

C

B

A

E


D

C

B

A

211-C

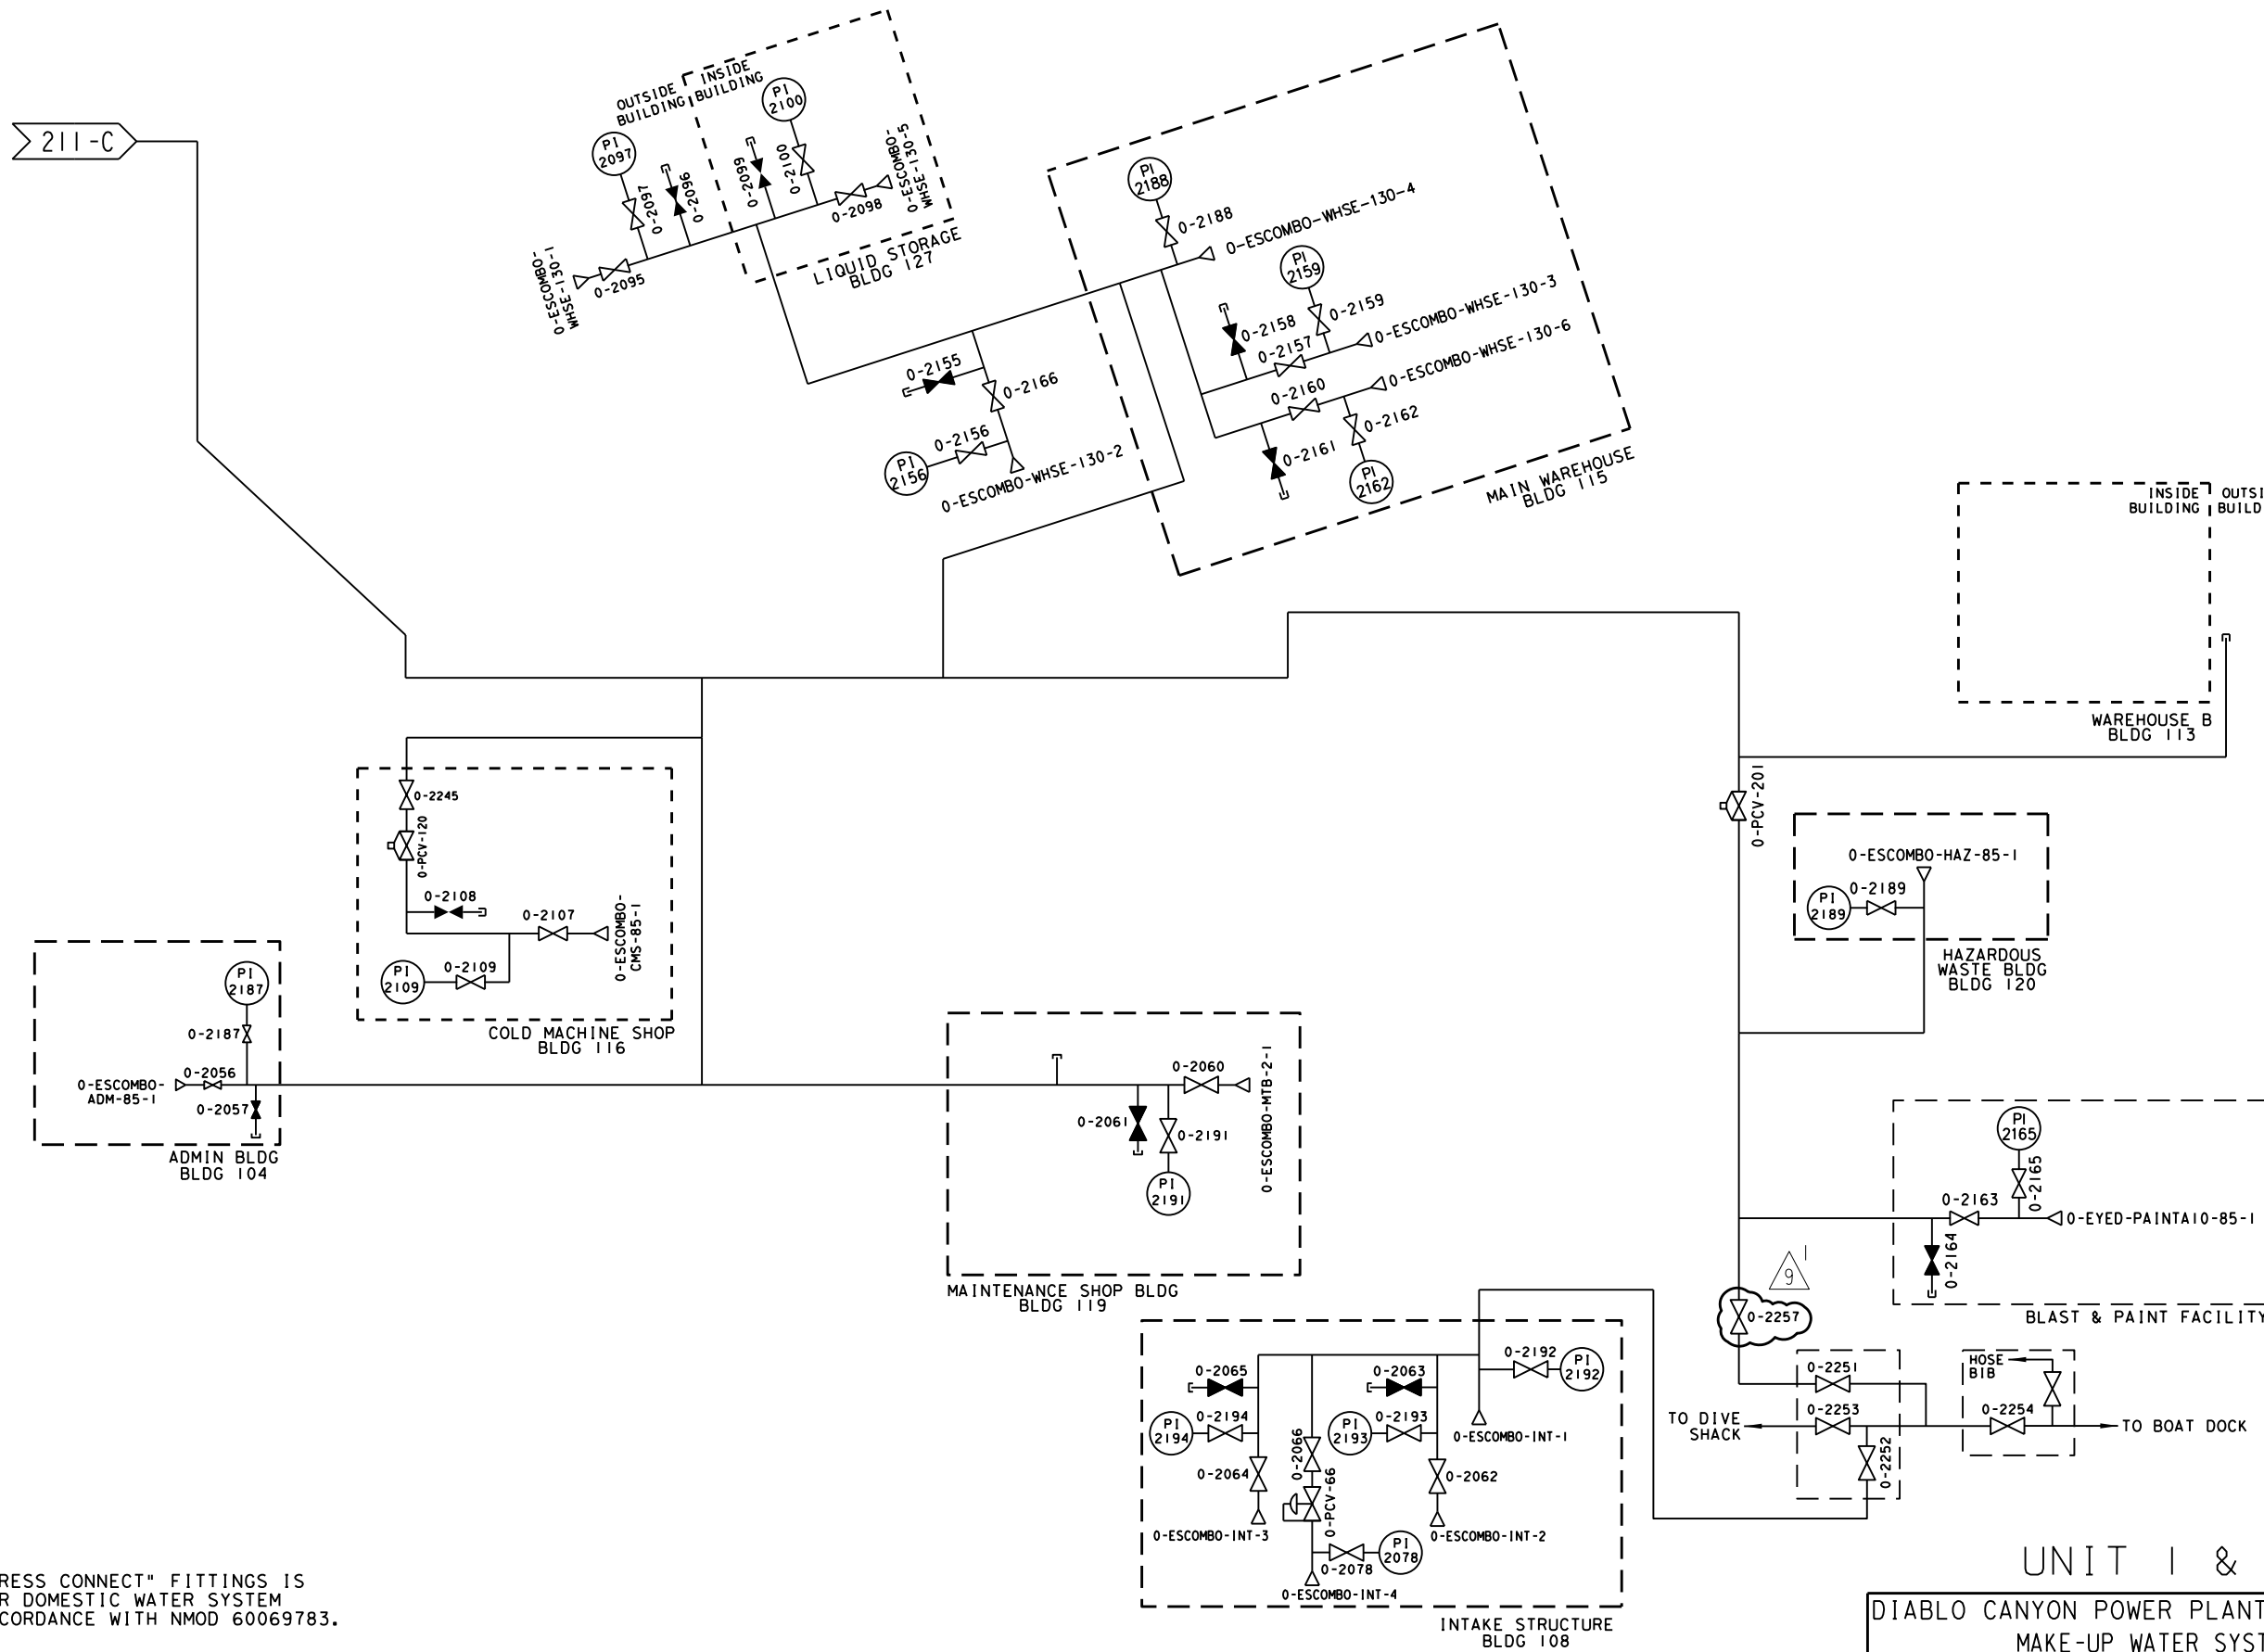

1. THE USE OF "PRESS CONNECT" FITTINGS IS ACCEPTABLE FOR DOMESTIC WATER SYSTEM REPAIRS IN ACCORDANCE WITH NMOD 60069783.

SAFETY SHOWER AND EYEWASH STATION FLOW DIAGRAMS

UNIT 1 & 2

DIABLO CANYON POWER PLANT - PG&E CO.
MAKE-UP WATER SYSTEM

DRAWING	SHEET	PAGE	REV
102016	21A	0	9

RASTER=102016-21A-0.dgn
DGN=102016-21A-0.dgn
CAD User: ZNS4 Date:02-19-2020

INPGIC
1 Size

02-19-2020	ZNS4	FXC2	N/A	NOT REQUIRED PER CF3.ID5	-	-	-	Revised Per DFT-7*5103
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	