


E
D
C
B
A

RASTER=2008s5a.dgn
DGN=2008s5a.dgn
CAD User: AJFJ Date: 04-21-2011

3/12/2012

NOTES:

1. FOR DETAILS REFER TO SHEET 5C (52A-A)
2. STRAINER REQUIRES FLANGE AND SUCTION PIPING FLEXIBLE ENOUGH TO FACILITATE INSTALLATION OF PANCAKE STRAINERS FOR START-UP. (51A-E) (50A-E)
3. P-0120 WITH PTFE SLEEVE (51A-C)
4. SPEC. 0722, ITEM 21 (51A-A) (58A-A)
5. FOR VENTS / DRAINS OFF INLET LINES SEE SHEET 7.
6. ALL PIPING ON THIS SHEET IS PG&E CODE CLASS E EXCEPT AS NOTED.
7. BLANK PLATE INSTALLED PER "S2" SPEC, CODE CLASS E.

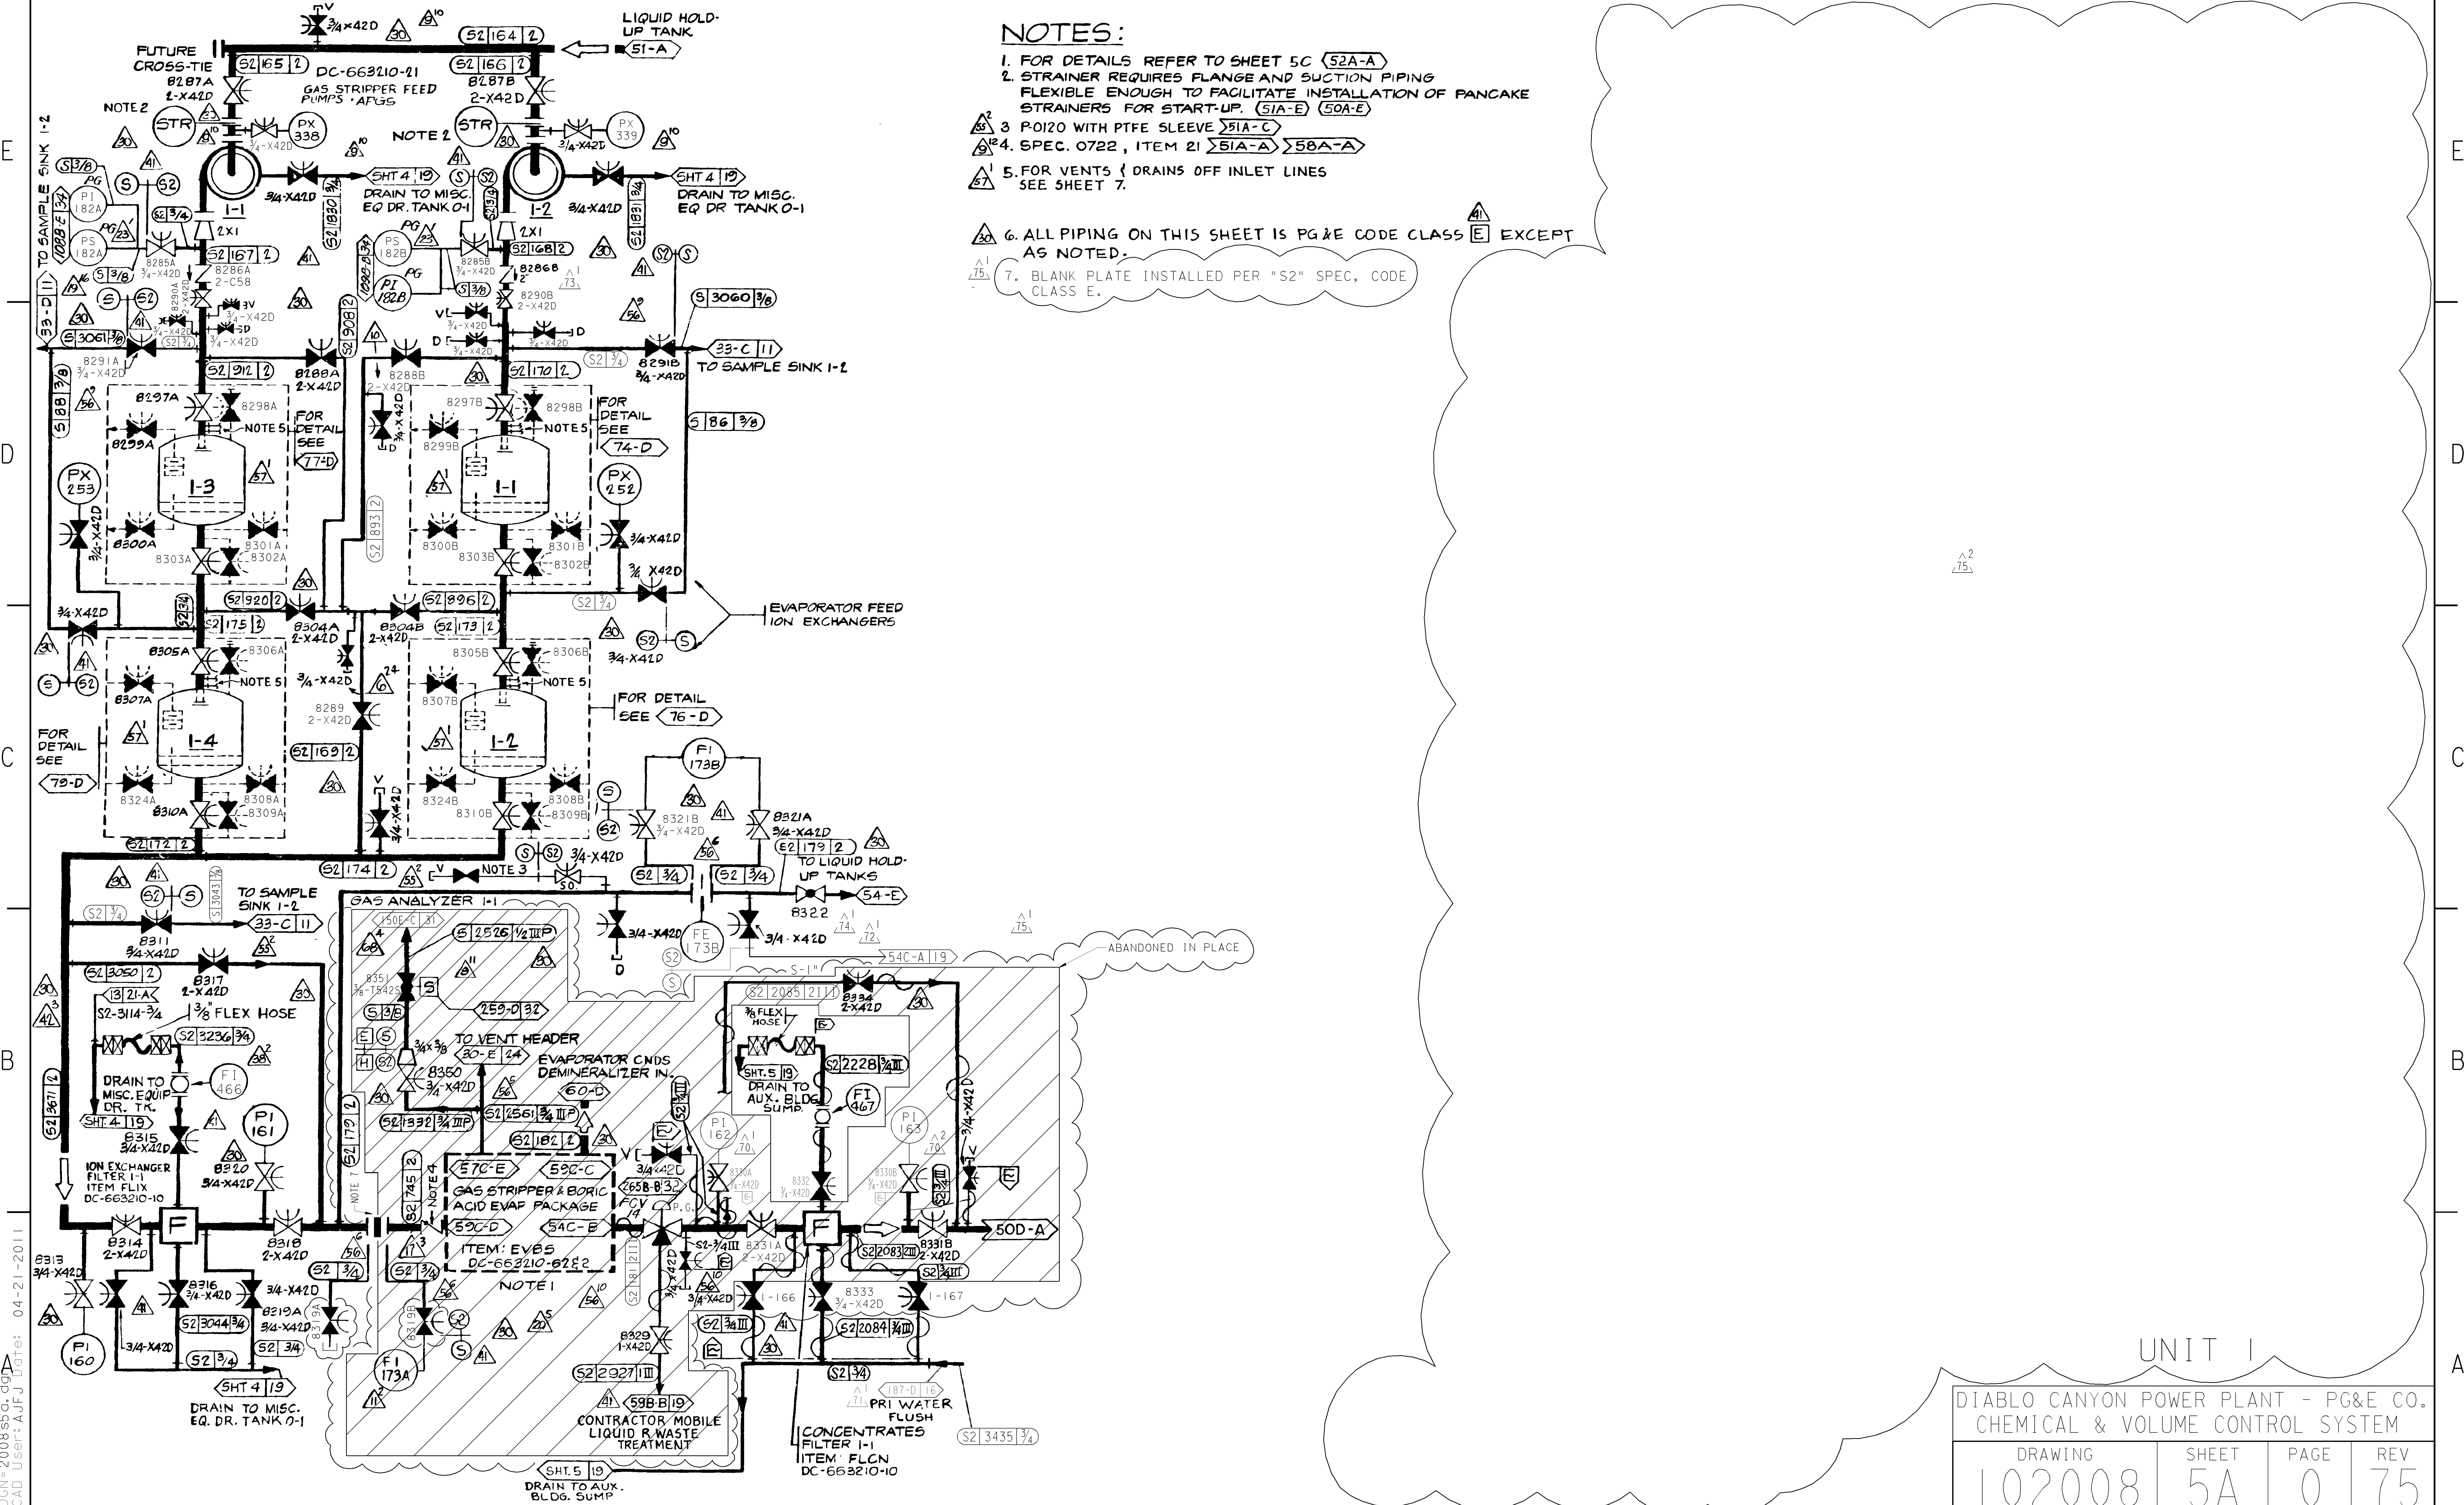

UNIT I
DIABLO CANYON POWER PLANT - PG&E CO.
CHEMICAL & VOLUME CONTROL SYSTEM

DRAWING	SHEET	PAGE	REV
102008	5A	0	75

04-21-2011	AJFJ	FxC2	KERSI J. DALAL	MECHANICAL	M 16690	3/31/2012	REVISED PER DDN-2*560
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE*	PE EXP.