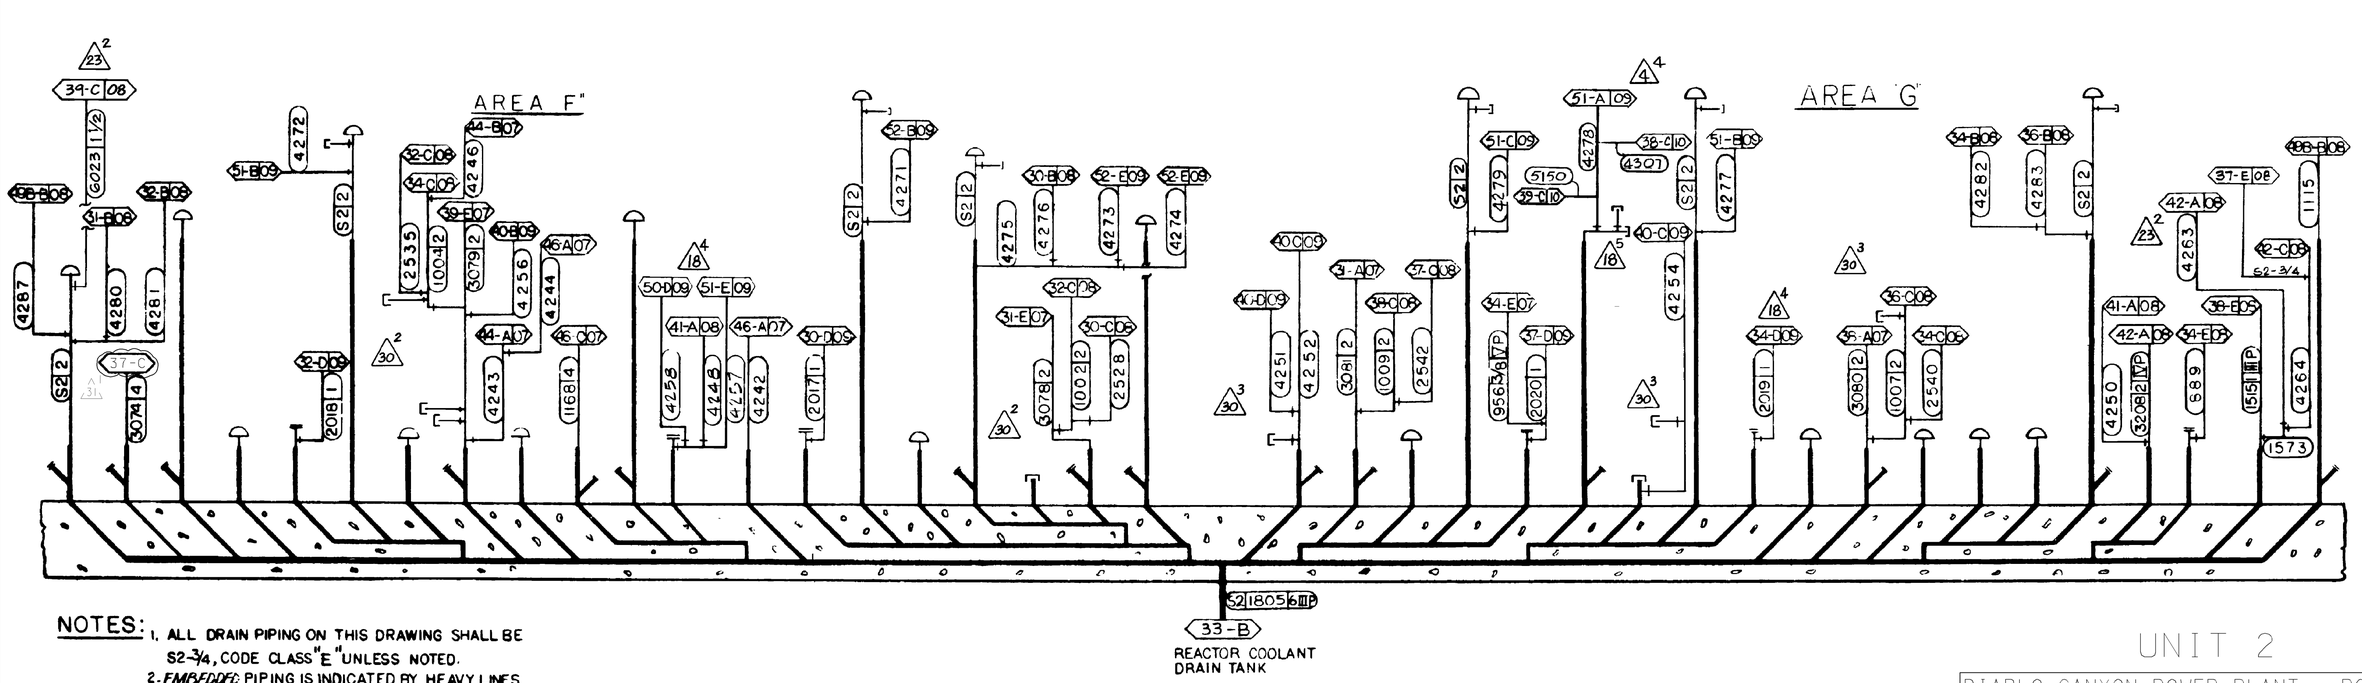

NOTES: 1. ALL DRAIN PIPING ON THIS DRAWING SHALL BE S2-¾, CODE CLASS "E" UNLESS NOTED.
2. EMBEDDED PIPING IS INDICATED BY HEAVY LINES REF. DWG. No. 501008 & 501009

INSIDE CONTAINMENT
CLOSED DRAIN TO EMBEDDED PIPING SYSTEM.

UNIT 2

DIABLO CANYON POWER PLANT - PG&E CO.
LIQUID RADWASTE SYSTEM

DRAWING	SHEET	PAGE	REV
108019	3A	0	31

DATE	DWN	RE	IV					
06-02-2010	GNO7	FxC2		KERSI J. DALAL	MECHANICAL	M 16690	3/31/2012	REVISED PER DFT-7*808
				PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	

RASTER=108019S3A.dgn
DGN=108019S3A.dgn
CAD User: GNO7 Date: 06-02-2010

INPGIC
3 Size