


- NOTES:**
- FOR LEGEND, ABBREVIATIONS, INDEX, AND GENERAL NOTES, SEE SHEET 2 (102023) OR SHEET 3 (102001).
  - DELETED
  - SEE DRAWING 59316 FOR AIR FLOW DIAGRAM. SEE DRAWINGS 59361, 59362, & 59363 FOR DUCT LAYOUT.
  - OPEN ONLY WHEN SAFEGUARDS AND BUILDING VENTILATION SYSTEMS ARE OPERATING SIMULTANEOUSLY (SUPPLY FAN S-32 WITH EXHAUST FAN E-1, AND SUPPLY FAN S-31 WITH EXHAUST FAN E-2, RESPECTIVELY.) >103-B> >104-D>
  - TEMPERATURE CONTROLLERS ARE LOCATED IN SUPPLY FAN ROOMS. ONLY TEMPERATURE BULB IS LOCATED IN THIS AIR PLENUM >103-B> >104-B>.
  - DELETED
  - DUCTWORK IS DESIGN CLASS II; DUCT AND DUCT SUPPORTS ARE QUALIFIED TO SEISMIC CLASS I CRITERIA. <106-E>

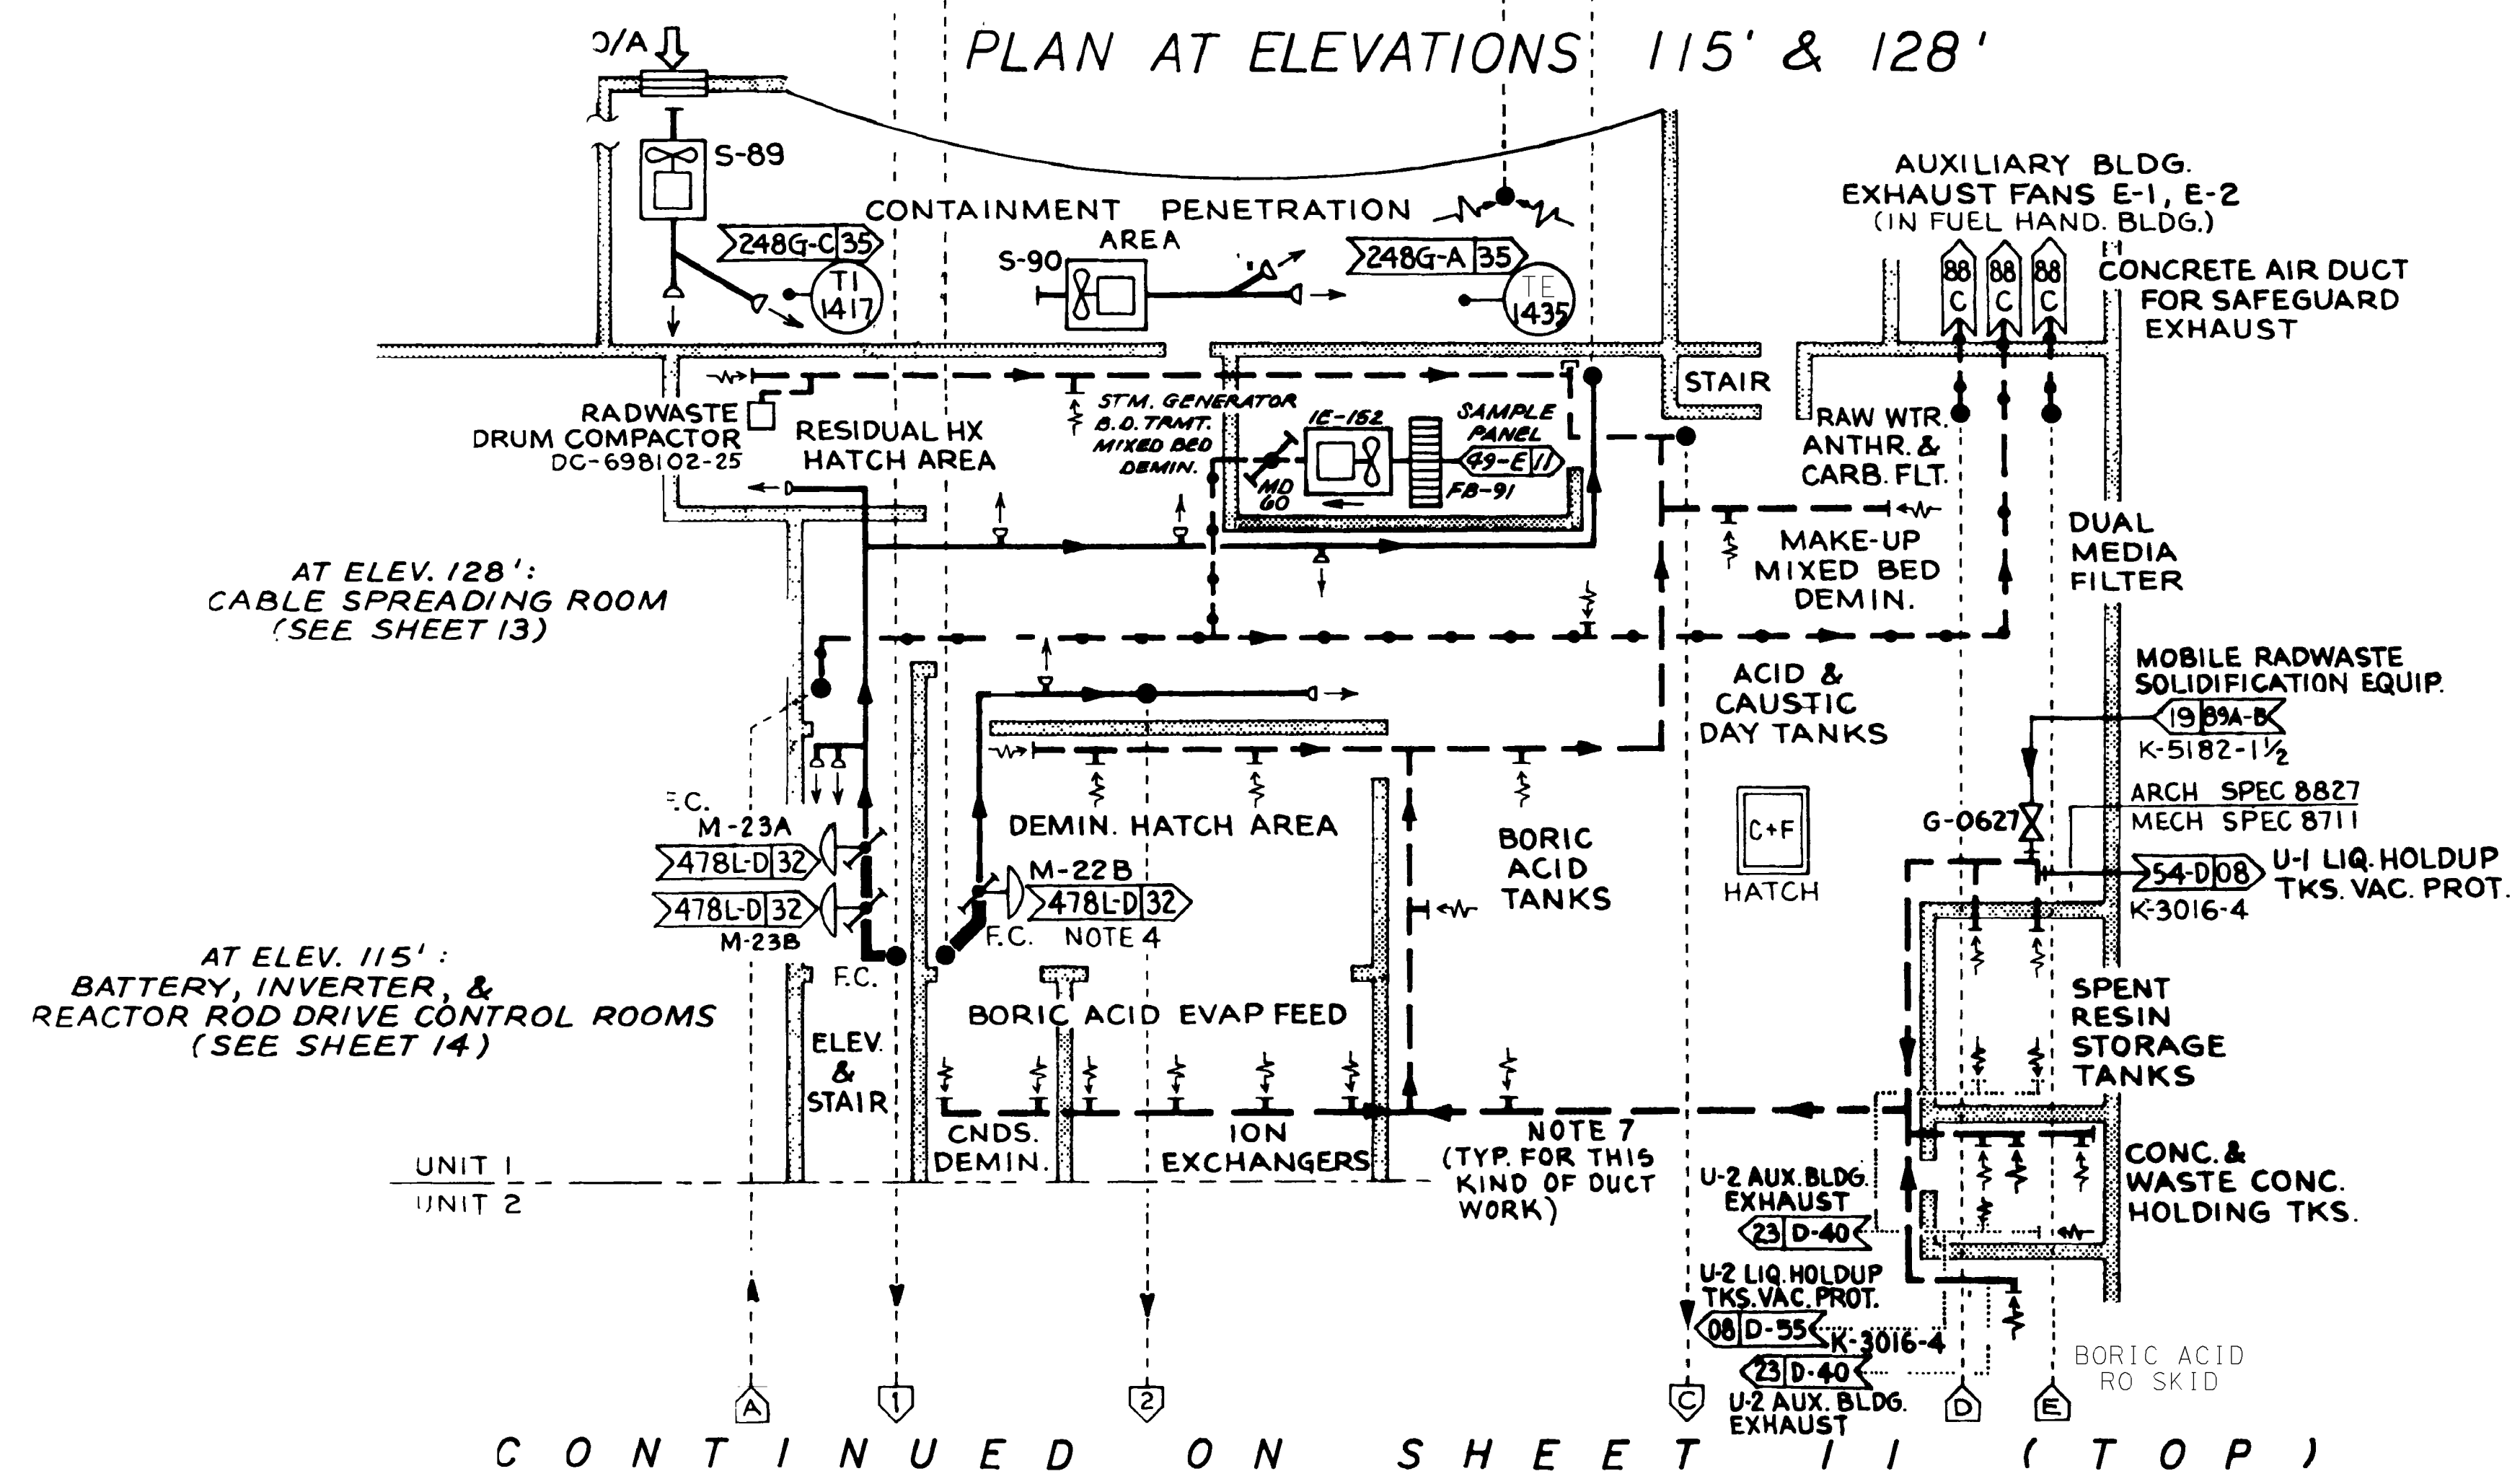

**AUXILIARY BUILDING HVAC (ENGINEERED SAFETY EQUIPMENT AREA)**

UNIT I

DIABLO CANYON POWER PLANT - PG&E CO.  
VENTILATION & AIR CONDITIONING SYSTEMS

DRAWING	SHEET	PAGE	REV
102023	10	0	102

09-30-2015	ZNS4	KJD3	N/A	NOT REQUIRED PER CF3.1D5	-	-	-	REVISED PER DDN-2*1035
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	

RASTER=2023sl10.dgn  
 DGN=2023sl10.dgn  
 CAD User: ZNS4 Date: 09-30-2015