


FIRE PUMP HOUSE AT PATTON FLAT

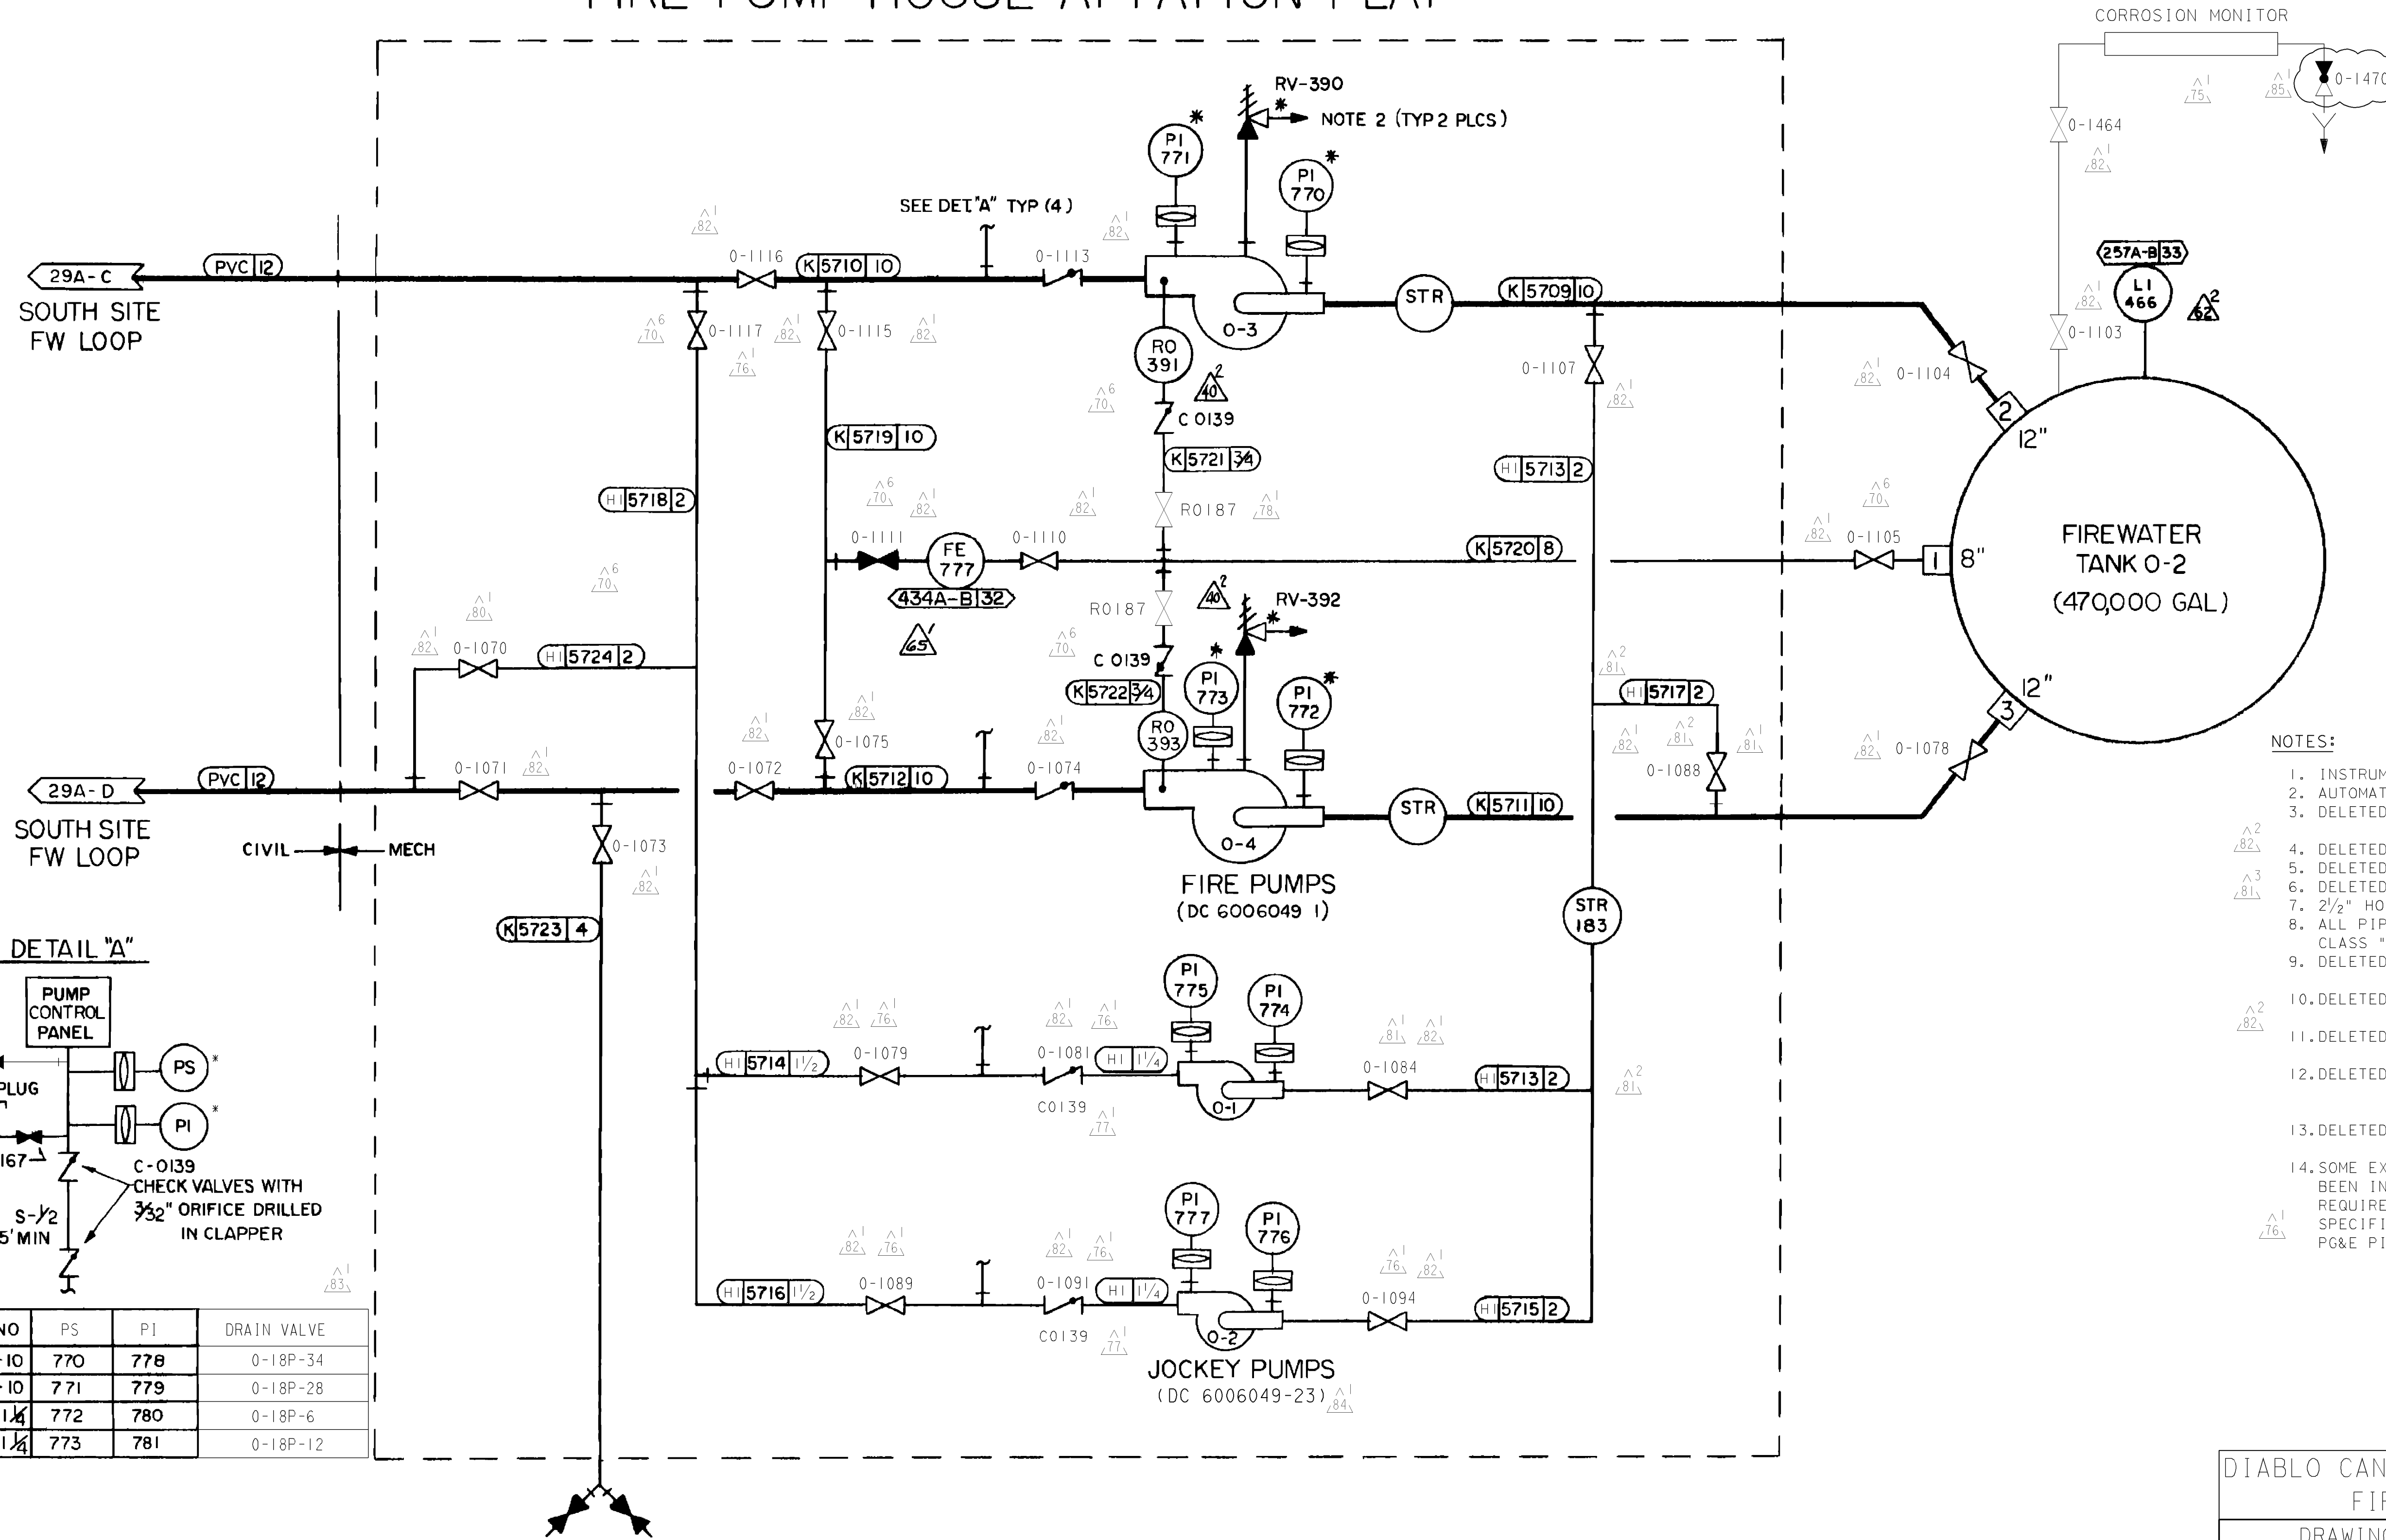

- NOTES:
1. INSTRUMENTS DENOTED BY * ARE VENDOR SUPPLIED.
 2. AUTOMATIC AIR RELEASE VENT.
 3. DELETED
 4. DELETED
 5. DELETED
 6. DELETED.
 7. 2 1/2" HOSE GATE VALVE, KENNEDY FIG. 39 (UL/FM).
 8. ALL PIPING THIS SHEET DOWNGRADED TO PG&E CODE CLASS "E" PER DCP-M-47548.
 9. DELETED
 10. DELETED
 11. DELETED
 12. DELETED
 13. DELETED
 14. SOME EXISTING SMALL BORE PIPING MAY HAVE BEEN INSTALLED PER, AND SATISFY THE REQUIREMENTS OF, PG&E PIPING SPEC "K". WHERE SPECIFIED, ALL NEW INSTALLATIONS TO BE PER PG&E PIPING SPEC "HI".

PUMP DISCH	LINE NO	PS	PI	DRAIN VALVE
FP 0-3	5710-10	770	778	0-18P-34
FP 0-4	5712-10	771	779	0-18P-28
JP 0-1	5714-1 1/4	772	780	0-18P-6
JP 0-2	5716-1 1/4	773	781	0-18P-12

UNIT I

DIABLO CANYON POWER PLANT - PG&E CO.
 FIRE PROTECTION SYSTEMS

DRAWING	SHEET	PAGE	REV
102018	2B	0	85

RASTER=2018s2b.dgn
 DGN=2018s2b.dgn
 CAD User: RxG2 Date: 07-06-2009