


E  
D  
C  
B  
A

E  
D  
C  
B  
A

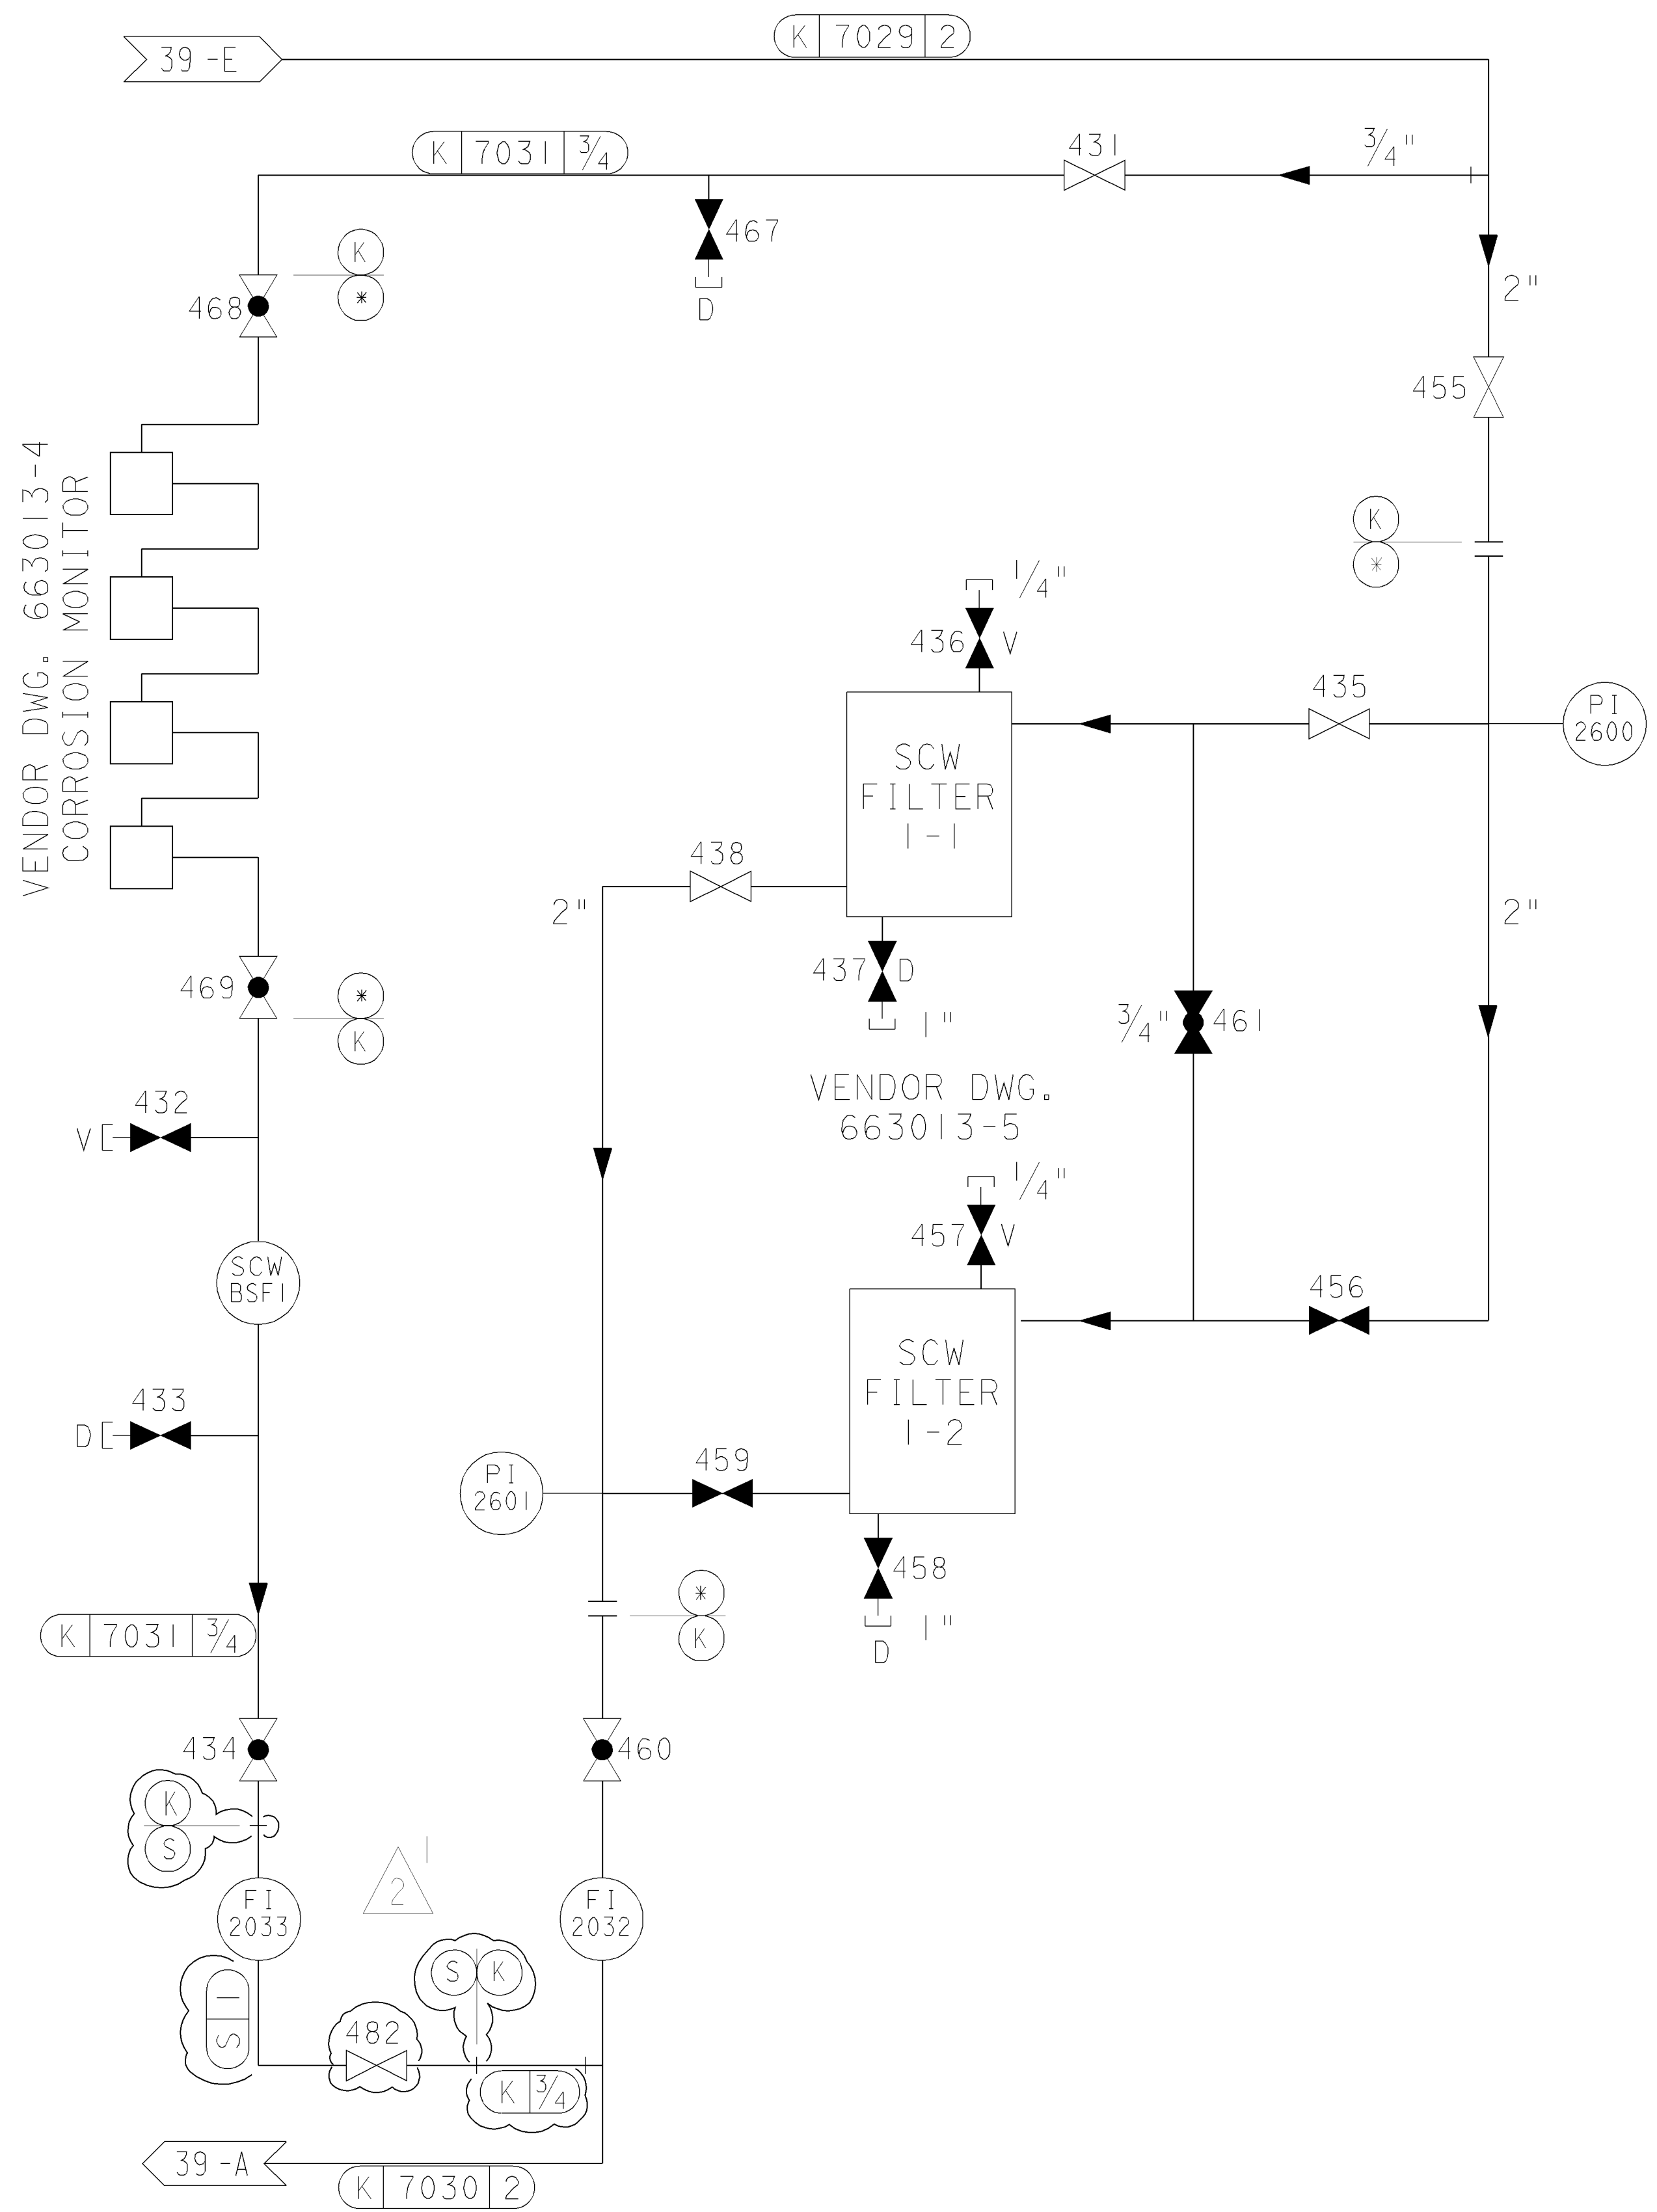

- NOTES:  
 1. ALL PIPING ON THIS DWG. SHALL BE P.G.&E. CLASS "E".  
 2. ALL DRAIN AND VENT VALVES, DESIGNATED "D" & "V", ARE 3/4" U.N.O.

UNIT 1			
DIABLO CANYON POWER PLANT - PG&E CO.			
SERVICE COOLING WATER SYSTEM			
DRAWING	SHEET	PAGE	REV
102015	3A	0	2

RASTER=102015s3A.dgn  
 DCN=102015s3A.dgn  
 CAD User: AJFJ Date: 03-23-2011

03-23-2011	AJFJ	FxC2		KERSTI J. DALAL	MECHANICAL	M 16690	3/31/2012	REVISED PER DDT-4*415
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	