


E
D
C
B
A

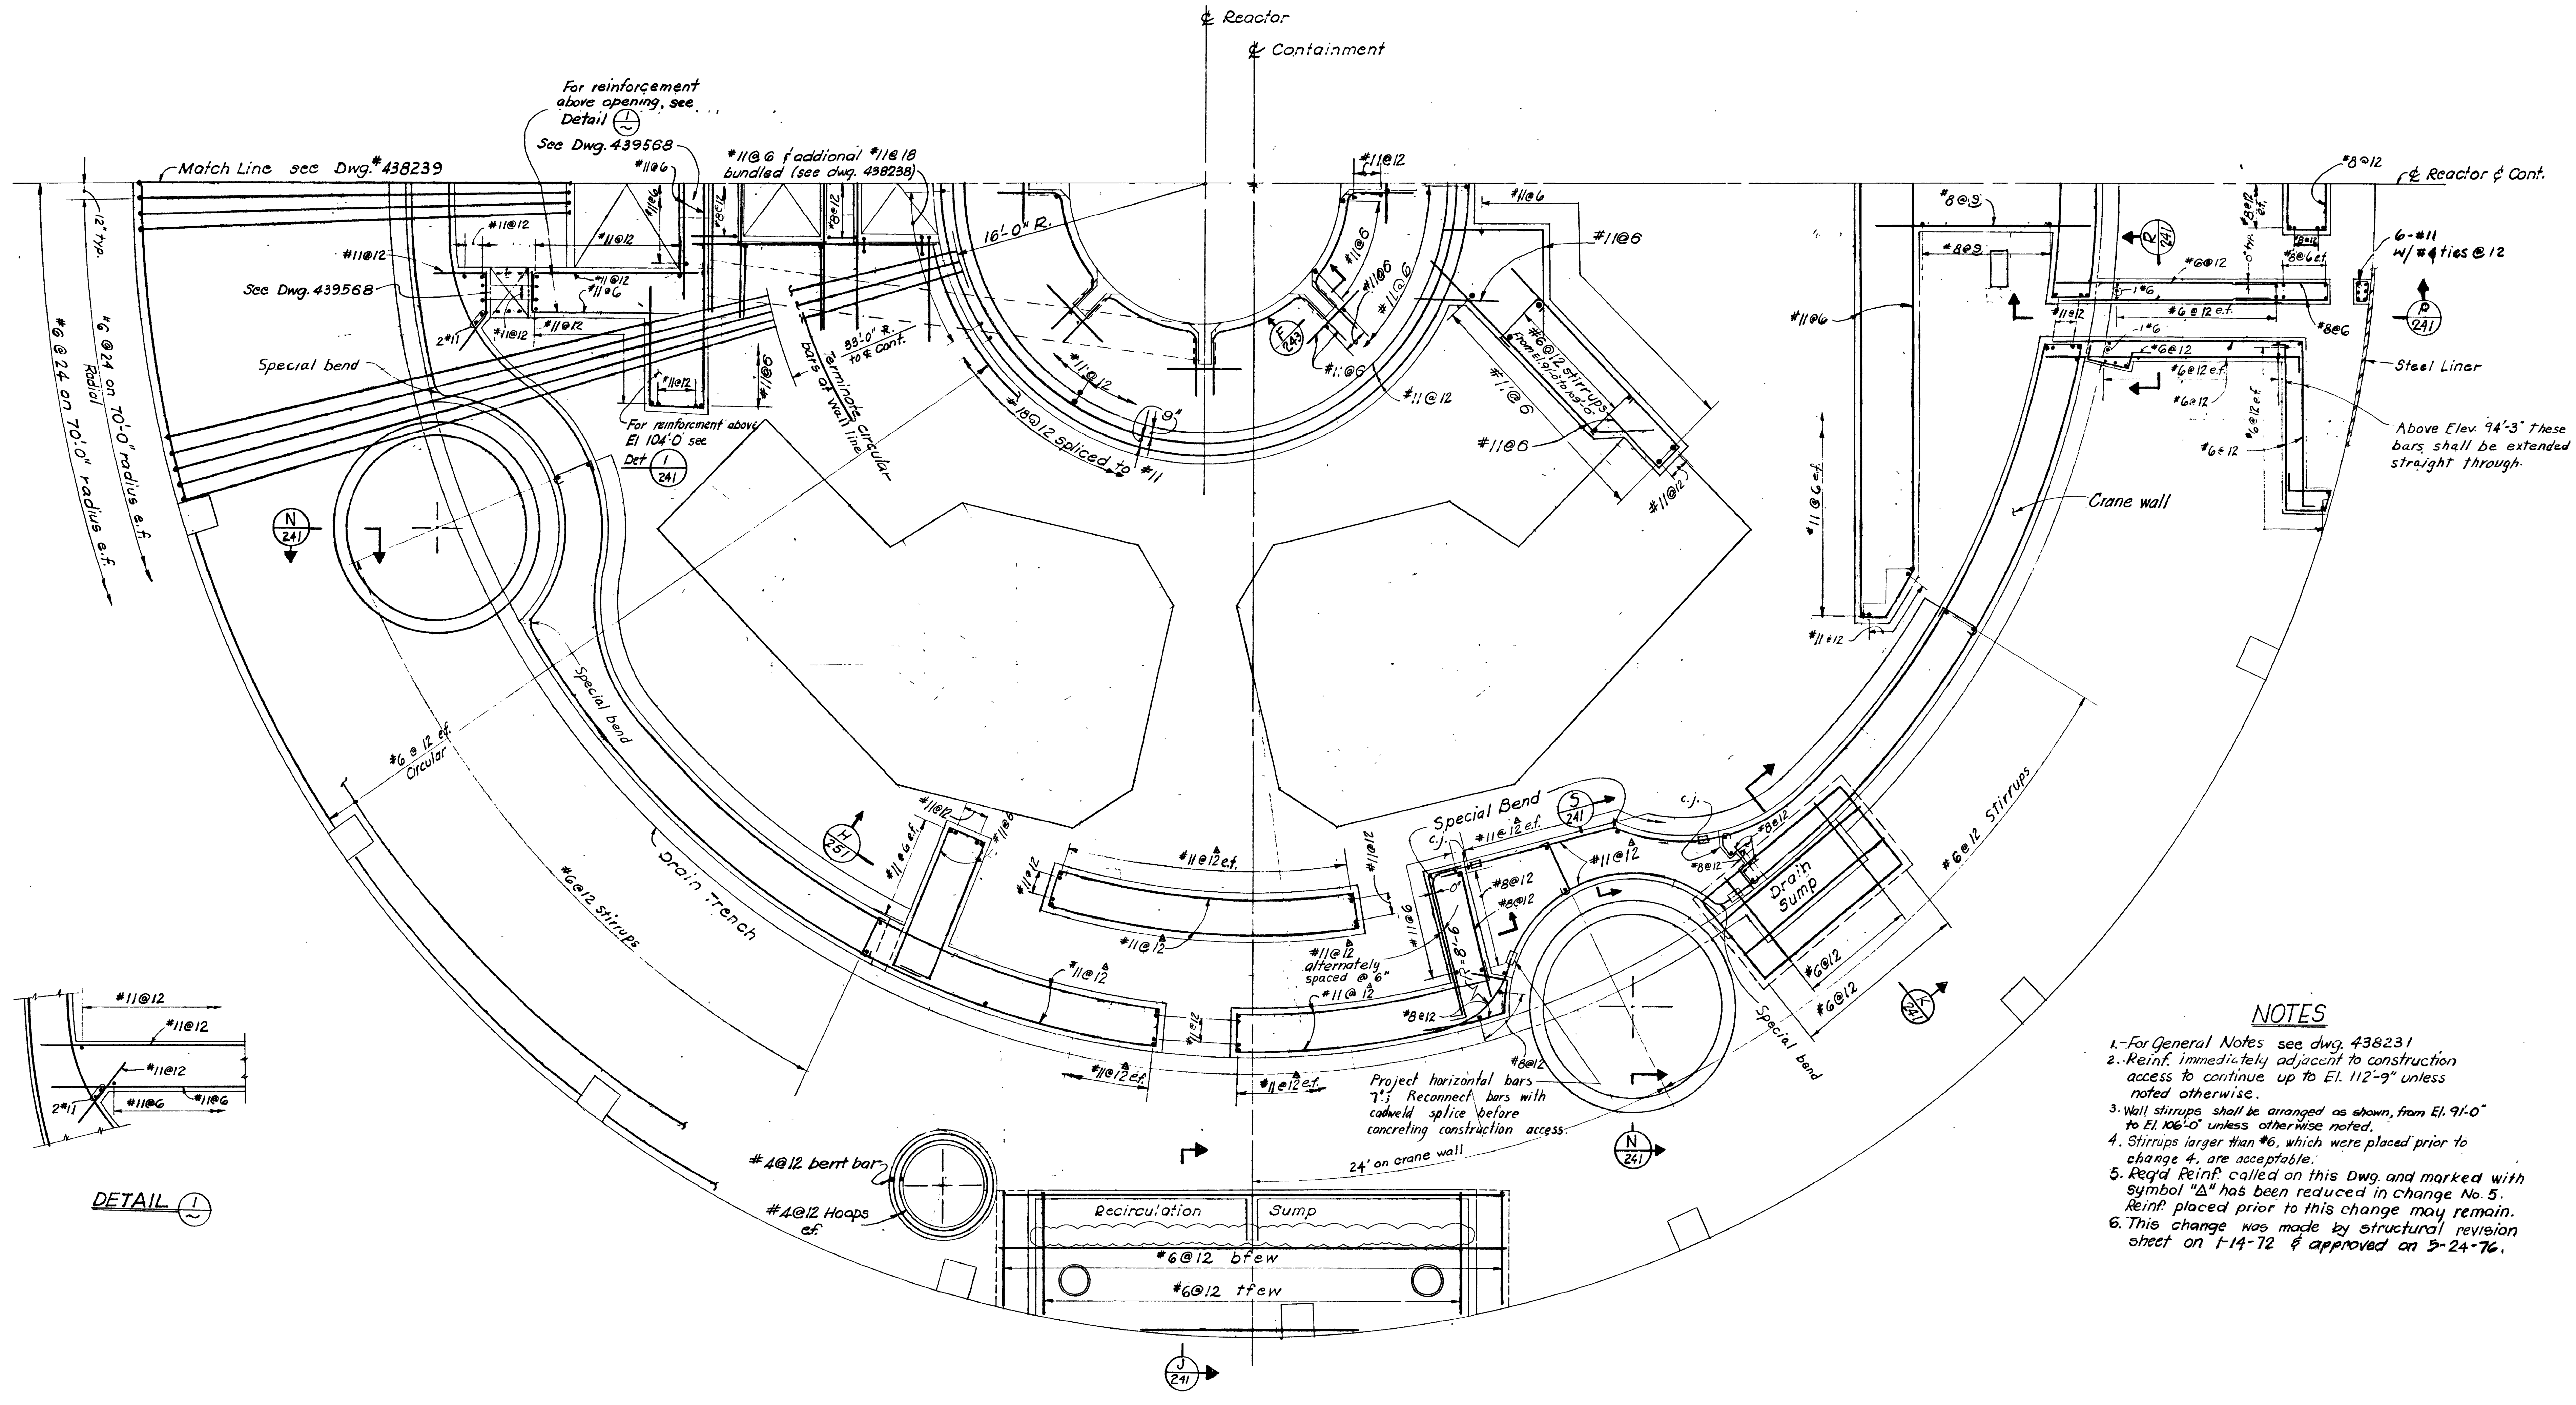


PLAN AT EL. 91'-0"

NOTES

1. For General Notes see dwg. 438231
2. Reinf. immediately adjacent to construction access to continue up to El. 112'-9" unless noted otherwise.
3. Wall stirrups shall be arranged as shown, from El. 91'-0" to El. 106'-0" unless otherwise noted.
4. Stirrups larger than #6, which were placed prior to change 4, are acceptable.
5. Reqd. Reinf. called on this Dwg. and marked with symbol "Δ" has been reduced in change No. 5. Reinf. placed prior to this change may remain.
6. This change was made by structural revision sheet on 1-14-72 & approved on 5-24-76.

DETAIL 1

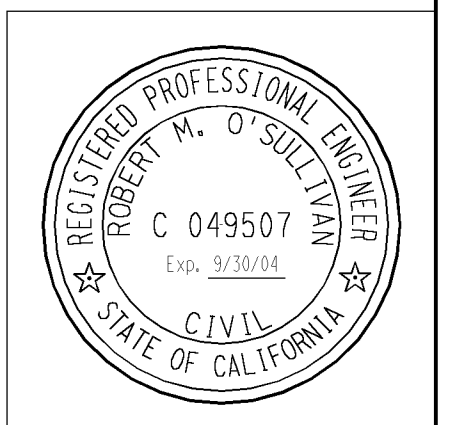

DATE	DESCRIPTION	COORDINATION
11/27/00	Revised per DCI-SC-049510-00	NUCL. - MECH. - ELEC. - CIVIL - PIPING - I&C -
DWN.	PMH2	
R.E.	SXM9	
INDEP. VERIFIER	RM02	
P.E.	RM02	

UNIT 1
CIVIL
INTERIOR CONCRETE REINFORCING
SLAB AT EL. 91'-0" - SOUTH
CONTAINMENT STRUCTURE - AREA "G"
PACIFIC GAS AND ELECTRIC COMPANY
SAN FRANCISCO, CALIFORNIA

DWG SCALE	REV 7
BILL OF MATL.	
SUPDS BY	
SHEET NO. 1 OF	
438240	