


NOTES CONT: 7. CODE CLASS E PORTION OF LINE 4145 SHALL BE SEISMICALLY ANALYZED TO DESIGN CLASS I CRITERIA (102-E)

8. DRAIN W/ QUICK-DISCONNECT COUPLING W/ INTEGRAL CHECK VALVE FOR EMERGENCY TIE-IN TO FIRE PROTECTION SYSTEM (102018-5A). COUPLING TO BE REMOVED WHEN DRAINING IS REQUIRED.

9. DRAIN W/ QUICK-DISCONNECT COUPLING W/ INTEGRAL CHECK VALVE. DRAIN HOSE TO BE ATTACHED FOR ROUTING FLOW TO FLOOR DRAINS WHEN FPS TIE-IN (NOTE 8) IS OPERATIONAL COUPLING TO BE REMOVED WHEN DRAINING IS REQUIRED.

10. THE INSTRUMENT AIR TO FCV-366 AND TCV-28 HAS BEEN ISOLATED BOTH VALVES ARE FULLY OPEN. (106-B)

11. VALVE - S/C 99-6459 (105-C)

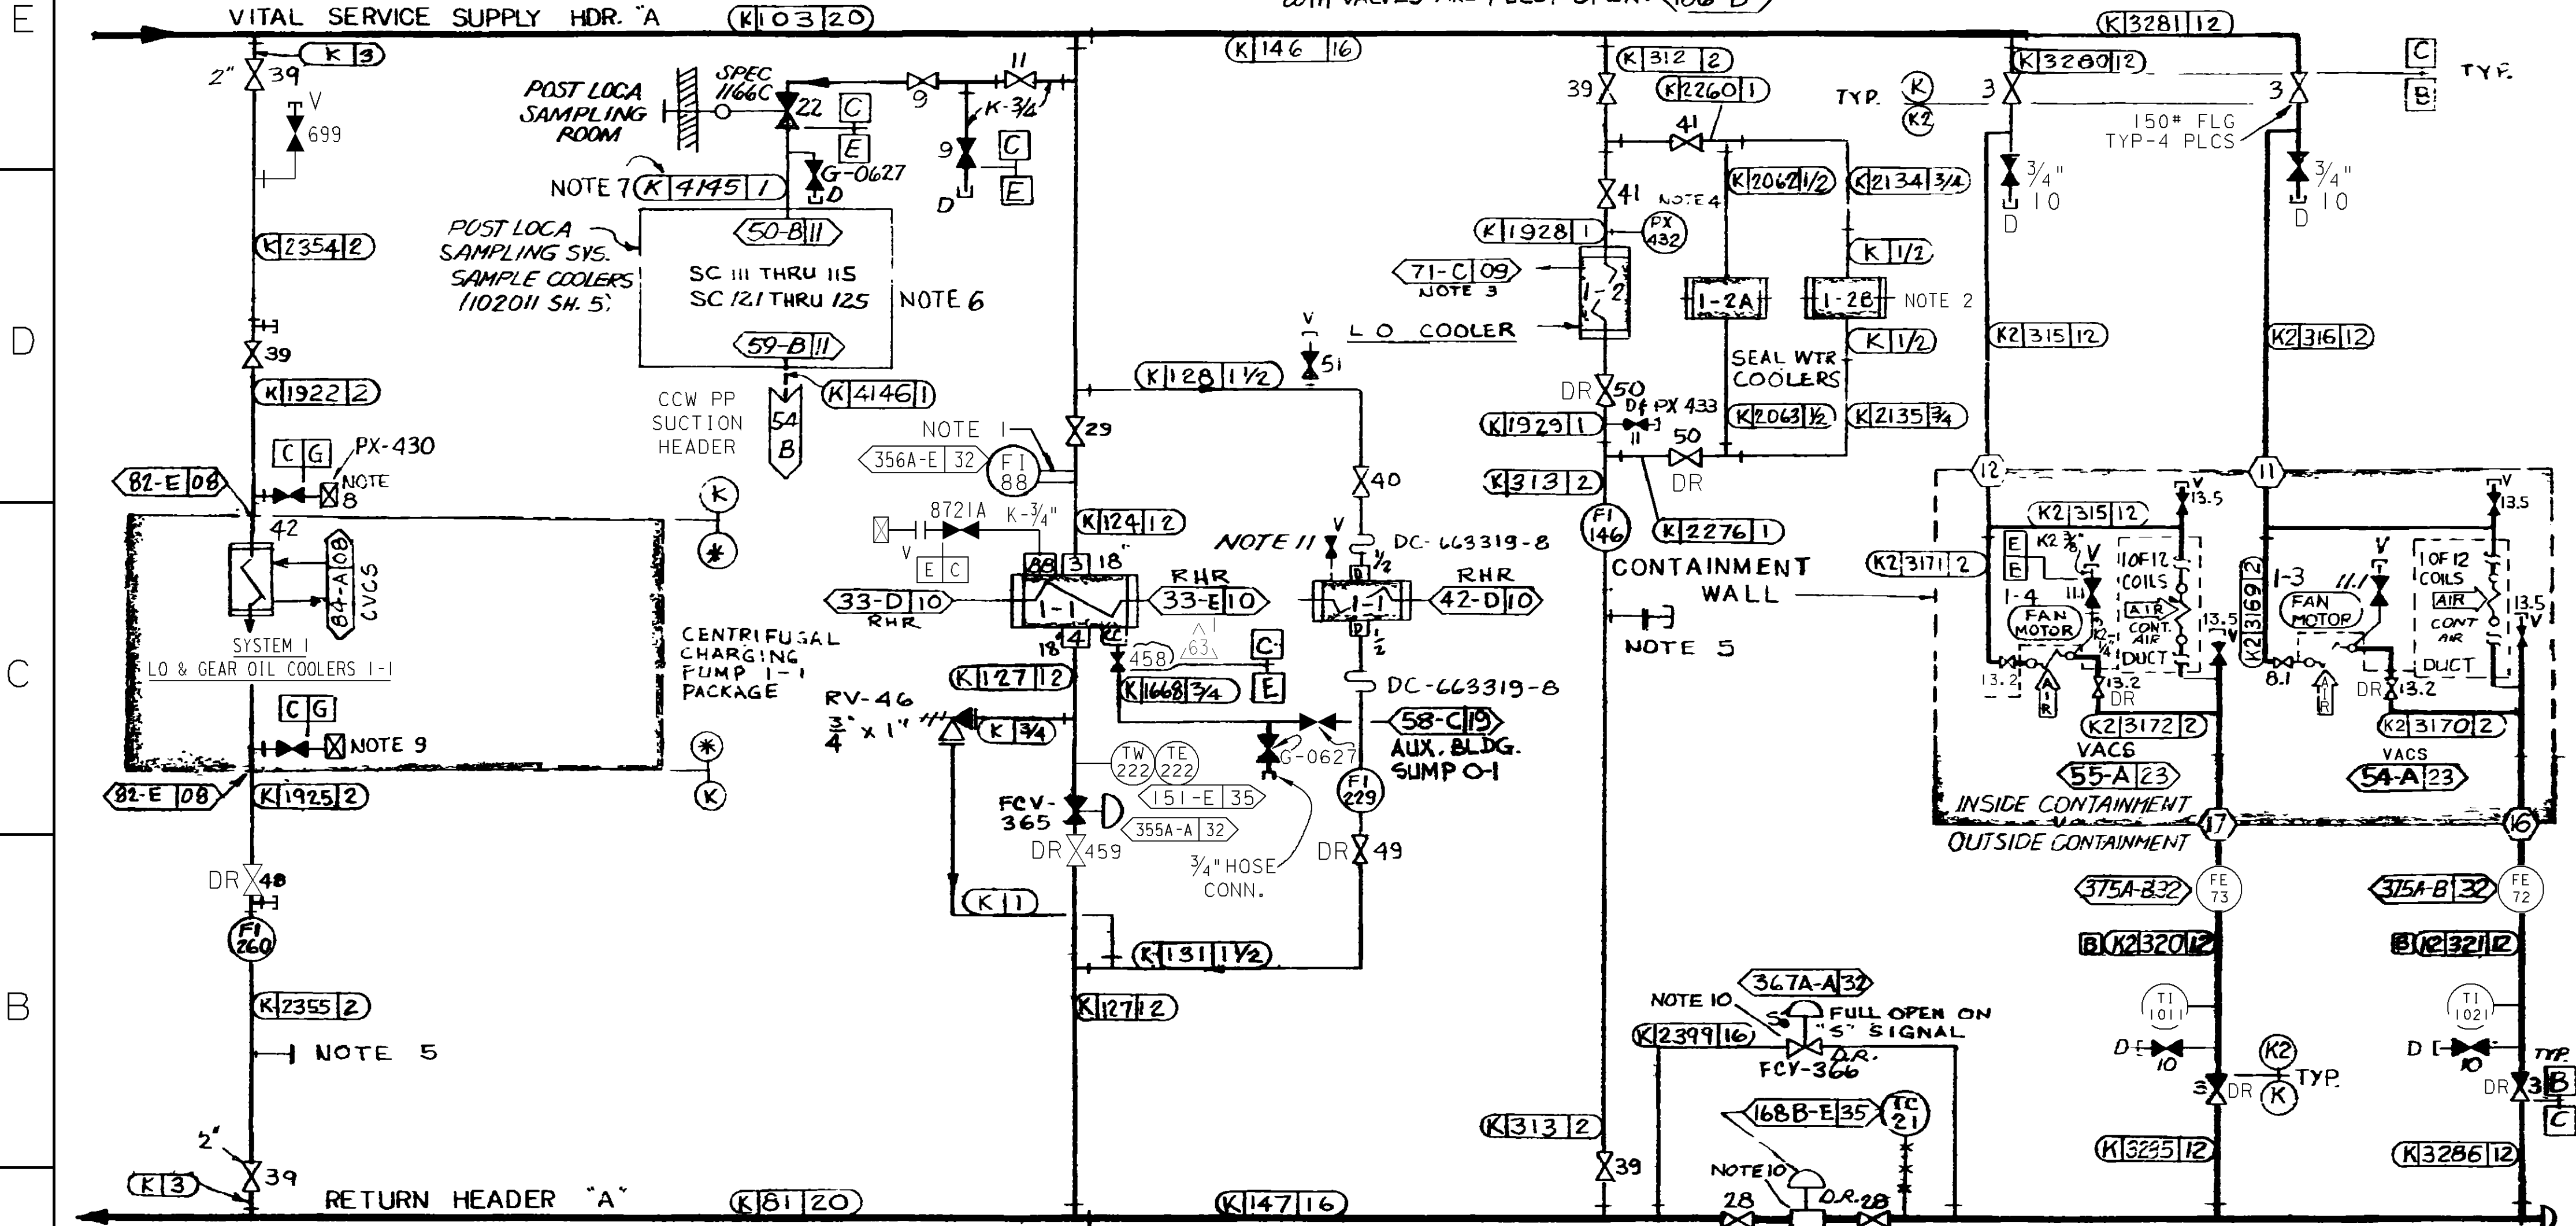

CENTRIFUGAL CHARGING PP 1-1 DC-663210-40, 47, 48, 49, 50

RESIDUAL HEAT EXCHANGER 1-1 DC-663217-4

RHR PP H SEAL WTR. CLR DC-663217-9, 16

SAFETY INJECTION PUMP 1-2 DC-663216-26, 32

REACTOR CONTAINMENT FAN COOLERS DC-863079-2 5 FAN COILS - FAN MOTORS H.X.

- NOTES:
- 1 ELBOW TAPS FOR FLOW INDICATION (104-D)
 - 2 REFER TO SIS PP SEAL FLUSH SYSTEM DIAGRAM, PG#E RECORD NO DC-663216-27 (107-D)
 3. REFER TO SIS PP LUBE OIL COOLER SYSTEM MFR. DWG PG#E RECORD NO DC-663216-26 (105-D)

HEADER "A" COMPONENTS

4. PX'S TO BE LOCATED WITHIN 1' OF H.X. (106-E)
5. 2" BLIND FLANGE SEE NOTES 2 & 3 SH.5A (100-B)
6. POST LOCA SAMPLE COOLERS ARE DESIGN CLASS II & SEISMICALLY ANALYZED PER DESIGN CRITERIA MEMORANDUM M-45 (103-D)

(SEE COORD 100-E FOR NOTES CONT.)

UNIT 1

DIABLO CANYON POWER PLANT - PG&E CO.
COMPONENT COOLING WATER SYSTEM

DRAWING	SHEET	PAGE	REV
102014	10	0	63

RASTER=erui7616.dgn
 DGN=erui7616.dgn
 CAD User: ZNS4 Date: 12-15-2015

INPGIC 1 Size	12-15-2015	ZNS4	Fxc2	N/A	NOT REQUIRED PER CF3.ID5	-	-	-	REVISED PER DFT-7*3381
	DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	