

A

B

C

D


A

B

C

D

E

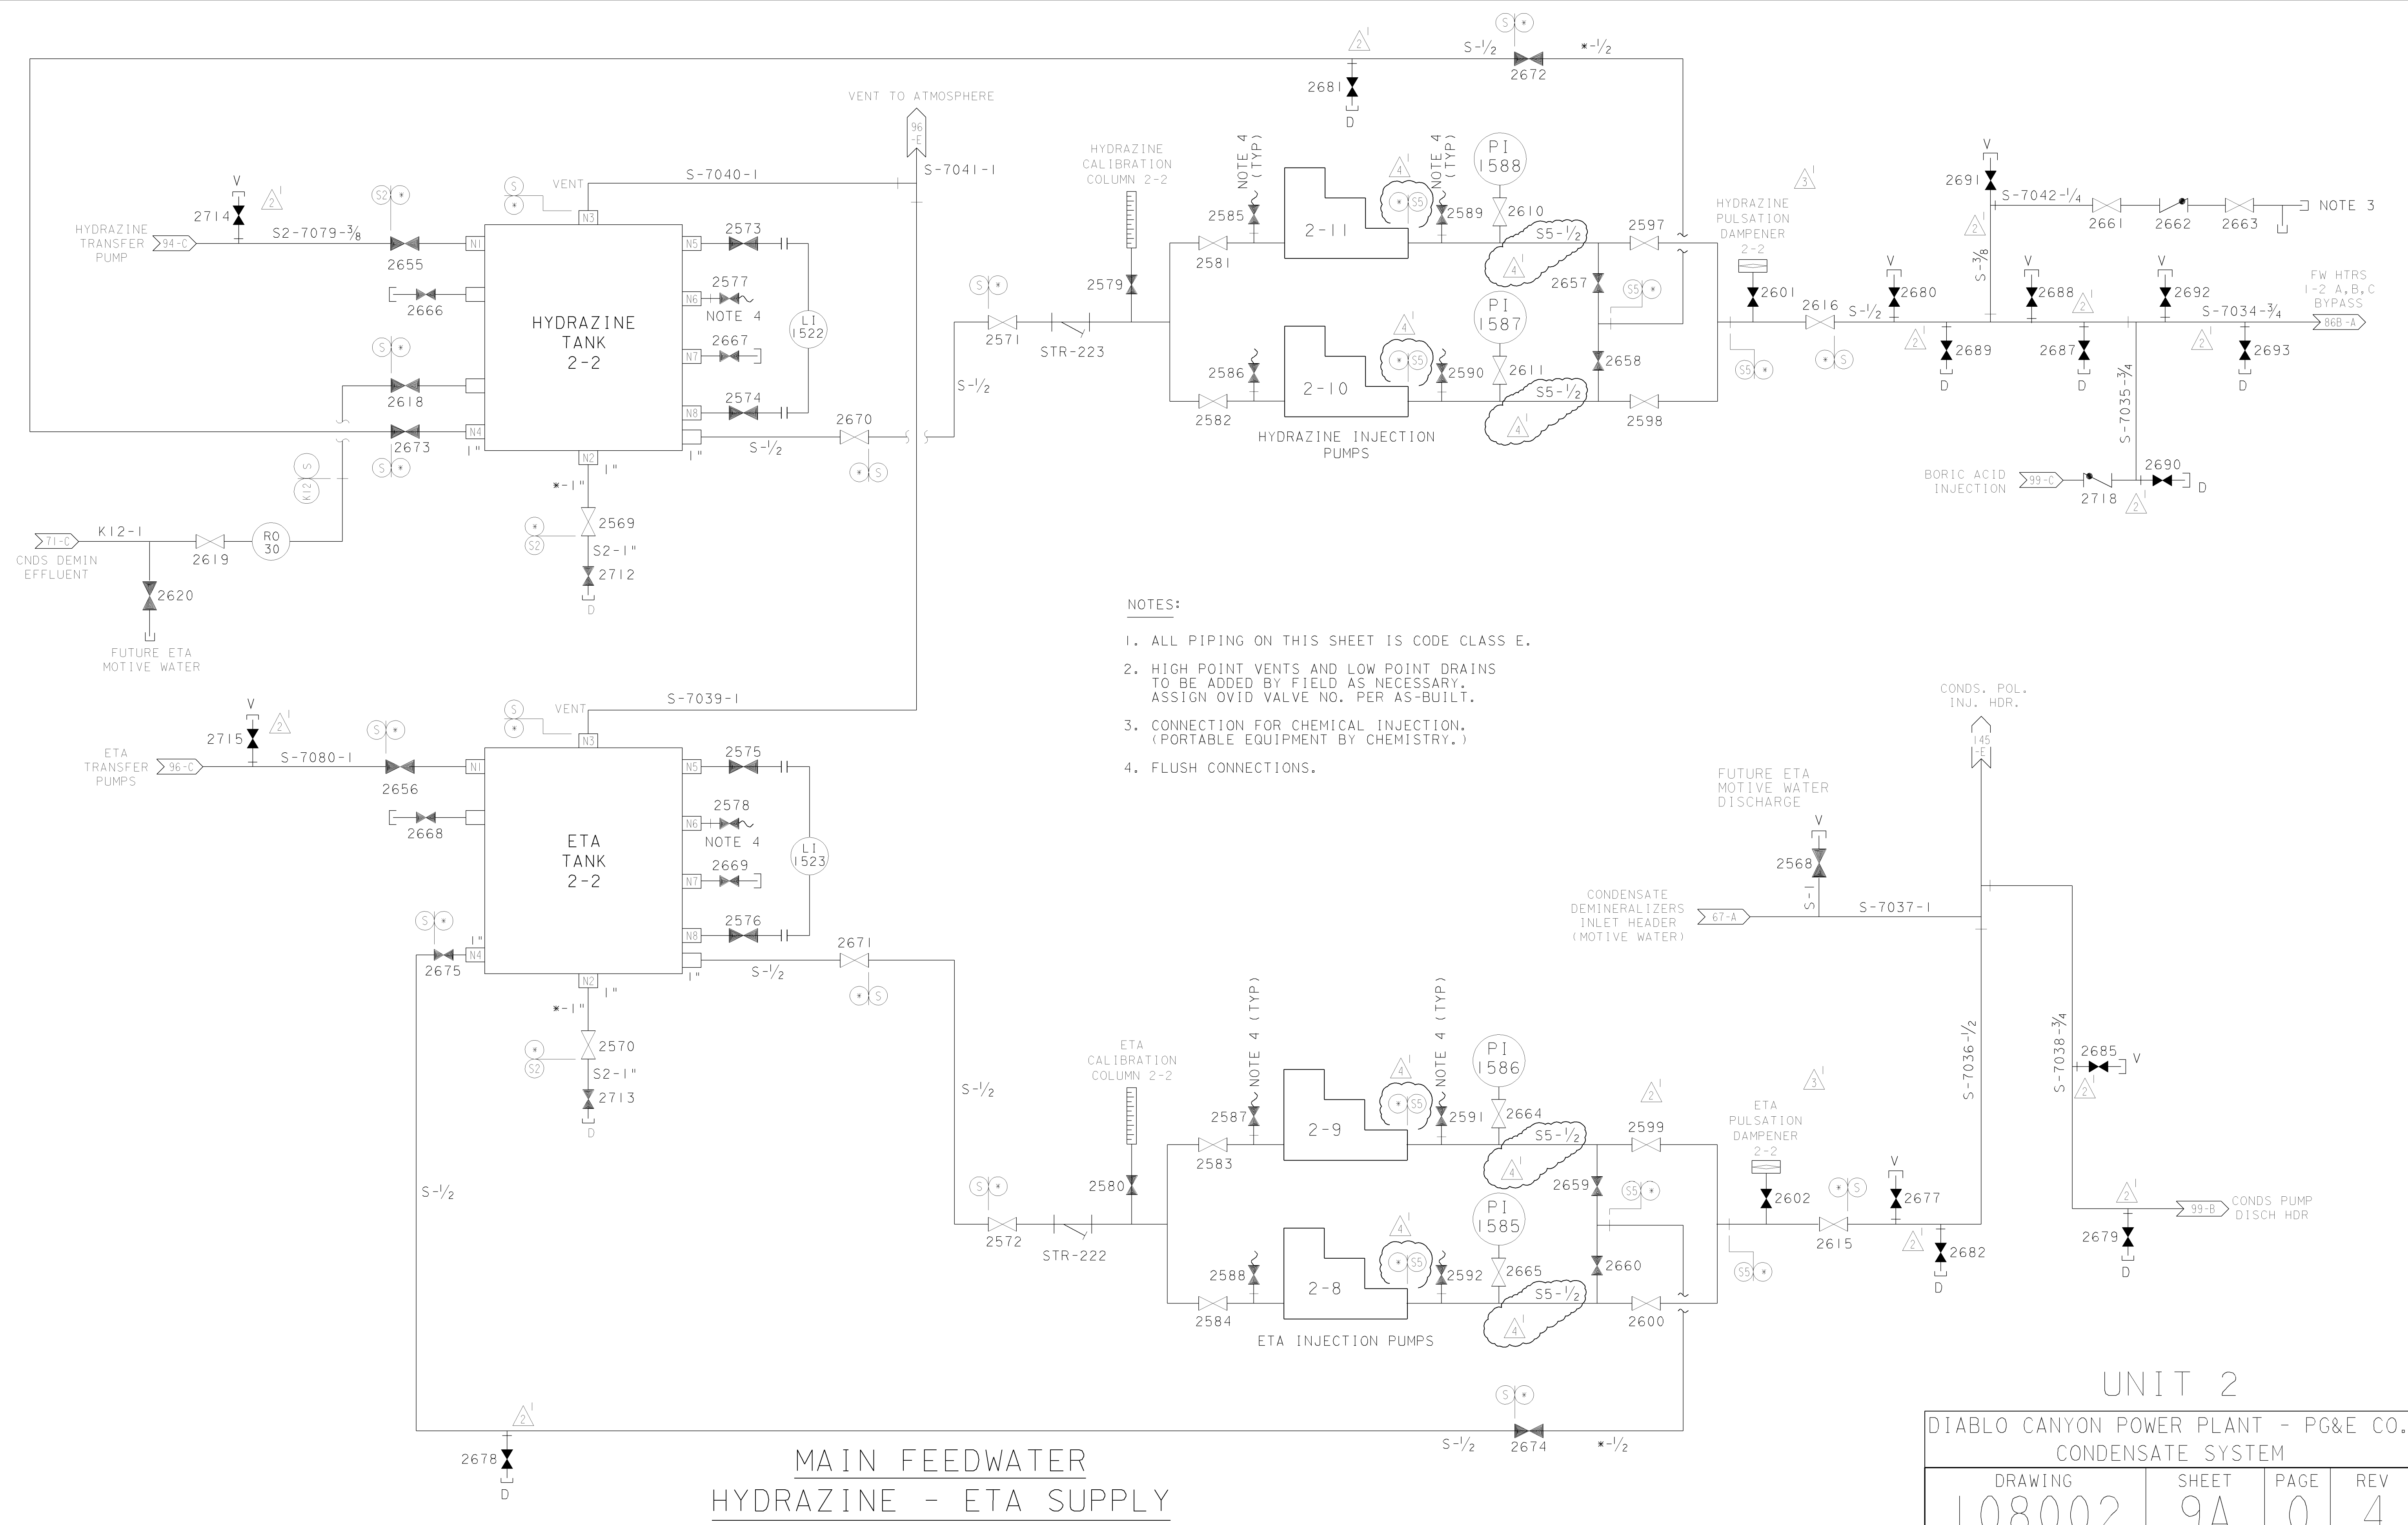

- NOTES:
1. ALL PIPING ON THIS SHEET IS CODE CLASS E.
 2. HIGH POINT VENTS AND LOW POINT DRAINS TO BE ADDED BY FIELD AS NECESSARY. ASSIGN OVID VALVE NO. PER AS-BUILT.
 3. CONNECTION FOR CHEMICAL INJECTION. (PORTABLE EQUIPMENT BY CHEMISTRY.)
 4. FLUSH CONNECTIONS.

MAIN FEEDWATER
HYDRAZINE - ETA SUPPLY

UNIT 2

DIABLO CANYON POWER PLANT - PG&E CO.
CONDENSATE SYSTEM

DRAWING	SHEET	PAGE	REV
108002	9A	0	4

RASTER=108002.s9A.DGN
 DGN=108002.s9A.DGN
 CAD User: AJL2 Date: 08-22-2006

08-22-2006	AJL2	RMDI		KERSI J. DALAL	MECHANICAL	M 16690	3/31/2008	REVISED PER FCT-031676
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	