

110

111

112

113

114

115

116

117


118

119

MAIN CONDENSER TUBE SHEET SALT WATER LEAK DETECTION SYSTEM

NOTES:

1. ALL PIPING SHOWN ON THIS SHEET SHALL BE PG&E CODE CLASS E
2. ALL ANALYZER SENSORS (CEL) SHALL BE INSTALLED AS CLOSE AS POSSIBLE TO INSTRUMENT SUPPLY PUMPS.
3. THE WORD "TYPICAL" AS USED ON THIS SHEET DENOTES VALVES, PIPING, ETC. WITH THE SAME SPECIFICATION AND FUNCTION.
4. FOR CONDENSER TRAY CONNECTIONS, SEE DC-663041-13. 116-D
5. 1/2" - WHITEY SS 45F8. 110,119-B,D
6. GARLOCK STYLE 204 DOUBLE ARCH EXPANSION JOINT. 115-A
7. 3/8" WHITEY SS 4456 (TYP 4). 111,118-B,D

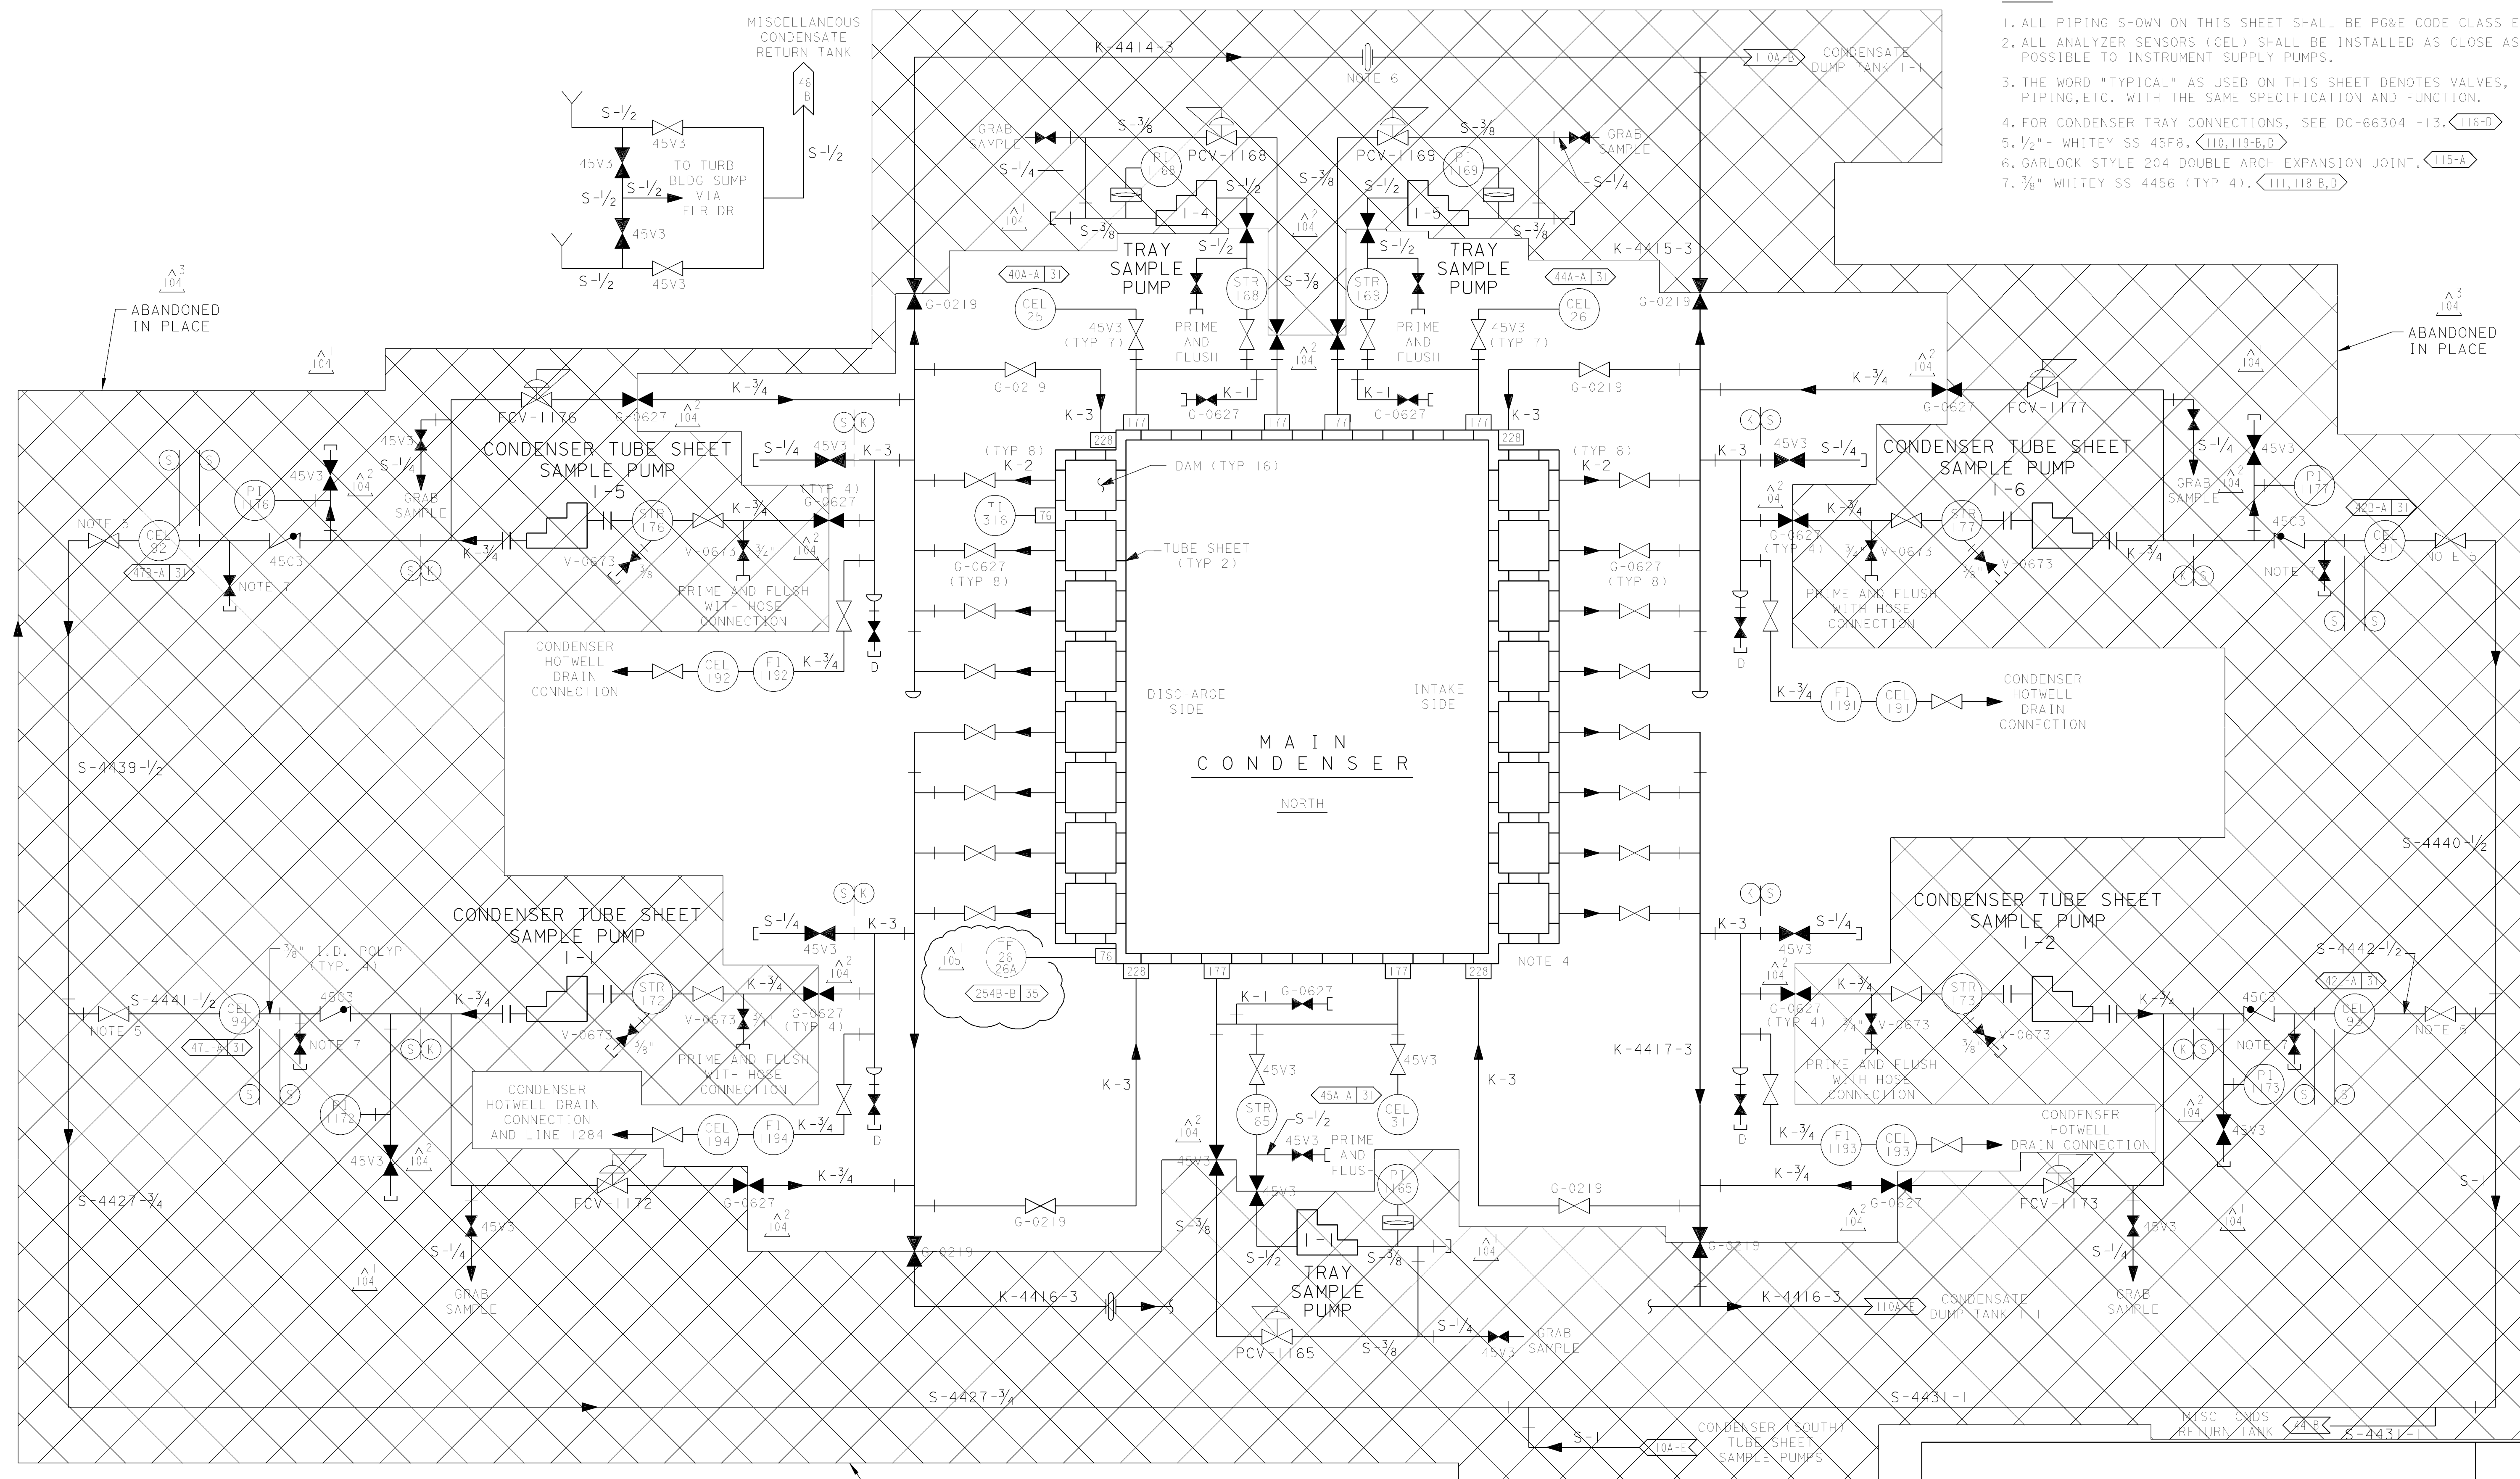

UNIT-1

P G & E CO.

SHEET 11 PAGE 0

102002

REV. 105

5/5/05	AJL2	FXC2	-	KERSI J. DALAL	MECHANICAL	M 16690	3/31/2006	Revised per FCT 030067
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	