




RHR TEMPERATURES

E12-R601

YOKOGAWA 

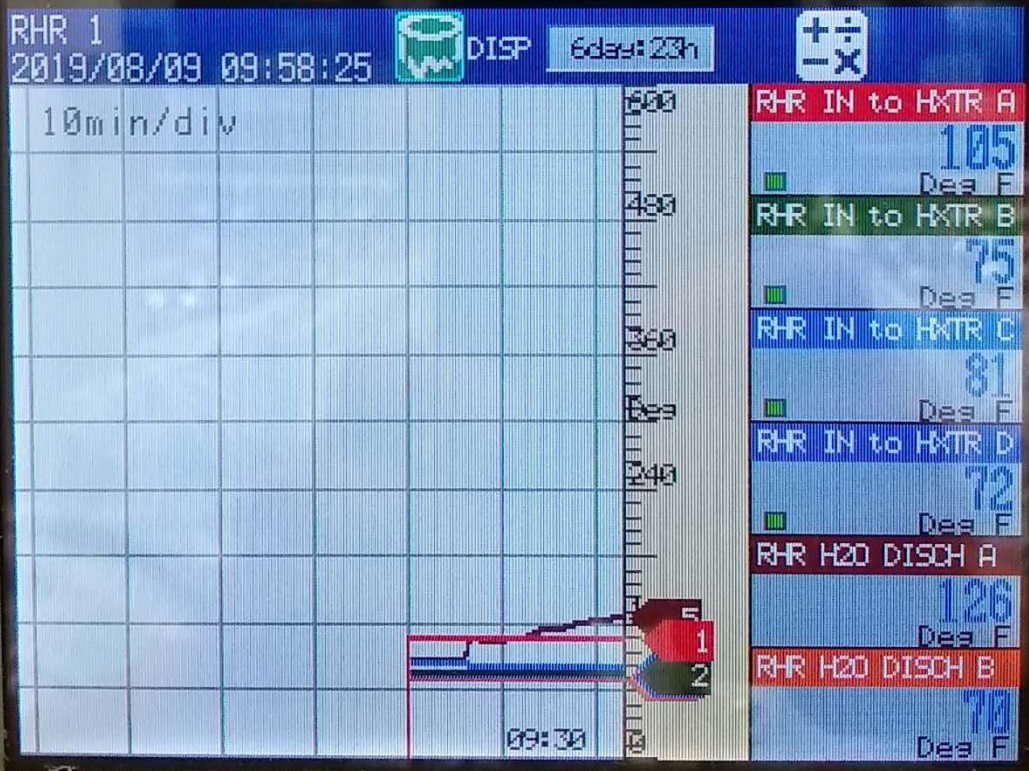

1	5	9
2	6	10
3	7	11
4	8	12

DISP/ENTER


PERRY NUCLEAR POWER PLANT		Procedure Number: SVI-D23-T1213	
Title: Suppression Pool Average Temperature		Use Category: Step-by-Step	
		Revision: 9	Page: 9 of 11

ATTACHMENT 1: SUPPRESSION POOL TEMPERATURE DATA SHEET
Page 1 of 1

DATE/ TIME	ICS USED		S.P. AVG TEMP °F	EOP-02 ACTIVE		THERMAL POWER %	MODE SWITCH POSITION	INITIALS
	YES	NO		YES	NO			
Today 1000	X		76		X			RXO
Today 1005	X		76		X			RXO
Today 1010	X		77		X			RXO
Today 1015	X		78		X			RXO
Today 1020	X		79		X			RXO
Today 1025	X		80		X			RXO
Today 1030	X		81		X			RXO
Today 1035	X		82		X			RXO
Today 1040	X		83		X			RXO
Today 1045	X		84		X			RXO
Today 1050	X		85		X			RXO

Comments: _____

Performed By: Rob X. Opter / RXO / Today
 _____ / _____ / _____
 _____ / _____ / _____
 Signature Initials Date

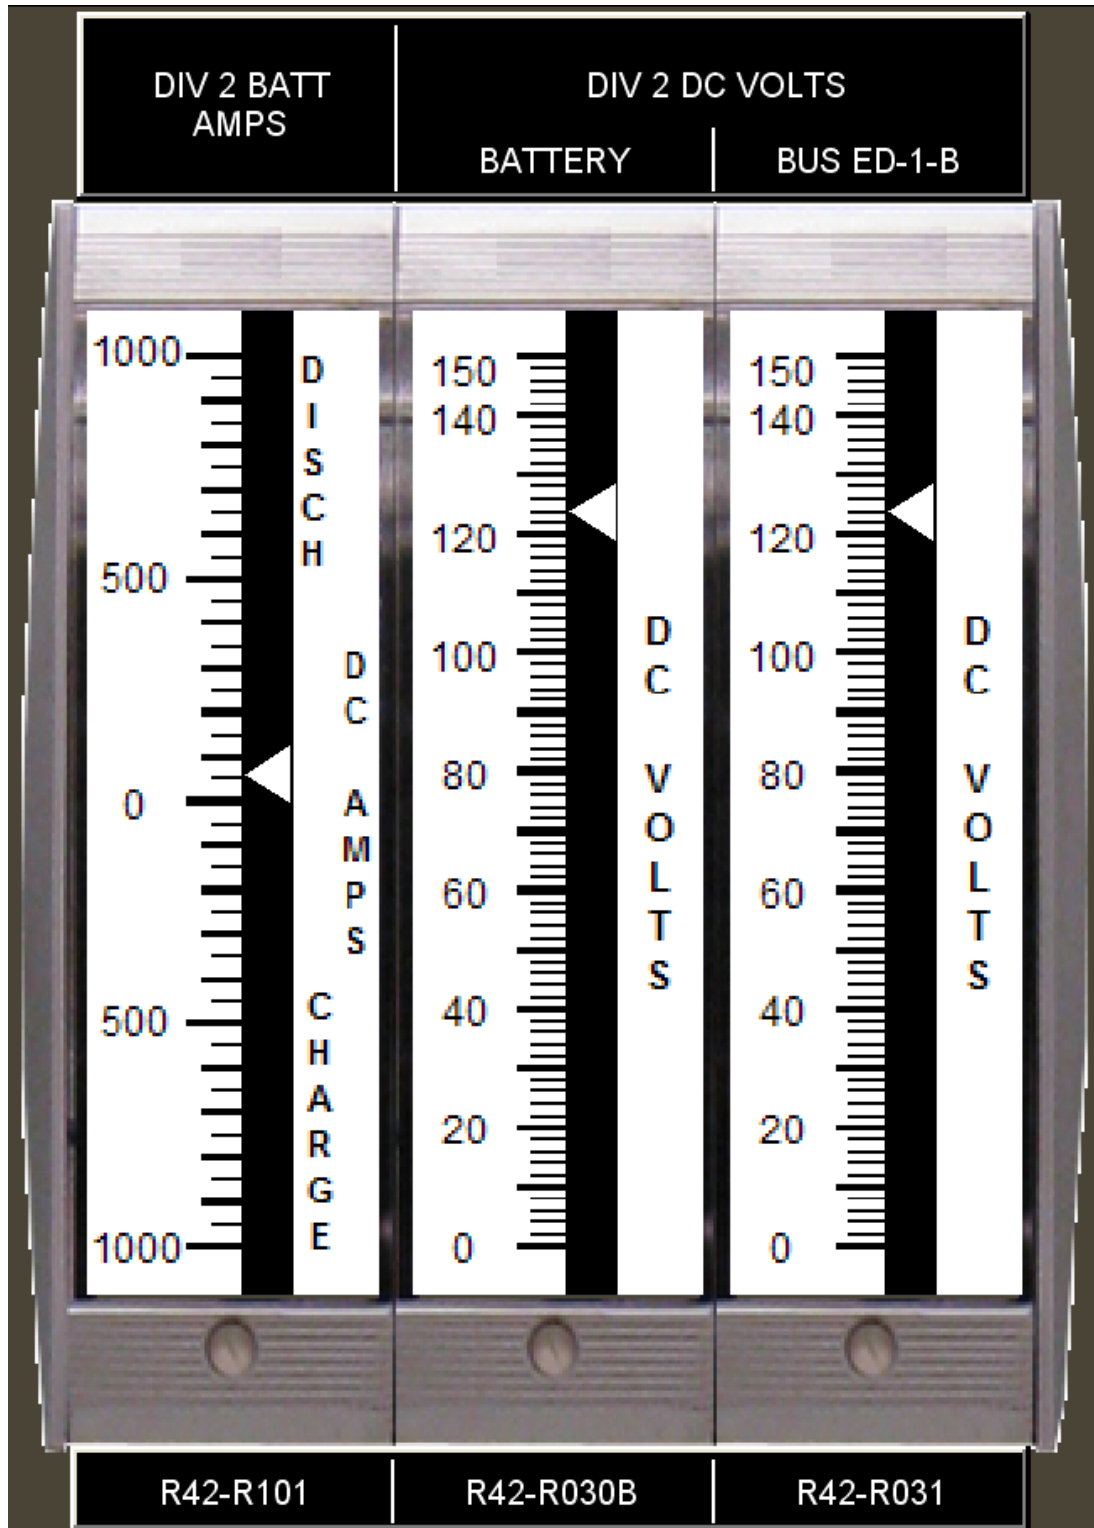

Partial panel picture of H13-P877