


BY A.C. DATE _____
CHKD. BY DATE _____

SUBJECT NEBRASKA PUBLIC POWER DISTRICT SHEET NO. _____ OF _____
COOPER NUCLEAR STATION JOB NO. 2520-02
AREA TEMP. MONITORING SYSTEM FOR NUCLEAR BOILER SYSTEMS LEAK DETECTIONS

REV. No. 7

IL-E-70-3 SHT. NO. 107 B
DWG. NO. ID-105 SH. 3 A

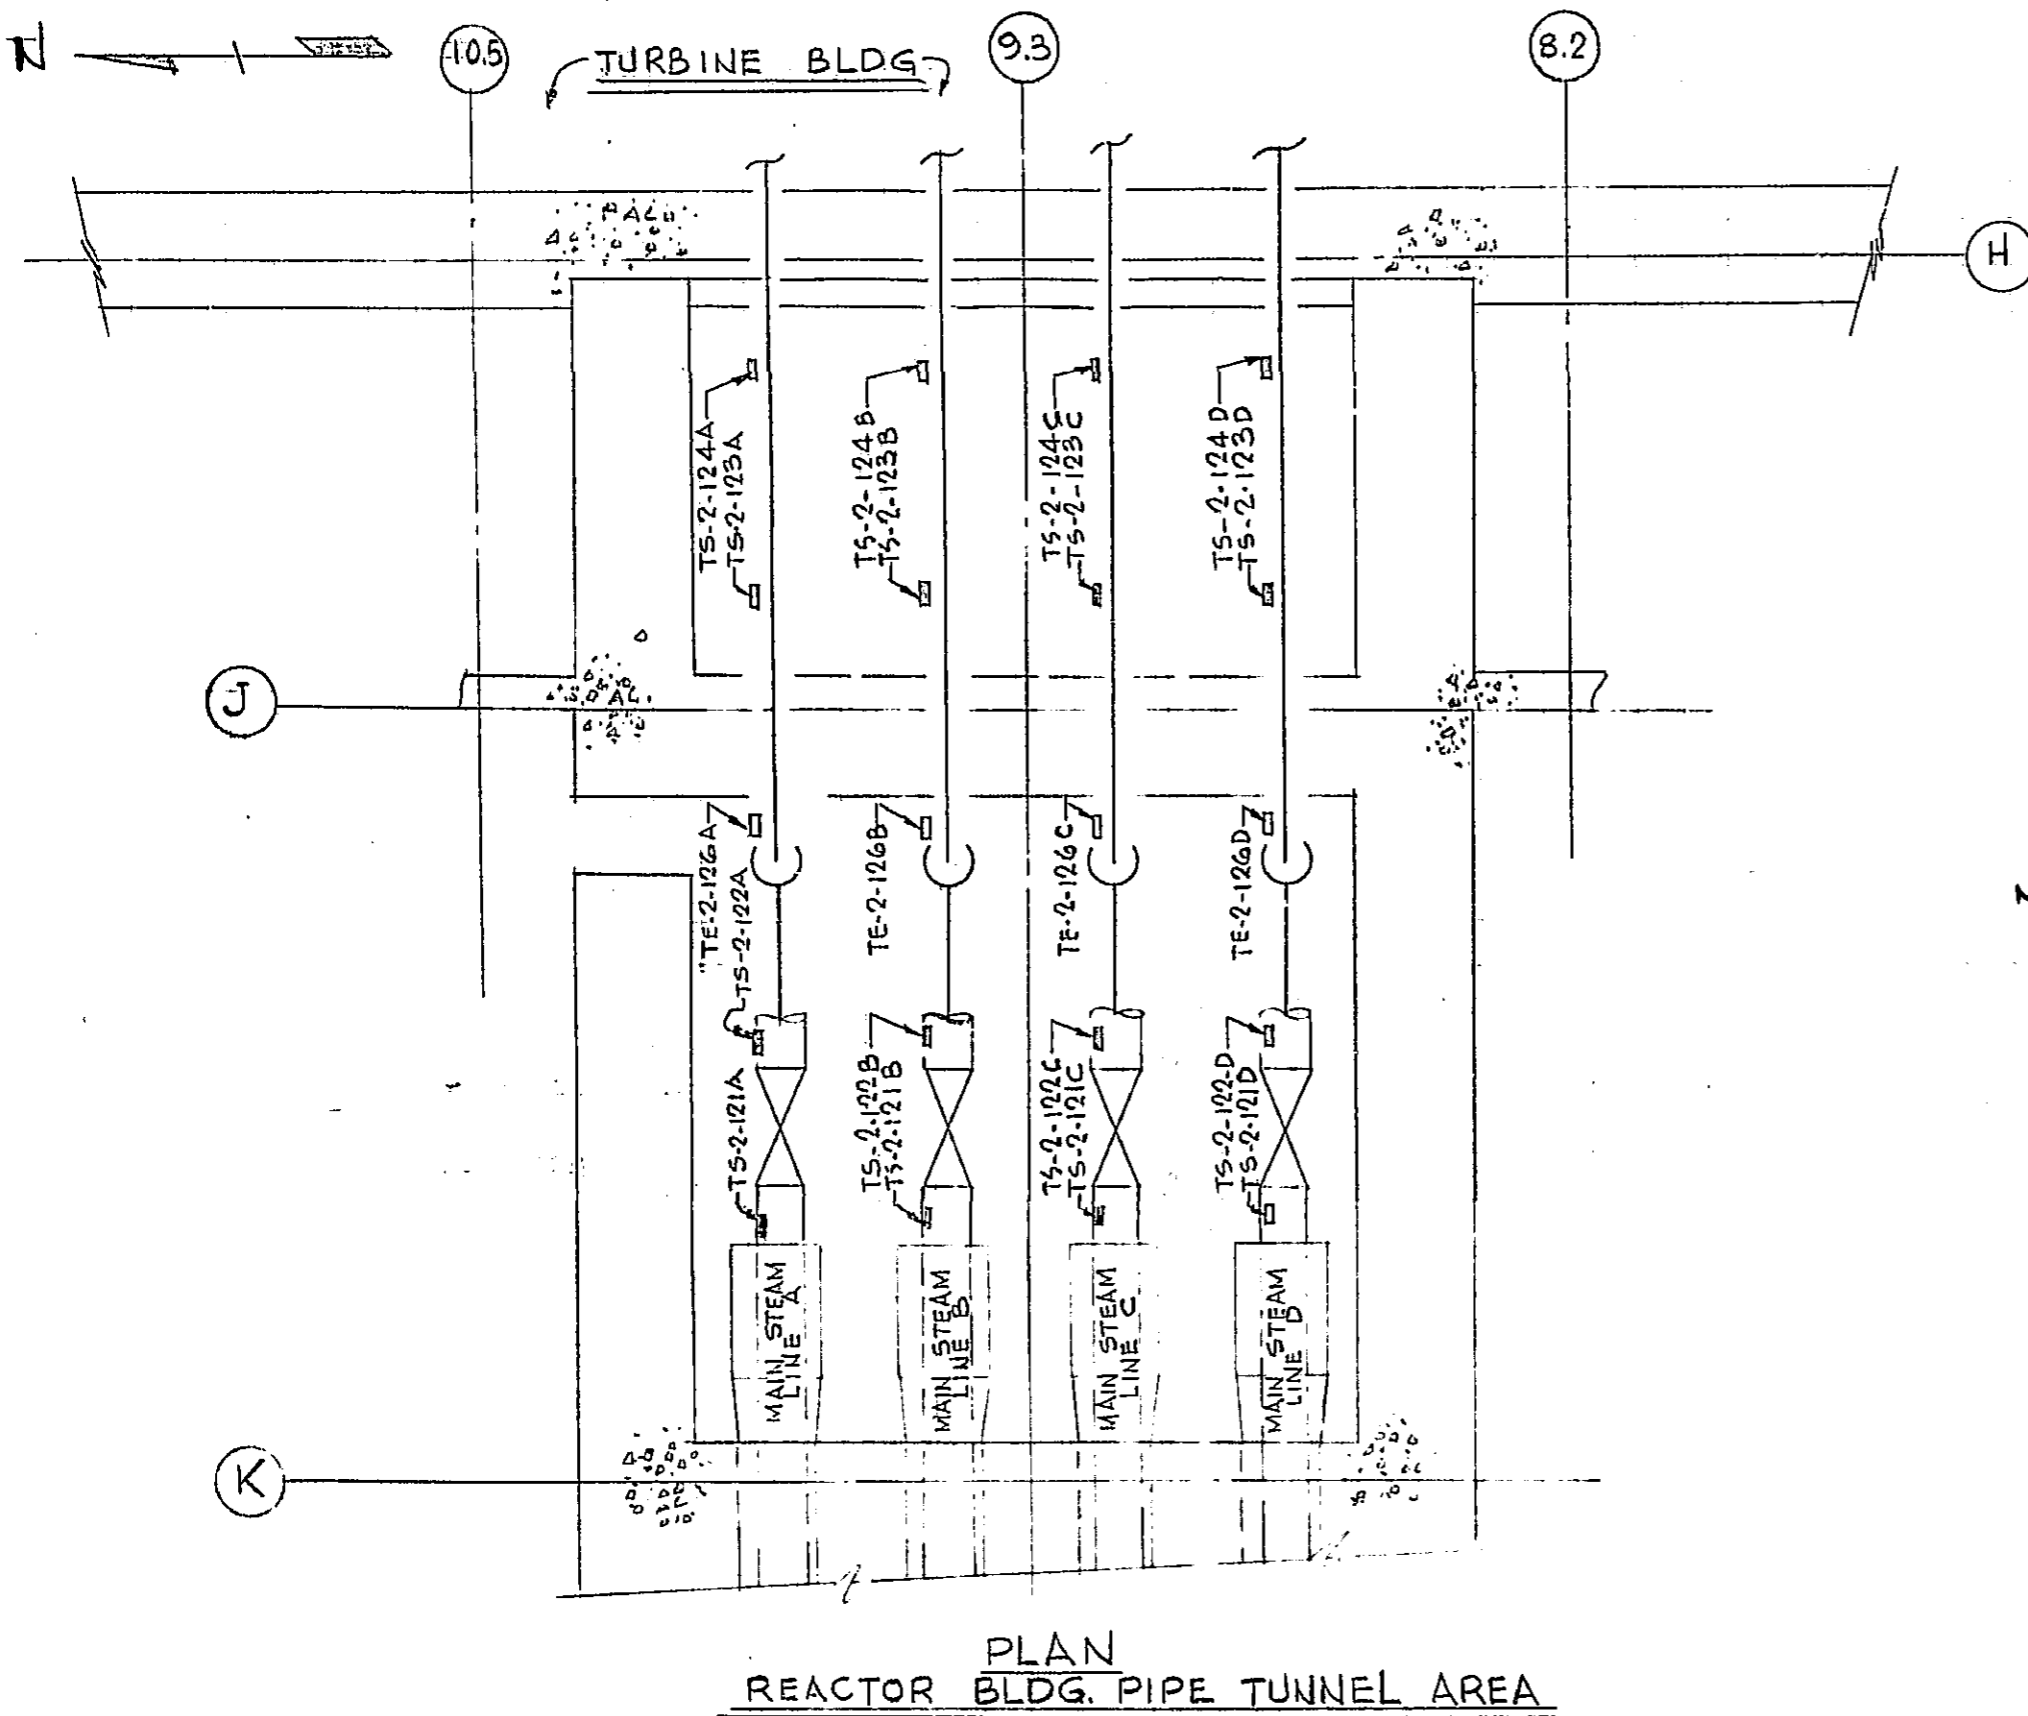

MAIN STEAM SYSTEM LEAK DETECTION

NOTE:

FIELD TO LOCATE TEMP. ELEMENTS AND SWITCHES ABOVE PIPING APPROX. AS SHOWN AND TO CLEAR ALL OBSTRUCTIONS.
FOR MOUNTING DETAILS OF TE-2-126 SEE G.E. DWG. 145C3018
FOR MOUNTING DETAILS OF TS-2-121 THRU-124 SEE DWG. NO. ID-105 SH. 2

T30-0877

RECEIVED
FILMED

N.P.D., D.C.C

S/N 1800