



BY KML DATE
CHKD. BY DATE

SUBJECT NEBRASKA PUBLIC POWER DISTRICT
COOPER NUCLEAR STATION
INSTALLATION DETAILS - TEMPERATURE DETECTORS FOR NUCLEAR BOILER SYSTEMS LEAK DETECTION

SHEET NO. OF
JOB NO. 2520-02

REV. No. 1

IL-E-70-3 SHT. No. 107 F
DWG. NO. I.D.-105 SHEET-7

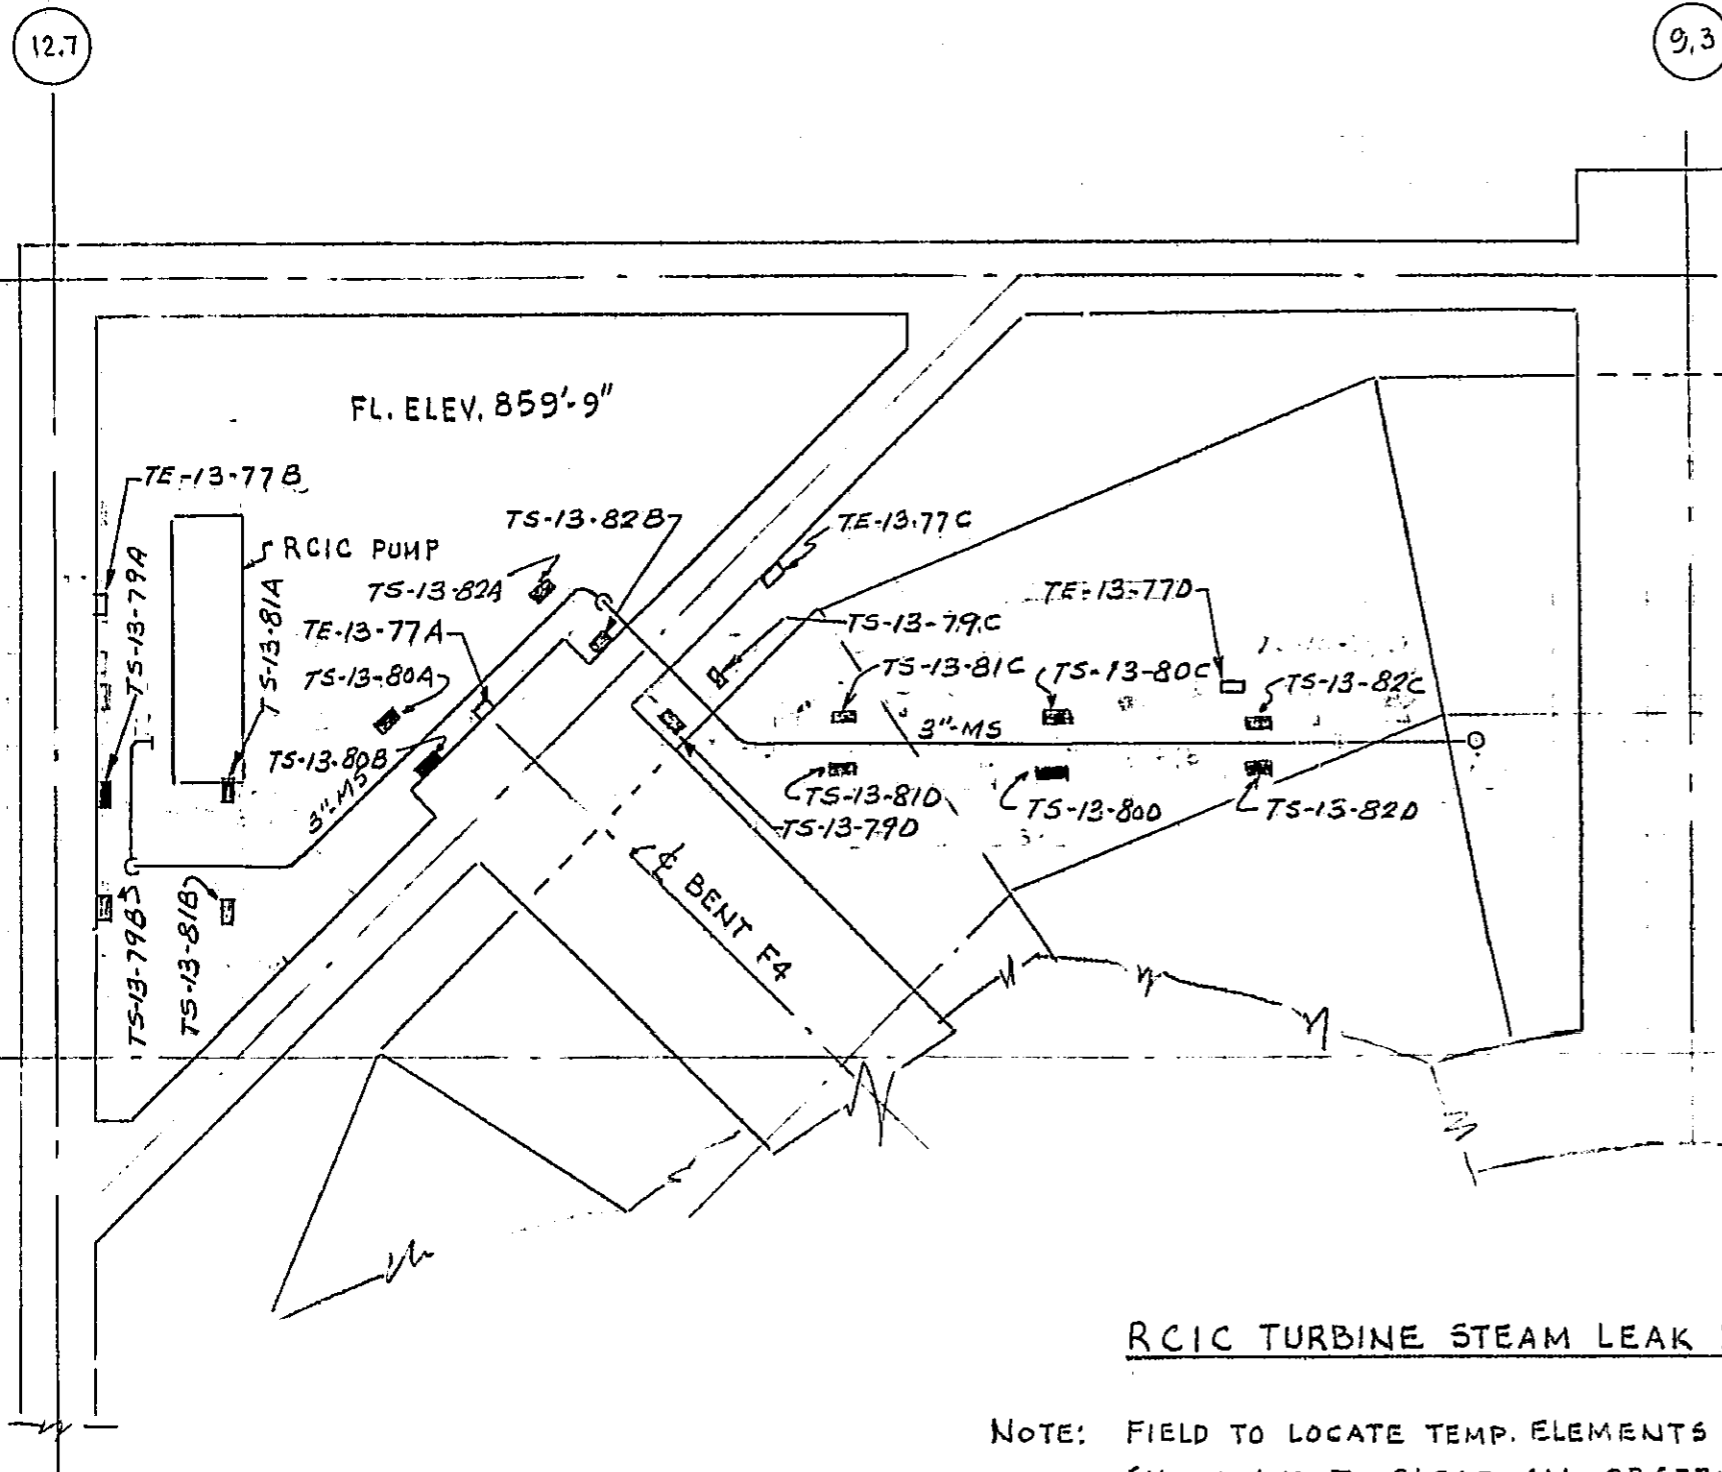

T30-0877
RECEIVED
FILMED
N.P.P.D.; D.C.C
S/N 1807

RCIC TURBINE STEAM LEAK DETECTION

NOTE: FIELD TO LOCATE TEMP. ELEMENTS AND SWITCHES ABOVE STEAM PIPING APPROX. AS SHOWN, AND TO CLEAR ALL OBSTRUCTIONS.
FOR MOUNTING DETAILS OF TE-13-77 SEE G.E. DWG. 145C3018
FOR MOUNTING DETAILS OF TS-13-79 THRU 82 SEE DWG. NO. I.D.-105 SHT. 2