

**ATTACHMENT (1)**

---

**ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT FOR THE  
CALVERT CLIFFS NUCLEAR POWER PLANT  
UNITS 1 AND 2  
AND THE INDEPENDENT SPENT FUEL STORAGE INSTALLATION**

---

---

**Calvert Cliffs Nuclear Power Plant**

**May 11, 2023**

**ANNUAL RADIOLOGICAL ENVIRONMENTAL  
OPERATING REPORT  
FOR THE  
CALVERT CLIFFS NUCLEAR POWER PLANT  
UNITS 1 AND 2  
AND THE  
INDEPENDENT SPENT FUEL STORAGE INSTALLATION**

January 1 - December 31, 2022

A. M. Barnett  
D. A. Grimmig

CONSTELLATION NUCLEAR, LLC

MAY 2023

**TABLE OF CONTENTS**

**LIST OF FIGURES** ..... ii

**LIST OF TABLES** ..... iii

**I. SUMMARY** ..... 5

**II. CALVERT CLIFFS NUCLEAR POWER PLANT RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM** ..... 7

**II.A. INTRODUCTION** ..... 7

**II.B. PROGRAM** ..... 7

**II.B.1 Objectives** ..... 7

**II.B.2 Sample Collection** ..... 8

**II.B.3 Data Interpretation** ..... 8

**II.B.4 Program Exceptions** ..... 8

**II.C. RESULTS AND DISCUSSIONS** ..... 8

**II.C.1 Aquatic Environment** ..... 8

**II.C.1.a Bay Water** ..... 8

**II.C.1.b Aquatic Organisms** ..... 9

**II.C.1.c Shoreline Sediment** ..... 9

**II.C.2 Atmospheric Environment** ..... 12

**II.C.2.a Air Particulate Filters** ..... 12

**II.C.2.b Air Iodine** ..... 12

**II.C.3 Terrestrial Environment** ..... 14

**II.C.3.a Vegetation** ..... 14

**II.C.4 Direct Radiation** ..... 14

**II.D. CONCLUSION** ..... 18

**III. INDEPENDENT SPENT FUEL STORAGE INSTALLATION RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM** ..... 24

**III.A. INTRODUCTION** ..... 24

**III.B. PROGRAM** ..... 24

**III.B.1 Objectives** ..... 24

**III.B.2 Sample Collection** ..... 25

**III.B.3 Data Interpretation** ..... 25

**III.C. RESULTS AND DISCUSSIONS** ..... 25

**III.C.1 Atmospheric Environment** ..... 25

**III.C.1.a Air Particulate Filters** ..... 25

**III.C.2 Terrestrial Environment** ..... 26

**III.C.2.a Vegetation** ..... 26

**III.C.2.b Soils** ..... 26

**III.D. CONCLUSION** ..... 28

**IV. REFERENCES** ..... 32

**APPENDIX A Sample Locations for the REMP and the ISFSI** ..... 34

**APPENDIX B Analysis Results for the REMP and the ISFSI** ..... 43

**APPENDIX C Quality Assurance Program** ..... 65

**APPENDIX D Land Use Survey** ..... 90

**APPENDIX E Additional Samples and Analysis Results** ..... 91

**LIST OF FIGURES**

---

Figure	Title	Page
1	Tritium in Chesapeake Bay Water .....	10
2	Silver-110m and Potassium-40 in Chesapeake Bay Oysters .....	11
3	Nuclear Fallout in the Calvert Cliffs Area .....	13
4a	Mean Dosimeter Gamma Dose, Calvert Cliffs Nuclear Power Plant .....	16
4b	2022 Quarterly Dosimeter Gamma Dose, per Location, Calvert Cliffs Nuclear Power Plant .....	17
5	Atmospheric Dispersion Around CCNPP Average Relative Air Concentrations (X/Q)...	20
6	Atmospheric Dispersion Around CCNPP Average Relative Ground Deposition (D/Q) ..	21
7	Mean Dosimeter Gamma Dose, ISFSI.....	29
A-1	Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant .....	37
A-2	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-2 Miles.....	38
A-3	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-10 Miles .....	39
A-4	Independent Spent Fuel Storage Installation Sampling Locations .....	41
A-5	Enlarged Map of the Independent Spent Fuel Storage Installation Sampling Locations ..	42
E-1	Site Map Groundwater Monitoring Wells .....	106
E-2	Site Map Rainwater Locations.....	107

---

**LIST OF TABLES**

Table	Title	Page
1	Synopsis of 2022 Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program.....	22
2	Annual Summary of Radioactivity in the Environs of the Calvert Cliffs Nuclear Power Plant Units 1 and 2.....	23
3	Synopsis of 2022 Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation Radiological Environmental Monitoring Program .....	30
4	Annual Summary of Radioactivity in the Environs of the Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation .....	31
A-1	Locations of Environmental Sampling Stations for the Calvert Cliffs Nuclear Power Plant .....	36
A-2	Locations of Environmental Sampling Stations for the Independent Spent Fuel Storage Installation at Calvert Cliffs.....	40
B-1	Concentration of Tritium and Gamma Emitters in Bay Water .....	45
B-2	Concentration of Gamma Emitters in the Flesh of Edible Fish .....	46
B-3	Concentration of Gamma Emitters in Oyster Samples .....	47
B-4	Concentration of Gamma Emitters in Shoreline Sediment.....	48
B-5	Concentration of Iodine-131 in Filtered Air .....	49
B-6	Concentration of Beta Emitters in Air Particulates.....	51
B-6	Concentration of Beta Emitters in Air Particulates.....	53
B-7	Concentration of Gamma Emitters in Air Particulates .....	55
B-8a	Concentration of Gamma Emitters in Vegetation Samples .....	56
B-8b	Concentration of Gamma Emitters in Vegetation From Locations Around the ISFSI.....	58
B-9	Concentration of Gamma Emitters in Soil Samples From Locations Around the ISFSI ..	59
B-10	Typical MDA Ranges for Gamma Spectrometry .....	60
B-11	Typical LLDs for Gamma Spectrometry .....	61
B-12	Direct Radiation .....	62
C-1	Results of Participation in Cross Check Programs .....	69
C-2	Results of Quality Assurance Program .....	75
C-3	Calvert Cliffs Nuclear Power Plant ODCM Required LLDs.....	89
D-1	Land Use Survey.....	90
E-1	Locations of Non-Tech Spec and Radiological Groundwater Environmental Sampling Stations for Calvert Cliffs Nuclear Power Plant.....	93
E-2	Synopsis of 2022 Calvert Cliffs Nuclear Power Plant Non-Tech Spec Radiological Environmental Monitoring Program.....	94
E-3	Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2 Non-Tech Spec Radiological Environmental Monitoring Program .....	95
E-4	Concentration of Gamma Emitters in Bottom Sediment .....	96
E-5	Concentration of Iodine-131 in Filtered Air .....	97
E-6	Alpha Isotopic and Pu-241 in Groundwater .....	99

E-7	Gross Alpha Activity in Groundwater .....	100
E-8	Concentration of Radiostrontium in Groundwater .....	101
E-9	Concentration of Tritium in Groundwater .....	102
E-10	Concentration of Tritium in Surface Water, Precipitation, and Subsurface Drainage.....	103
E-11	Gross Concentration of Gamma Emitters in Groundwater .....	104
E-12	Gross Concentration of Gamma Emitters in Surface Water, Precipitation and MH .....	105

## I. SUMMARY

During 2022, Calvert Cliffs Nuclear Power Plant (CCNPP) Units 1 and 2, a total of 2216 radiological analyses were performed, and the analytical results reviewed. Most of these analyses were performed to satisfy the requirements of the Offsite Dose Calculation Manual (ODCM) (Ref. 6), the Environmental Technical Specifications (Ref. 5) and the Independent Spent Fuel Storage Installation (ISFSI) Technical Specifications (Ref. 10). Some of these samples, although not required by either the ODCM or the Technical Specifications, were collected to maintain our commitments to the surrounding community and to maintain historical continuity of the CCNPP Radiological Environmental Monitoring Program (REMP) that started in 1970. The entire monitoring program in place around CCNPP is divided into three parts: the original REMP, the ISFSI monitoring program, and the Non-ODCM Radiological Environmental Monitoring. The following paragraphs describe each of these parts in more detail.

A total of 946 radiochemical analyses were performed on 906 environmental samples; and 364 Optically Stimulated Luminescent Dosimeters (OSLDs) were analyzed for ambient radiation exposure rates as part of the original REMP. These analyses were performed to satisfy the requirements of the ODCM (Ref. 6) and the Environmental Technical Specifications (Ref. 5).

For the ISFSI monitoring program, 320 radiochemical analyses were performed on 300 environmental samples, 224 of which were in common with the original REMP. In addition, 320 OSLDs, 16 in common with the original REMP, were analyzed for ambient radiation exposure rates. These analyses were performed to satisfy the requirements of the ODCM (Ref. 6) and the ISFSI Technical Specifications (Ref. 10).

Lastly, 350 radiochemical analyses were performed on 274 quality assurance samples and 156 quality assurance OSLDs were analyzed as part of an internal and external quality assurance program associated with Teledyne Brown Engineering. Laboratory inter-comparison samples obtained from Environmental Resource Associates (ERA) and Analytics' Inc. were also analyzed.

Samples collected from the aquatic environment included bay water, fish, oysters, and shoreline sediment. Bay water was analyzed for tritium and gamma emitters. Fish, oysters, and shoreline sediments were analyzed for gamma emitting radionuclides.

Monitoring the atmospheric environment involved sampling the air at various locations surrounding CCNPP and the ISFSI. Air particulates and gaseous iodine were collected on glass fiber filters and charcoal cartridges, respectively. The particulate filters were analyzed for beta activity and gamma emitting nuclides. The charcoal cartridges were analyzed for airborne gaseous radioiodine.

Samples from the terrestrial environment consisted of vegetation and soil samples collected and analyzed for gamma emitters. Vegetation samples for the original REMP were also analyzed for I-131.

Measurements of direct radiation, as required by the ODCM, were performed by analyzing OSLDs from forty-two locations surrounding CCNPP and the ISFSI.

Natural radioactivity was detected in essentially all 2216 radiological analyses performed. Low levels of man-made fission products were also observed in 6 of these analyses for the CCNPP REMP. Two of these observations were for low level Tritium and is attributed to normal plant operations. The other 4 observations were for Cs-137 and attributed to fallout from past atmospheric weapons testing. Detailed discussions about the results of these analyses are contained in the body of this report.

To assess the plant's contribution to the radiation levels of the ambient environment, dose calculations were performed by Murray and Trettel, Inc. using 2022 data from the plant's effluent releases, 2022 on-site meteorological data, and appropriate pathways. Details on these dose calculations and meteorological trends from 2022 are provided in the Annual Report on the Meteorological Monitoring Program at the Calvert Cliffs Nuclear Power Station 2022. The results of these dose calculations indicate:

- a. a maximum thyroid dose of  $1.87 \times 10^{-2}$  mrem via liquid and gaseous pathways, which is about 0.0249% of the acceptable limit of 75 mrem/yr as specified in 40CFR190 "Environmental Radiation Protection Standards for Nuclear Power Operations" and 10CFR72.104, "Licensing Requirements for the Independent Storage of Spent Nuclear Fuel and High-Level Radioactive Waste";
- b. a maximum whole-body dose of  $2.52 \times 10^{-2}$  mrem via liquid and gaseous pathways, which is about 0.101% of the acceptable limit of 25 mrem/yr as specified in both 40CFR190 and 10CFR72.104; and
- c. a maximum calculated dose to all other organs via liquid and gaseous pathways was equal to  $3.54 \times 10^{-2}$  mrem. This dose is about 0.142% of the allowable limit of 25 mrem/yr as specified in both 40CFR190 and 10CFR72.104.

Thus, it is concluded based upon the levels of radioactivity observed and the various dose calculations performed, that CCNPP Units 1 and 2 and the ISFSI did not cause any significant radiological impact on the surrounding environment.



## **II. CALVERT CLIFFS NUCLEAR POWER PLANT RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

### **II.A. INTRODUCTION**

The REMP has been conducted in the vicinity of CCNPP since the summer of 1970. The Calvert Cliffs site is an operating nuclear generating station consisting of two pressurized water reactors. Unit 1 achieved criticality on October 7, 1974 and commenced commercial operation in May 1975. Unit 2 achieved criticality on November 30, 1976 and went into commercial operation April 1, 1977. The location of the plant in relation to local metropolitan areas is shown on Figure A-1.

Results of the monitoring program for the pre-operational period have been reported in a series of documents (Ref. 1-4). The results from previous operational periods are contained in annual reports submitted to the Nuclear Regulatory Commission (NRC) as required.

Results of the monitoring program for the current operational period are included in this report. The report presents the content of the REMP (Table 1), the sampling locations (Appendix A), the summary of the analytical results (Table 2), a compilation of the analytical data (Appendix B), the results of the Interlaboratory Comparison Program and the Quality Assurance Program (Appendix C), the results of the Land Use Survey (Appendix D), and a compilation of the analytical data for extra samples collected (Appendix E). Interpretation of the data and conclusions are presented in the body of the report.

The environmental surveillance data collected during this reporting period were compared with that generated in previous periods whenever possible to evaluate the environmental radiological impact of CCNPP Units 1 and 2.

### **II.B. PROGRAM**

#### **II.B.1 Objectives**

The objectives of the REMP for the Calvert Cliffs Nuclear Power Plant are:

- a. To verify that radioactivity and ambient radiation levels attributable to plant operation are within the limits specified in the ODCM (Ref. 6) and the Environmental Radiation Protection Standards as stated in 40CFR190,
- b. To detect any measurable buildup of long-lived radionuclides in the environment,
- c. To monitor and evaluate ambient radiation levels, and
- d. To determine whether any statistically significant increase occurs in the concentration of radionuclides in important pathways.

### **II.B.2 Sample Collection**

The locations of the individual sampling stations are listed in Table A-1 and shown in Figures A-2 and A-3. All samples were collected by contractors to, or personnel of Constellation Generation Solutions (CGS) according to Procedures (Ref. 7, 12 and 15).

### **II.B.3 Data Interpretation**

Many results in environmental monitoring occur at or below the minimum detectable activity (MDA). In this report, all results at or below the relevant MDA are reported as being "less than" the MDA value which is the minimum detectable activity for each nuclide in that sample at the time of analysis.

### **II.B.4 Program Exceptions**

There was one dosimetry program exception during this operating period. DR23 in Quarter 3 2022 dosimeters were lost. The two dosimeters and their housing were completely missing in the field. Two additional dosimeters were lost that had been collocated for Quality Assurance purposes. The collector searched the area and was unable to recover the equipment. A new housing and dosimeters were deployed for the next quarter. These losses were captured in the Nuclear Corrective Action Program to document the events and trend future events should they occur. (IR#04530384)

## **II.C. RESULTS AND DISCUSSIONS**

All the environmental samples collected during the year were analyzed using Constellation Generation Solutions (CGS) laboratory procedures (Ref. 8), except Tritium which was analyzed by Teledyne Brown Engineering (Ref. 14) and Dosimetry analysis provided by Landauer using OSLDs (Ref. 17). The analytical results for this reporting period are presented in Appendix B and are also summarized in Table 2. For discussion, the analytical results are divided into four categories. The categories are Aquatic Environment, Atmospheric Environment, Terrestrial Environment, and Direct Radiation. These categories are further divided into subcategories according to sample type (e.g. Bay Water and Aquatic Organisms for Aquatic Environment).

### **II.C.1 Aquatic Environment**

The aquatic environment surrounding the plant was monitored by analyzing samples of bay water, aquatic organisms, and shoreline sediment. The samples were obtained from various sampling locations on the Chesapeake Bay near the plant.

#### **II.C.1.a Bay Water**

Monthly bay water samples were taken from two locations during the year. These locations are the Intake Area (sample code WA1) and the Discharge Area (sample code WA2). Composite

samples were obtained from each location for the entire sampling period. These samples were analyzed for tritium and gamma emitters.

The tritium analyses, performed on quarterly composites of the monthly bay water samples, revealed low level concentrations of Tritium in two samples at the Discharge Area (sample code WA2). Tritium was identified in the first quarterly sample collected from 12/30/2021 to 03/30/2022 at 187 +/- 117 pCi/L and the third quarterly sample collected from 07/01/2022 to 09/30/2022 at 599 +/- 138 pCi/L.

Figure 1 compares tritium observed in the plant discharge and intake with annual effluent releases as reported in the Radioactive Effluent Release Report.

Monthly analyses of bay water samples from both locations for gamma emitters exhibited no detectable concentrations of any plant-related radionuclides.

### **II.C.1.b Aquatic Organisms**

Twelve samples of aquatic organisms were obtained from four locations during the year. Samples of fish, when in season, are normally collected from the Discharge Area (sample codes IA1 and IA2) and from the Patuxent River (sample codes IA4 and IA5). As shown in Table B-2, two species of fish were sampled at both the plant discharge and the control point in the Patuxent River. Oyster samples were obtained quarterly from Camp Conoy (sample code IA3) and Kenwood Beach (IA6).

Figure 2 compares K-40 and Ag-110m observed in oysters from Camp Conoy (IA3) with annual effluent releases of Ag-110m as reported in the Radioactive Effluent Release Report.

Edible portion of the fish and oyster samples were analyzed for gamma emitters.


Gamma spectrometric analyses of the fish exhibited naturally occurring K-40 but no detectable concentrations of any plant-related radionuclides. Oyster samples likewise exhibited naturally occurring K-40 but no detectable concentrations of any plant-related radionuclides.

### **II.C.1.c Shoreline Sediment**


Semiannual shoreline sediment samples are taken from one location during the year. This location is Shoreline at Barge Road (sample code WB1). The semiannual shoreline sediment samples obtained from this location were analyzed for gamma emitters.

Gamma spectrometric analyses of these samples exhibited naturally occurring radionuclides, but no detectable concentration of any plant-related radionuclides.

**FIGURE 1**  
**Tritium in Chesapeake Bay Water**

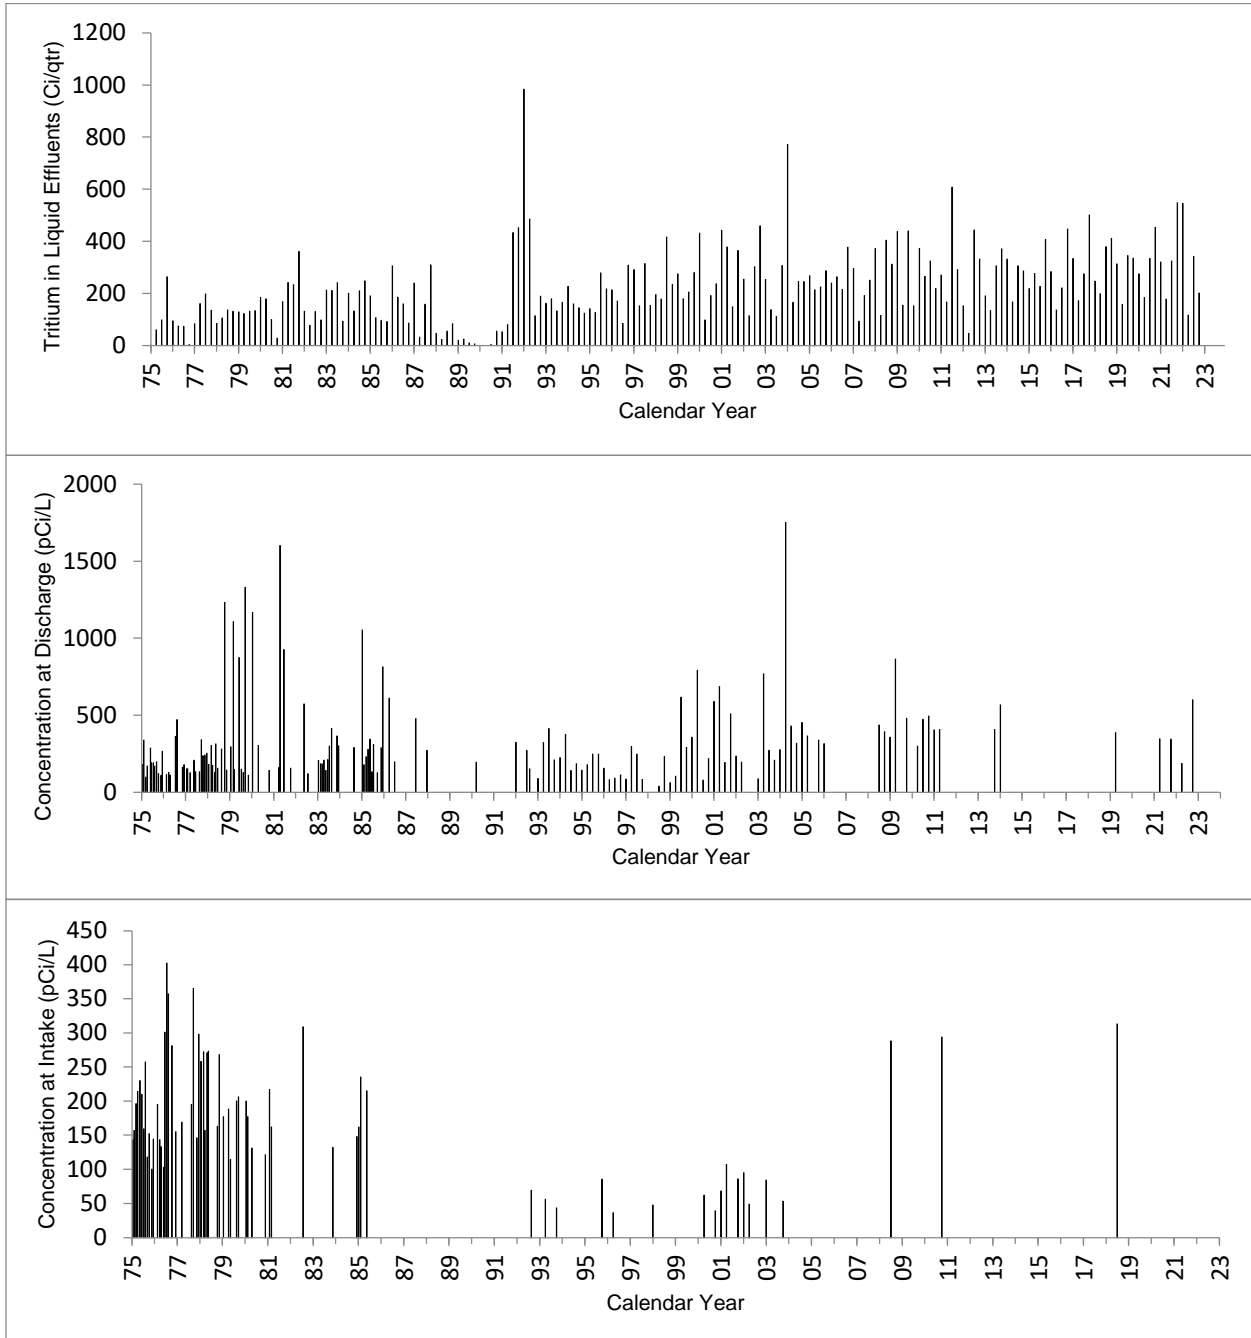

**FIGURE 2**  
**Silver-110m and Potassium-40 in Chesapeake Bay Oysters**

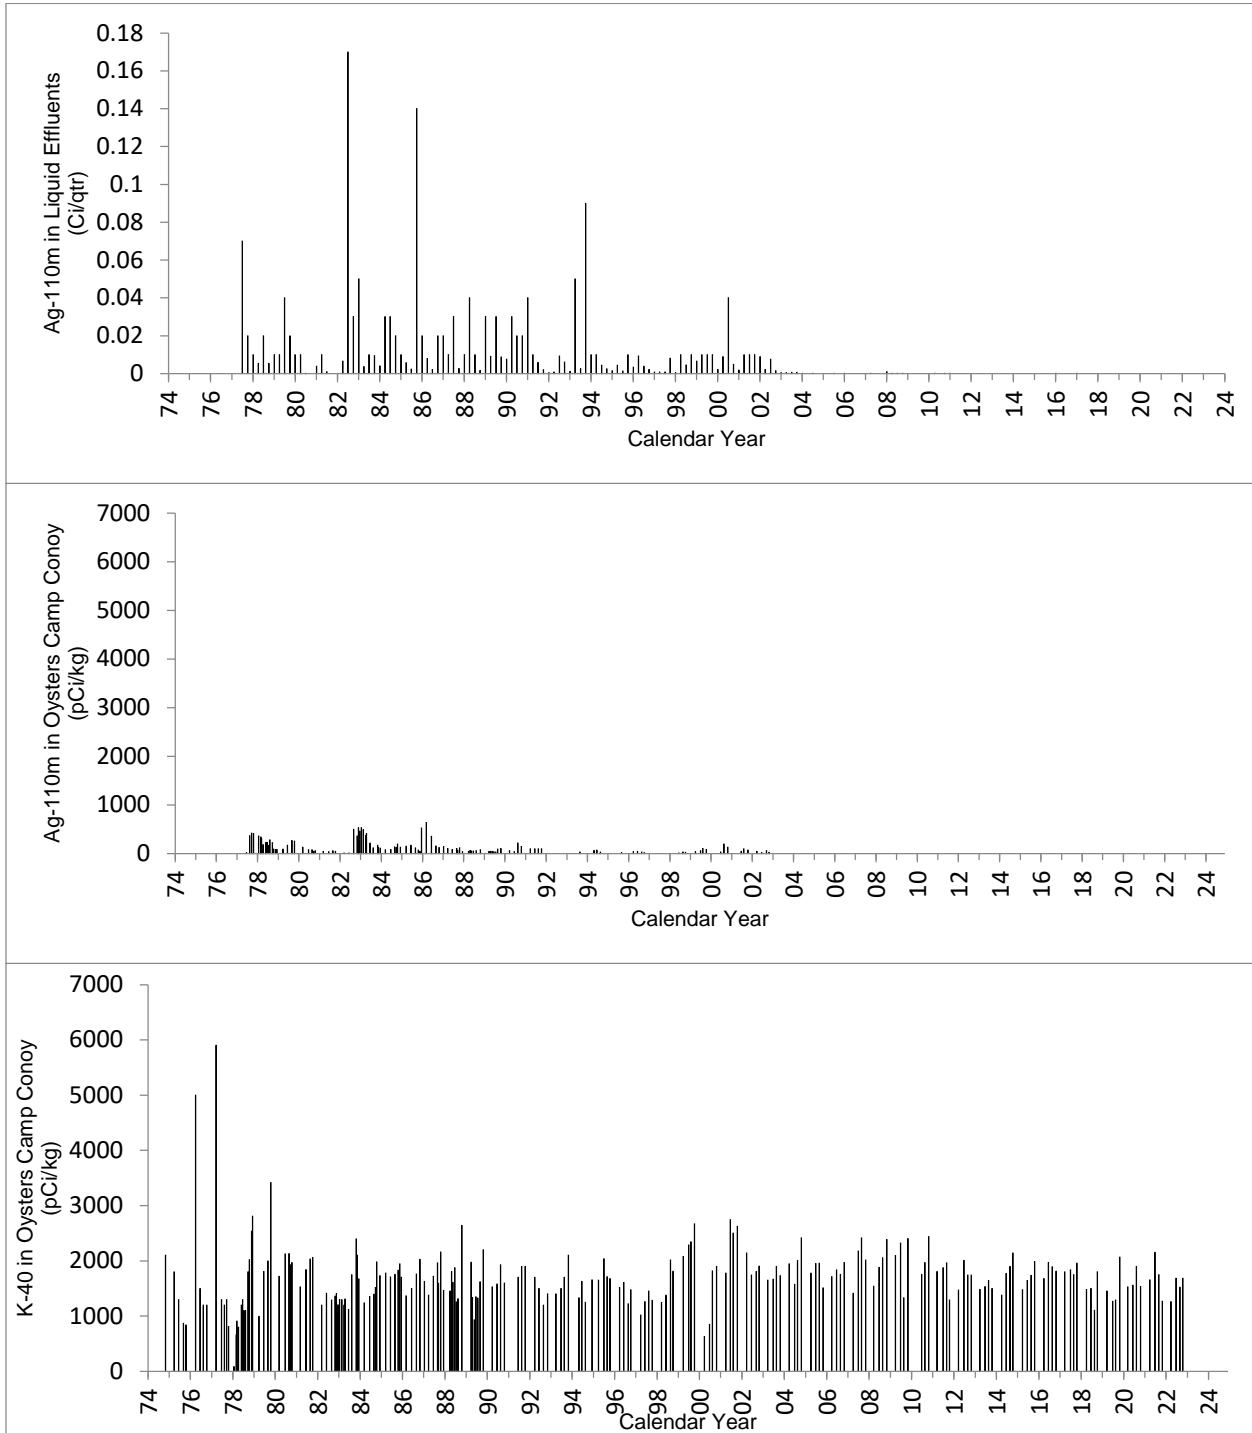

## **II.C.2 Atmospheric Environment**

The atmospheric environment was monitored by analyzing air particulate filters and charcoal cartridges (for trapping radioiodine species). Samples were collected from eight locations surrounding the plant. The locations are On Site Before Entrance to Camp Conoy (sample code A1), Camp Conoy Road at the Emergency Siren (sample code A2), Bay Breeze Road (sample code A3), Route 765 at Lusby (sample code A4), and at the Emergency Operations Facility (sample code A5), Meteorological Station (sample code SFA1), NNW of ISFSI (sample code SFA3), and SSE of ISFSI (sample code SFA4). Sample locations A1, SFA1, SFA3, and SFA4 are common to the REMP monitoring program and the ISFSI monitoring program.

### **II.C.2.a Air Particulate Filters**

Weekly composite air particulate filter samples were collected from the eight locations, referenced, above during the year. These samples were analyzed for beta activity and gamma emitters.

Weekly analyses for beta activity on air particulate filters collected from all eight locations showed values characteristic of background levels. The values ranged from  $0.9 \times 10^{-2}$  to  $4.8 \times 10^{-2}$  pCi/m<sup>3</sup> for the indicator locations and  $0.9 \times 10^{-2}$  to  $4.4 \times 10^{-2}$  pCi/m<sup>3</sup> at the control location. The location with the highest overall mean of  $2.2 \times 10^{-2}$  pCi/m<sup>3</sup> was A4, Route 765 at Lusby.

Gamma spectrometric analyses of Quarterly composited air particulate weekly samples exhibited no detectable concentrations of any plant-related radionuclides in any of these samples. Naturally occurring radionuclides, such as Be-7, were detected in nearly all samples.

Figure 3 depicts the historical trends of beta activity.


### **II.C.2.b Air Iodine**

Weekly composited charcoal cartridges (for trapping radioiodine species) were collected from the eight locations, referenced above, during the year. These samples were analyzed for radioiodine species and exhibited no detectable concentrations of I-131 during the year.

Figure 3 depicts the historical trends of manmade radioiodine activity for location A4, Route 765 at Lusby including the impact I-131 due to significant events such as the fallout resulting from the accident event at Chernobyl in 1986 and the accident event at Fukushima Daiichi in 2011. These examples demonstrate the sensitivity of the CCNPP REMP. Since the REMP is able to detect fallout from nuclear accidents from across the world, it is clear that the REMP would be able to detect the environmental accumulation of radioactive material coming directly from CCNPP.

**FIGURE 3**  
**Nuclear Fallout in the Calvert Cliffs Area**

SURFACE AIR VAPORS, LUSBY, MD (A4)

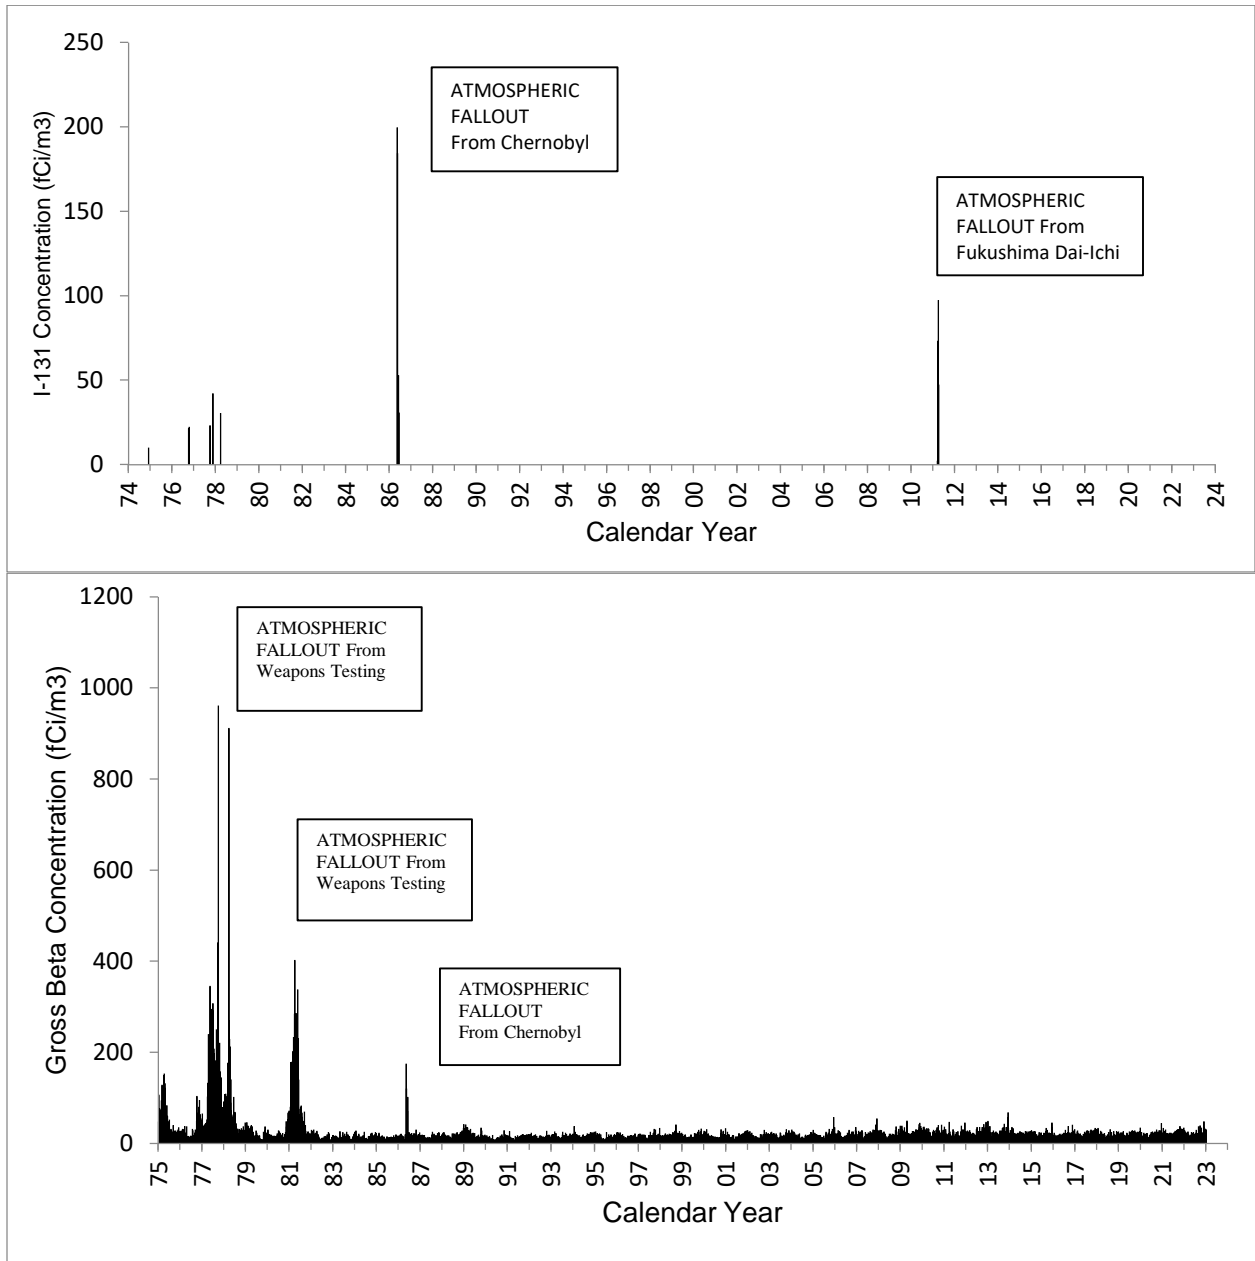

### **II.C.3 Terrestrial Environment**

The terrestrial environment was monitored by analyzing samples of vegetation collected monthly, when available, from various sampling locations near the plant during the normal growing season.

#### **II.C.3.a Vegetation**

Vegetation samples were collected from three locations during the year. These locations are On Site Before Entrance to Camp Conoy (sample codes IB4, IB5, and IB6), the Emergency Operations Facility (sample codes IB7, IB8, and IB9), and the Garden Plot at Meteorological Station (sample codes IB10, IB11, and IB12). These samples were analyzed for gamma emitters, including analyses for I-131.

All samples showed detectable amounts of naturally occurring K-40 and Be-7. No plant related radionuclides were found in any of these samples.

#### **II.C.4 Direct Radiation**

Direct radiation is measured by a network of environmental dosimeters in each overland sector surrounding the plant, both at the plant boundary and at 4 miles from the plant.

Environmental Dosimeters were collected quarterly from twenty-three locations surrounding the plant. The twenty indicator locations are On Site Along the Cliffs (sample code DR1), Route 765 Auto Dump (sample code DR2), Giovanni's Tavern (sample code DR3), Route 765 Across from White Sand Dr (sample code DR4), Route 765 at John's Creek (sample code DR5), Lusby (sample code DR6), On Site before the Entrance to Camp Conoy (sample code DR7), On Site at Emergency Siren (sample code DR8), Bay Breeze Road (sample code DR9), Calvert Beach Road & Decatur St (sample code DR10), Dirt Road off Mackall Rd & Parran Rd (sample code DR11), Bowen Rd & Mackall Rd (sample code DR12), Mackall Rd near Wallville (sample code DR13), Rodney Point (sample code DR14), Mill Bridge Rd & Turner Rd (sample code DR15), Across from Appeal School (sample code DR16), Cove Point Rd & Little Cove Point Rd (sample code DR17), Cove Point (sample code DR18), Long Beach (sample code DR19), and Onsite Near Shore (sample code DR20). The three control locations are the Emergency Operations Facility (sample code DR21), Solomons Island (sample code DR22), and Taylors Island, Anderson's Property (sample code DR23).

In 2022 OSLDs were provided by and analyzed by Landauer, Inc. The 2022 mean 91-day ambient radiation measured at the indicator locations was 12.2 mrem and ranged from 8.7 to 32 mrem as reported in Table 2. The control locations showed a 91-day mean of 14.3 mrem with ranges from 12.1 to 17.0 mrem. The location with the highest overall mean of 17.0 was Taylors Island, Anderson's Property (sample code DR23) which ranged from 16.4 to 17.4

Mrem for the first, second, and fourth quarters that data was available. Dosimeters were lost from the pole and could not be recovered for the third quarter. This is a program exception that was captured in the site's corrective action program for tracking and future trending and is also discussed in section II.B.4 Program Exceptions in this report.




Figure 4-a depicts the long-term trend of mean dosimeter exposure for the 4-mile, Control Location, and On-Site dosimeters. In June of 2018 the site adopted the requirements of the updated ANSI 13.37 standard which quantifies the dose due to the environment with enhanced accuracy and quality assurance by removing extraneous dose from the total measurement to give a true facility related dose result. Dosimeters accumulate dose continuously and extraneous dose represents the dose accumulated before and after the time spent at the sample location so the true dose accumulated at that location can be accurately determined.

Figure 4-b depicts quarterly exposure at each Dosimeter location in 2022, with the locations ranked by increasing exposure. From these graphs, it can be seen that there is a slight bias towards higher exposure at the control locations outlined in bold. This is due to higher natural background radiation at DR23 (Taylor's Island, 7.8 miles from CCNPP). This slight bias is due to normal variations in background radiation levels and is consistent with pre-operational data.


Note that in figure 4-b, the ranking of DR23 is diminished because Q3 data was not available for that dosimetry location. This has been identified in the program exceptions section of this report.

For example, in figure 4a this trend can be observed in the first calendar year of the graph, 1973, which was a year prior to the first criticality of Unit 1 (October 7, 1974). Facility-related dose was not detected at any of the monitoring locations in 2022.

**FIGURE 4a**  
**Mean Dosimeter Gamma Dose, Calvert Cliffs Nuclear Power Plant**

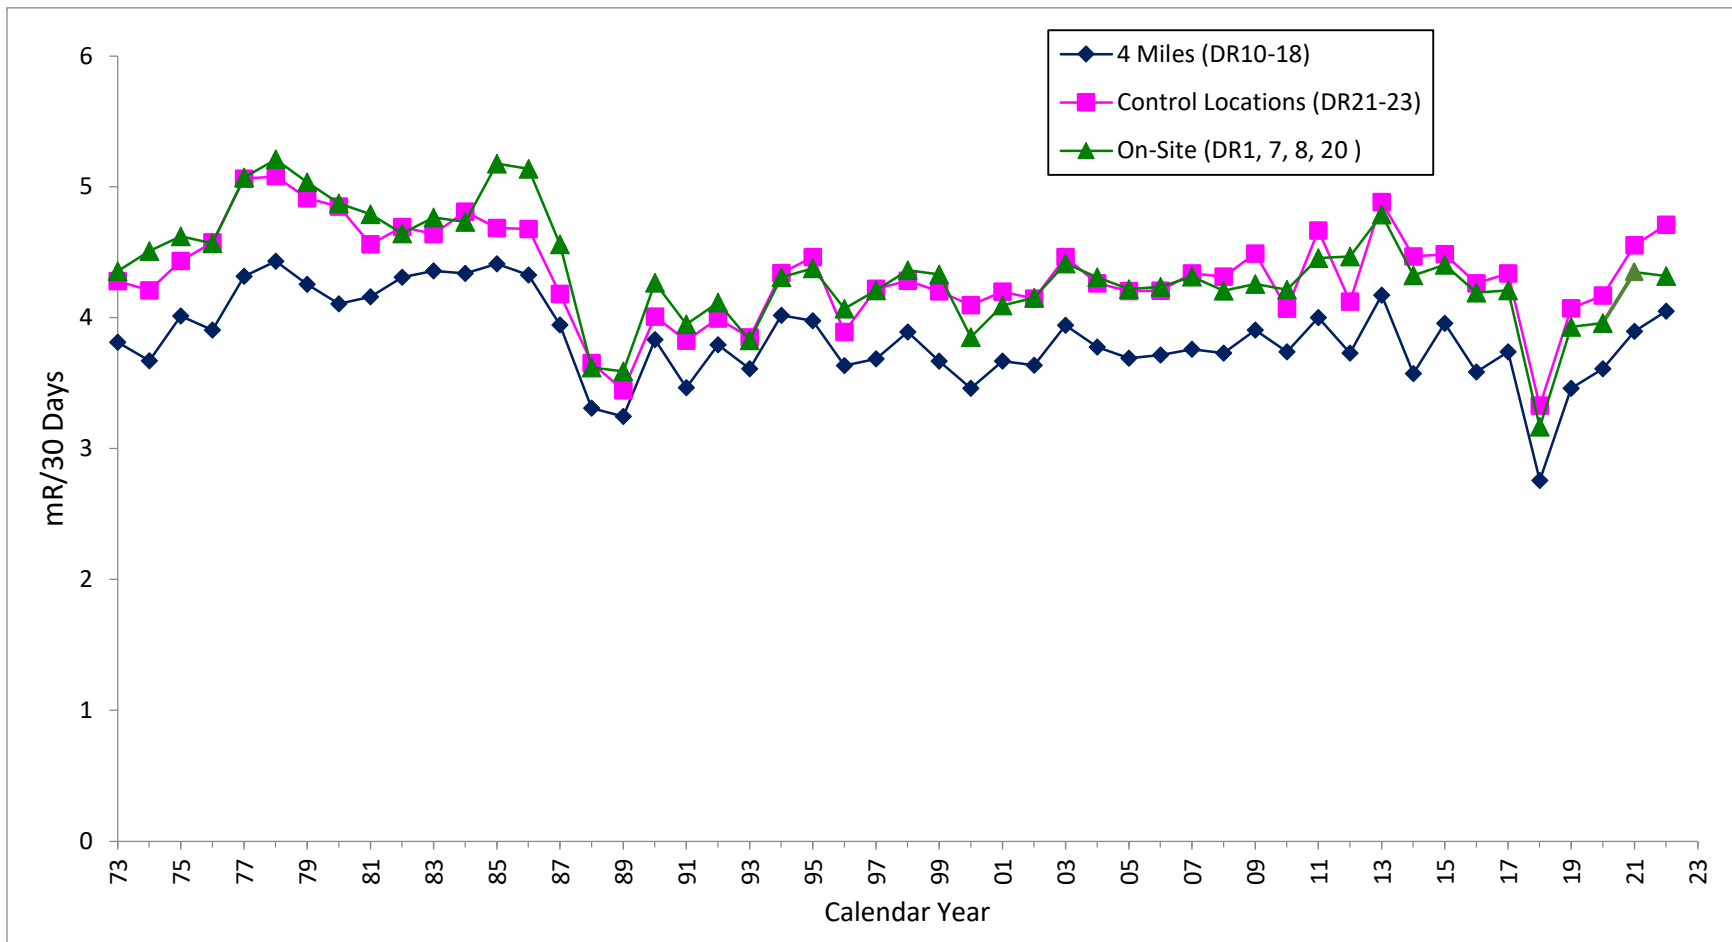

**FIGURE 4b**  
**2022 Quarterly Dosimeter Gamma Dose, per Location, Calvert Cliffs Nuclear Power Plant**

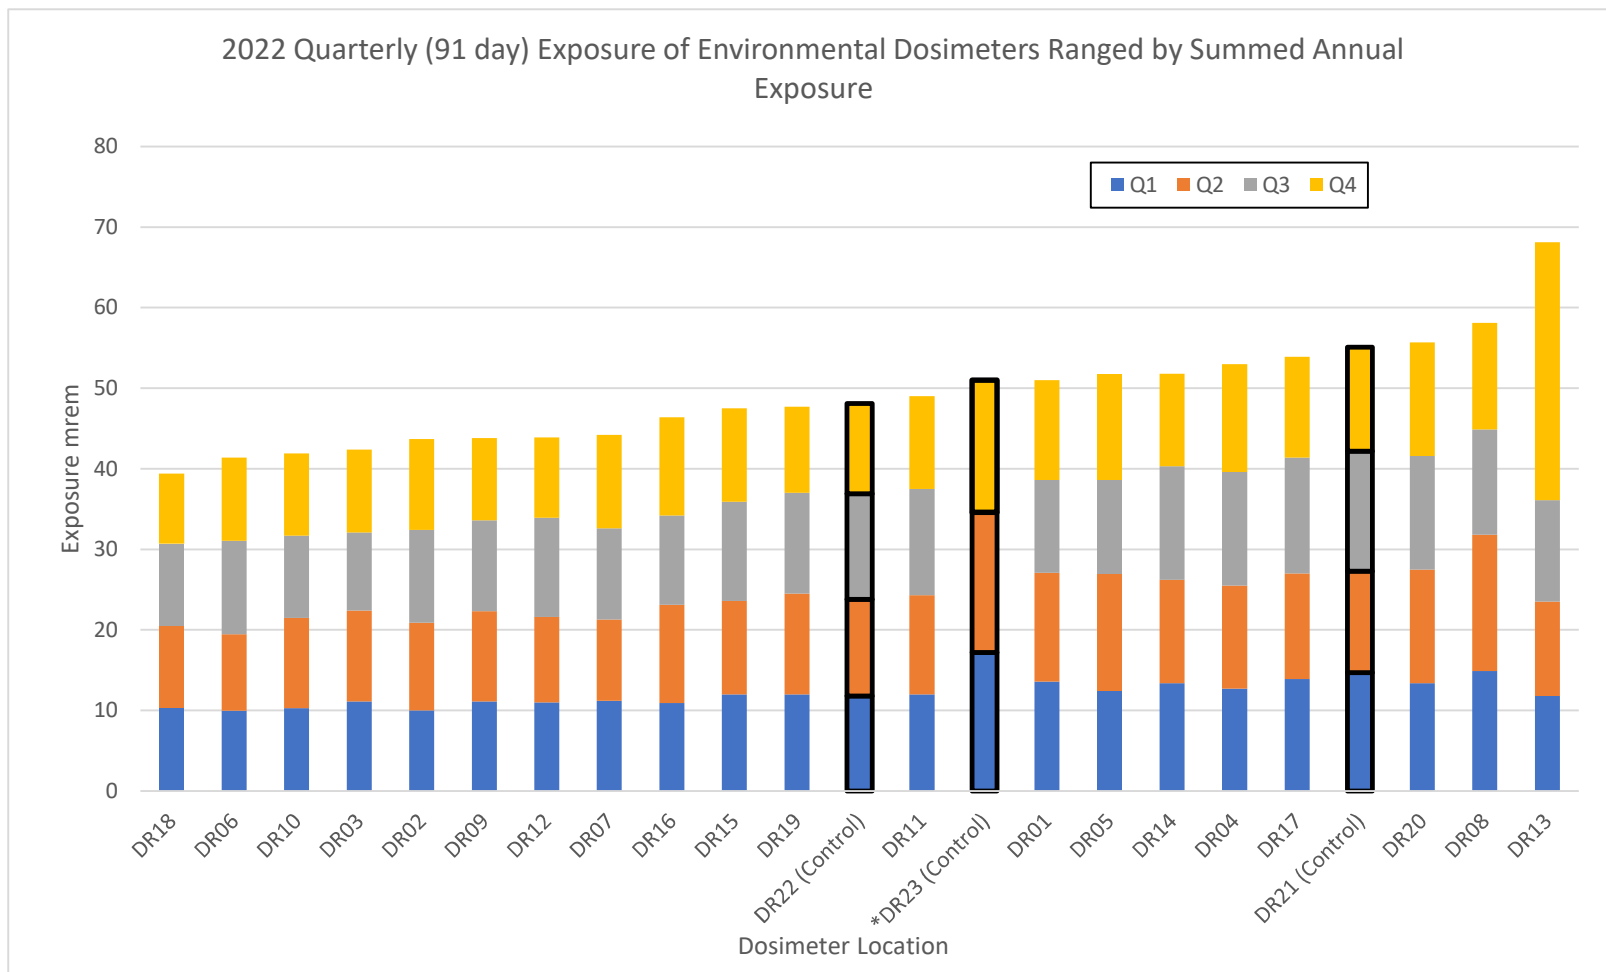

\*No data available for DR23, dosimeters were lost from the pole in Qtr. 3 2022

## **II.D. CONCLUSION**

Two occasions of low level Tritium in plant discharge were observed in 2022 and are attributable to normal plant operations. Results are described in section II.C.1.a of this report and are plotted in Figure 1 for which demonstrates consistency with historical trends at a low level of activity that is well below regulatory limits established in 40CFR190 and 10CFR72.104. No other man-made fission or activation by-products attributable to plant operations were observed in the environment surrounding the plant during the year.

Historical trends for tritium in bay water, Ag-110m and K-40 in oyster samples, nuclear fallout in the Calvert Cliffs area, and OSLD data are depicted in Figures 1 through 4. As can be seen from these figures, the plant made no adverse radiological contributions to the surrounding environment.

To assess the plant's contribution to the ambient radiation levels of the surrounding environment, dose calculations were performed by Murray and Trettel, Inc. using the plant's 2022 effluent release data, on site meteorological data (see X/Q and D/Q values presented in Figures 5 and 6), and appropriate pathways. Details on these dose calculations and meteorological trends from 2022 are provided in the Annual Report on the Meteorological Monitoring Program at the Calvert Cliffs Nuclear Power Station 2022. The results of these dose calculations indicate:

### **Gaseous Pathways**

A maximum thyroid dose of  $1.20 \times 10^{-5}$  mrem to a child via the plume, ground, vegetable, and inhalation pathways at 2.7 miles WNW of the containments at Calvert Cliffs.

This is about 0.000016% of the acceptable limit of 75 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum whole-body gamma dose of  $1.20 \times 10^{-5}$  mrem to a teenager at 2.2 miles WNW of the containments at Calvert Cliffs. This is about 0.0000480% of the acceptable dose limit of 25 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum dose to any other organ, in this case GI Tract, of  $1.22 \times 10^{-5}$  mrem to a teenager at 2.7 miles WNW of the containments at Calvert Cliffs. This is about 0.0000488% of the acceptable dose limit of 25 mrem/yr as specified in 40CFR190 and 10CFR72.104.

### **Liquid Pathways**

A maximum thyroid dose of  $1.87 \times 10^{-2}$  mrem to a teenager for all liquid pathways, which is about 0.0249% of the acceptable dose limit of 75 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum whole-body dose of  $2.52 \times 10^{-2}$  mrem to a teenager via all liquid pathways, which is about 0.101% of the acceptable dose limit of 25 mrem/yr as stated in 40CFR190 and 10CFR72.104.

A maximum dose to any other organ, in this case Bone, of  $3.54 \times 10^{-2}$  mrem to a teenager for all pathways, which is 0.142% of the acceptable dose limit of 25 mrem/yr specified in 40CFR190 and 10CFR72.104.

### **Gaseous and Liquid Pathways Combined**

A maximum thyroid dose of  $1.87 \times 10^{-2}$  mrem via liquid and gaseous pathways, which is about 0.0249% of the acceptable limit of 75 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum whole-body dose of  $2.52 \times 10^{-2}$  mrem via liquid and gaseous pathways, which is about 0.101% of the acceptable limit of 25 mrem/yr as specified in 40CFR190 and 10CFR72.104.

A maximum calculated dose to all other organs via liquid and gaseous pathways was equal to  $3.54 \times 10^{-2}$  mrem. This dose was about 0.142% of the allowable limit of 25 mrem/yr as specified in 40CFR190 and 10CFR72.104.

In all cases, the calculated doses are a small fraction of the applicable limits specified in 40CFR190 and 10CFR72.104.

Therefore, it is concluded that the operation of Calvert Cliffs Units 1 and 2 produced radioactivity and ambient radiation levels significantly below the limits of the ODCM, 40CFR190, and 10CFR72.104. There was no significant buildup of plant-related radionuclides in the environment due to the operation of the CCNPP in 2022

FIGURE 5

Atmospheric Dispersion Around CCNPP Average Relative Air Concentrations (X/Q)


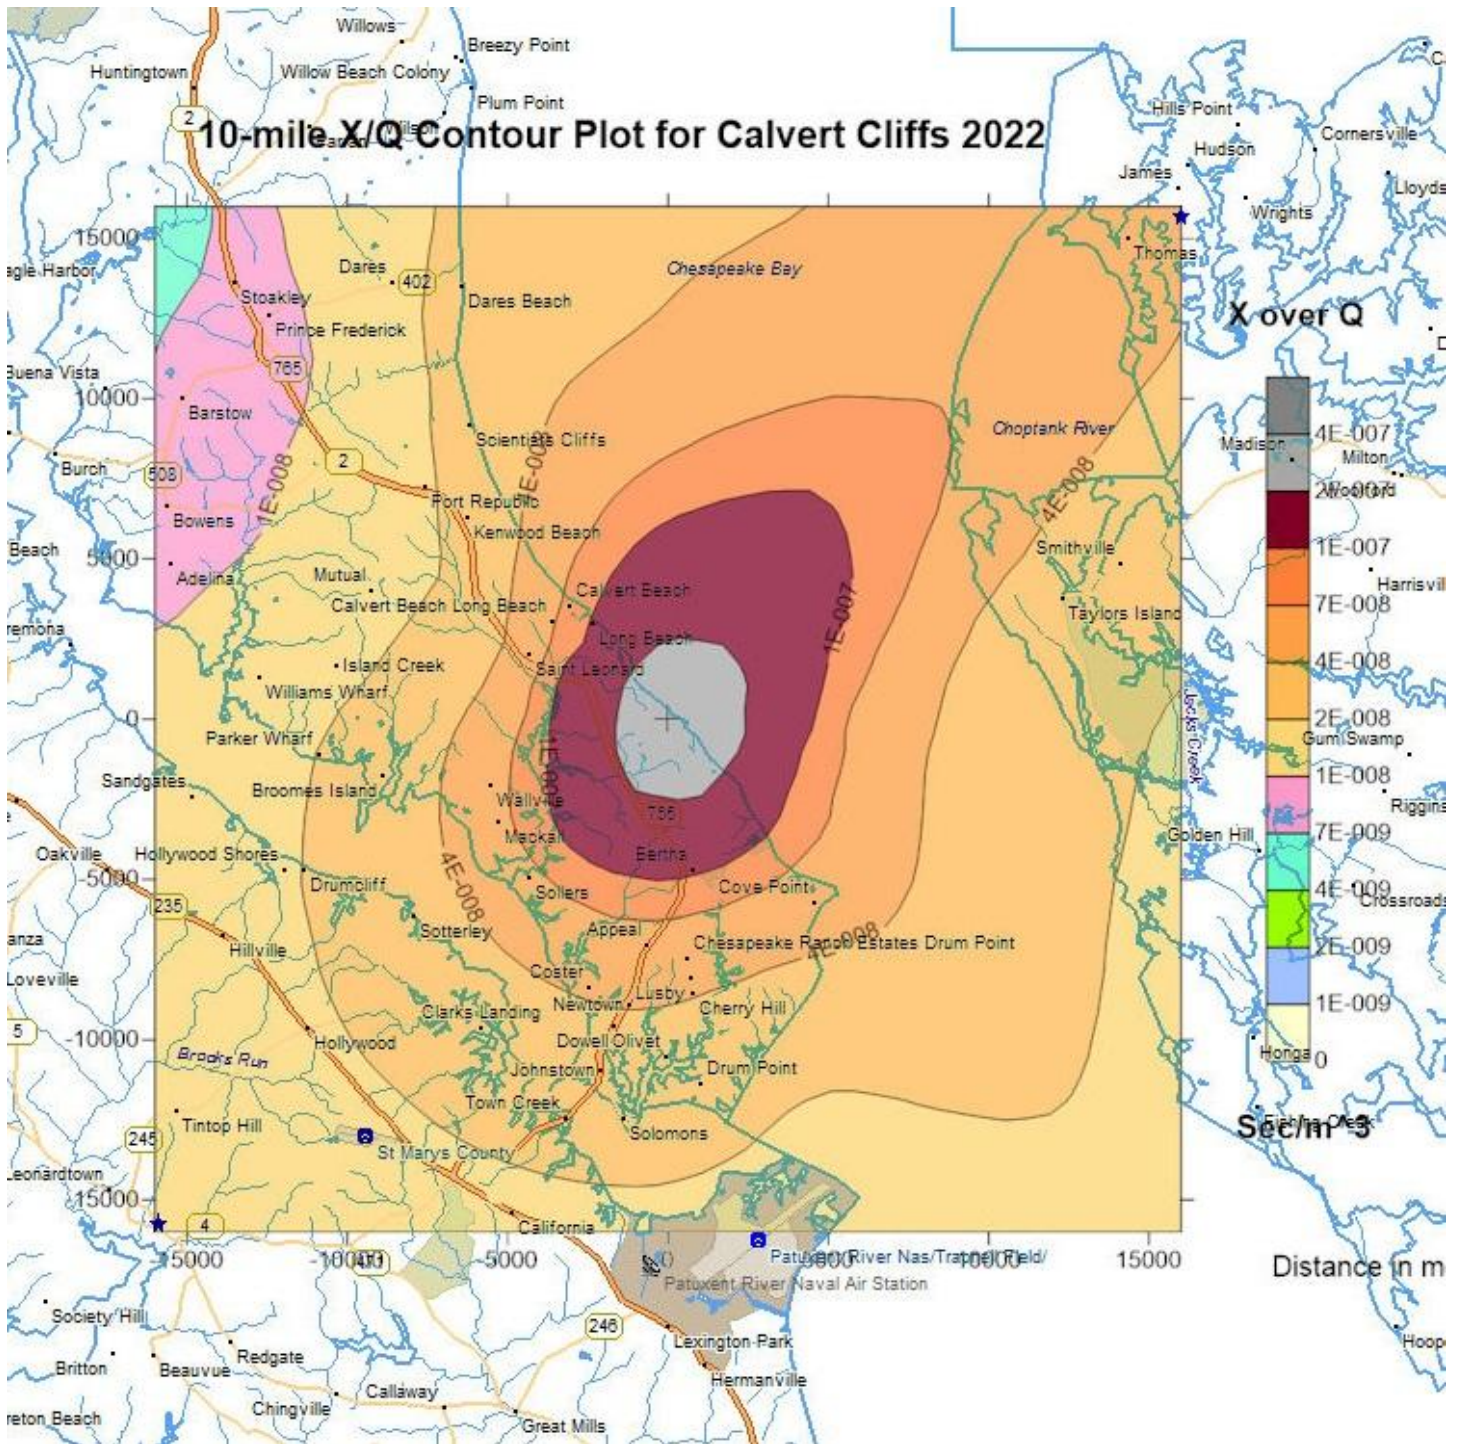


FIGURE 6

Atmospheric Dispersion Around CCNPP Average Relative Ground Deposition (D/Q)

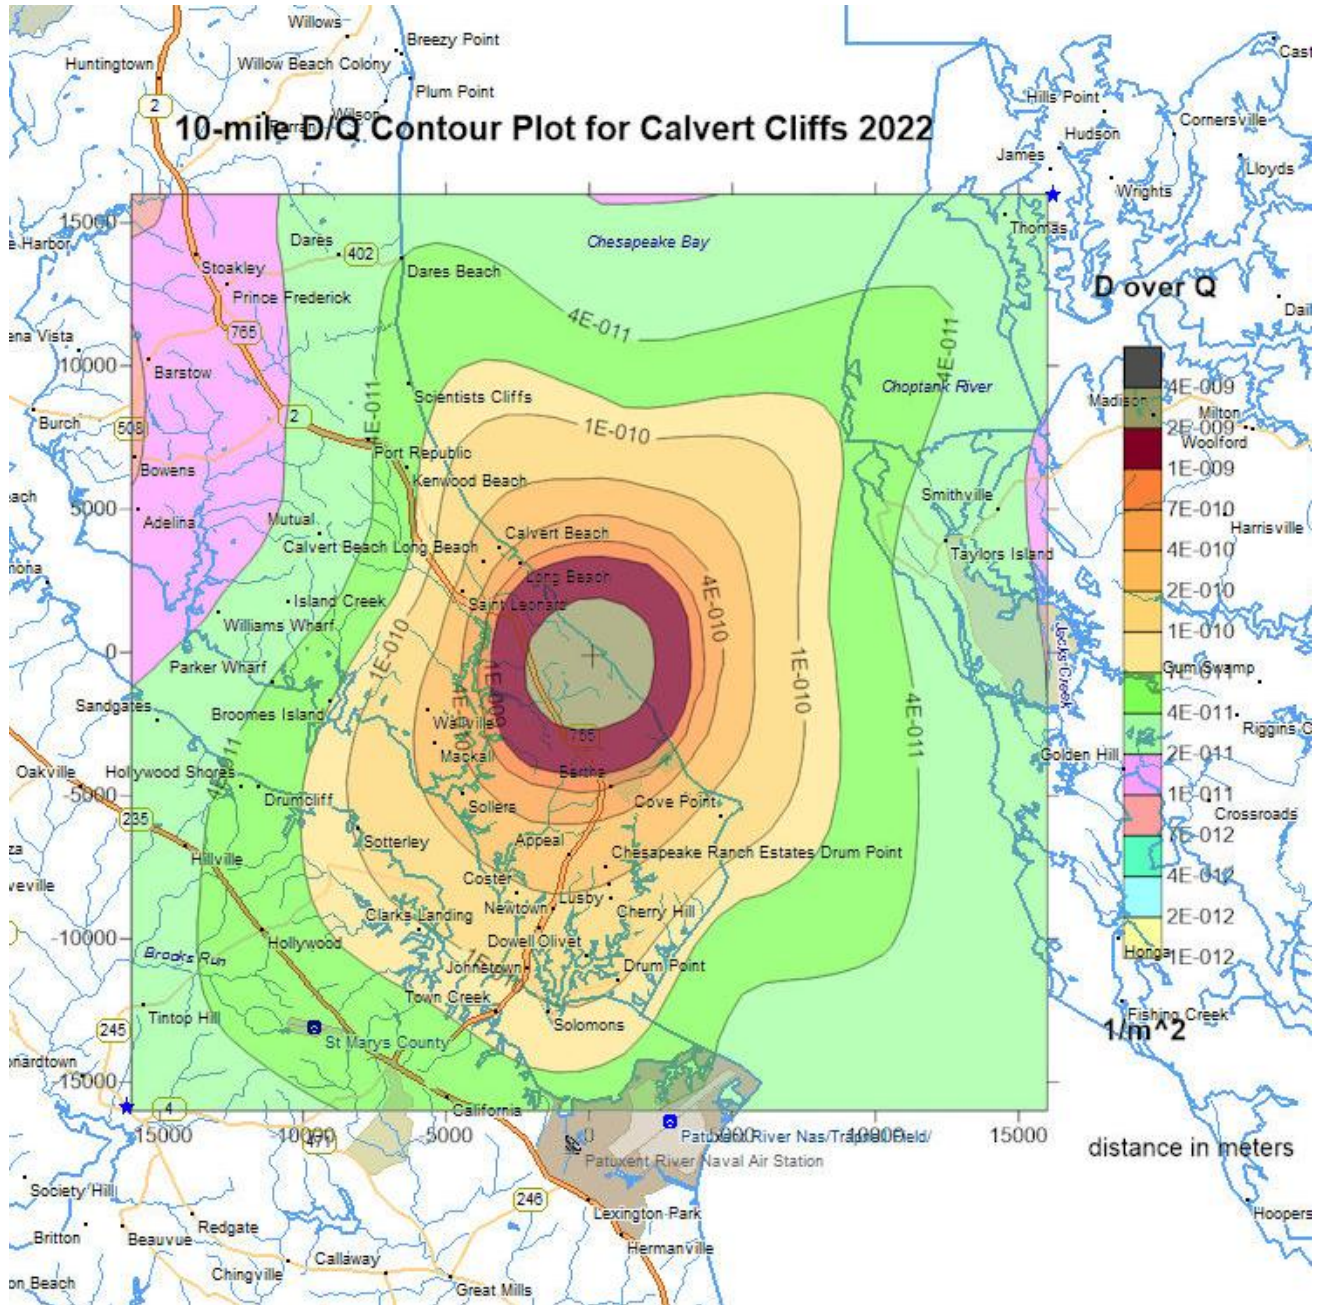

**Table 1**

**Synopsis of 2022 Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program**

Sample Type	Sampling Frequency <sup>1</sup>	Number of Locations	Number Collected	Analysis	Analysis Frequency <sup>1</sup>	Number Analyzed
<b>Aquatic Environment</b>						
Bay Water	MC	2	24	Gamma	MC	24
				H-3	QC	8
Fish <sup>2</sup>	A	4	4	Gamma	A	4
Oysters	Q	2	8	Gamma	Q	8
Shoreline Sediment	SA	1	2	Gamma	SA	2
<b>Atmospheric Environment</b>						
Air Iodine <sup>3</sup>	W	8	416	I-131	W	416
Air Particulates <sup>4</sup>	W	8	416	Gross Beta	W	416
				Gamma	QC	32
<b>Direct Radiation</b>						
Ambient Radiation	Q	23	364	OSLD	Q	364
<b>Terrestrial Environment</b>						
Vegetation <sup>5</sup>	M	3	36	Gamma	M	36

<sup>1</sup> W=weekly, M=monthly, Q=quarterly, SA=semiannual, A=annual, C=composite

<sup>2</sup> Once in Season, July through September

<sup>3</sup> The collection device contains charcoal

<sup>4</sup> Beta counting is performed after >72-hour decay, Gamma spectroscopy performed on quarterly composites of weekly samples

<sup>5</sup> Monthly during growing season when available



**Table 2**

**Annual Summary of Radioactivity in the Environs of the  
Calvert Cliffs Nuclear Power Plant Units 1 and 2**

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range <sup>1</sup>	Location with Highest Annual Mean Name/Distance & Direction <sup>2</sup>	Highest Annual Mean (F) / Range <sup>1</sup>	Control Locations Mean (F)/Range
<b>Aquatic Environment</b>						
Bay Water (pCi/L)	H-3 (8)	200	393 (2/4) (187-599)	Discharge Vicinity WA2 0.3 km N	393 (2/4) (187-599)	-- --
<b>Atmospheric Environment</b>						
Air Particulates (10 <sup>-2</sup> pCi/m <sup>3</sup> )	Gross Beta (421)	0.5	2.1 (364/364) (0.9-4.8)	Route 765 at Lusby A4 2.9 km SSW	2.2 (52/52) (0.9-4.8)	2.1 (52/52) (0.9-4.4)
<b>Direct Radiation</b>						
Ambient Radiation (mrem/91 days)	OSLD (364)	0.1	12.2 (320/320) (8.7-32)	Taylor's Island DR23 12.4 km ENE	17.0 (12/12) (16.4-17.4)	14.3 (44/44) (12.1-17.0)

<sup>1</sup> Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements at specified location is indicated in parentheses.

<sup>2</sup> Distance and direction from the central point between the two containment buildings.

### **III. INDEPENDENT SPENT FUEL STORAGE INSTALLATION RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

#### **III.A. INTRODUCTION**

In August 1990 BGE initiated a program of additional radiological environmental monitoring around the site for the Independent Spent Fuel Storage Installation (ISFSI). The first dry fuel storage canister was loaded into the ISFSI in November of 1993 with more canisters being loaded in subsequent years. In 2021, the site transitioned to Holtec Hi-storm (Holtec International Storage Module) vertically ventilated storage overpack system for Independent Spent Fuel Storage installation. In 2022 there were three such canisters of spent fuel transferred to the ISFSI.

Results of the monitoring program for the ISFSI for the current period are included in this report.

This report presents the content of the ISFSI REMP (Table 3), the ISFSI sampling locations (Appendix A), the summary of the analytical results of the period (Table 4), and a compilation of the analytical data for the period (Appendix B). Interpretation of the data and conclusions are presented in the body of the report.

The ISFSI monitoring program is as described in this section of the report.

The results were compared with that generated during the previous ISFSI pre-operational periods (Ref.11) and the current and previous CCNPP REMP periods. These results are discussed in more detail in Section III. C.

#### **III.B. PROGRAM**

##### **III.B.1 Objectives**

The objectives of the radiological environmental monitoring program for the ISFSI are:

- a. To satisfy the community concern regarding the impact of the ISFSI on the environment,
- b. To verify that radioactivity and ambient radiation levels attributable to operation of the ISFSI are within the limits specified in the Environmental Radiation Protection Standards as stated in 40CFRPart190 and 10CFR72.104,
- c. To detect any measurable buildup of long-lived radionuclides in the environment due to the ISFSI,
- d. To monitor and evaluate ambient radiation levels around the ISFSI, and
- e. To determine whether any statistically significant increase occurs in the concentration of radionuclides near the ISFSI.

### **III.B.2 Sample Collection**

The locations of the individual sampling sites are listed in Table A-2 and shown in Figures A-4 and A-5. All samples were collected by contractors to, or personnel of, Constellation Generation Solutions (CGS) personnel according to Constellation Generation Solutions Laboratory Procedures (Ref. 7).

### **III.B.3 Data Interpretation**

Many results in environmental monitoring occur at or below the minimum detectable activity (MDA). In this report, all results at or below the relevant MDA are reported as being "less than" the MDA value which is the minimum detectable activity for each nuclide in that sample at the time of analysis.

### **III.B.4 Program Exceptions**

There were no program exceptions for the ISFSI Monitoring Program in 2022.

## **III.C. RESULTS AND DISCUSSIONS**

All the environmental samples collected were analyzed using Constellation Generation Solutions (CGS) laboratory procedures (Ref. 8). The analytical results for this reporting period are presented in Appendix B and are also summarized for the period in Table 4. For discussion, the analytical results are divided into three categories. The categories are Atmospheric Environment, Terrestrial Environment, and Direct Radiation. These categories are further divided into subcategories according to sample type (e.g., Vegetation and Soil for Terrestrial Environment).

### **III.C.1 Atmospheric Environment**

The atmospheric environment was monitored by analyzing air particulate filters. These samples were collected from five locations surrounding the ISFSI.

No source of airborne radioiodine exists for the ISFSI. Airborne radioiodine is, therefore, not considered in assessing the radiological impact of the ISFSI.

#### **III.C.1.a Air Particulate Filters**

Weekly composite air particulate filter samples were collected from five locations during the period. These locations are On Site Before the Entrance to Camp Conoy (sample code A1), Meteorological Station (sample code SFA1), CCNPP Visitor's Center (sample code SFA2), NNW of the ISFSI (sample code SFA3), and SSE of the ISFSI (sample code SFA4). Sample locations A1, SFA1, SFA3, and SFA4 are in common with CCNPP REMP Program. All samples were analyzed for beta radioactivity and gamma emitting radionuclides.

Weekly analyses for beta activity on air particulate filters collected from all five locations showed values characteristic of levels routinely observed in the REMP. These values ranged from  $0.9 \times 10^{-2}$  to  $4.4 \times 10^{-2}$  pCi/m<sup>3</sup> for the indicator locations and  $1.0 \times 10^{-2}$  to  $4.5 \times 10^{-2}$  pCi/m<sup>3</sup> for the control location. The location with the highest overall mean of  $2.1 \times 10^{-2}$  pCi/m<sup>3</sup> was A1, On Site Before Entrance to Camp Conoy.

Gamma spectrometric analyses of quarterly composited air particulate samples exhibited no detectable concentrations of any plant-related radionuclides in any of these samples. Naturally occurring radionuclides, such as Be-7, were detected in nearly all samples.

### **III.C.2 Terrestrial Environment**

The terrestrial environment was monitored by analyzing samples of vegetation and soil collected quarterly from the vicinity of the air sampling locations for the ISFSI.

#### **III.C.2.a Vegetation**

Vegetation samples were collected quarterly from five locations during the year. These locations are Meteorological Station (sample code SFB1), CCNPP Visitor's Center (sample code SFB2), NNW of the ISFSI (sample code SFB3), SSE of the ISFSI (sample code SFB4), and On Site Before the Entrance to Camp Conoy (sample code SFB5).

No detectable concentrations of plant-related radionuclides were found in any of these samples. Naturally occurring radionuclides such as K-40 were detected in all samples.

#### **III.C.2.b Soils**

Soil samples were collected quarterly from five locations surrounding the ISFSI in the vicinity of the air samplers. These locations are: Meteorological Station (sample code SFS1), CCNPP Visitor's Center (sample code SFS2), NNW of the ISFSI (sample code SFS3), SSE of the ISFSI (sample code SFS4), and On Site before the Entrance to Camp Conoy (sample code SFS5).

Soil samples were analyzed for gamma emitting radionuclides. Cesium-137 was detected in four quarterly samples from indicator locations. The Cs-137 concentrations ranged from  $70.6 \pm 46$  to  $146 \pm 62$  pCi/kg. While the presence of Cs-137 in these samples may be plant-related, this range is consistent with that found to be due to the residual fallout from past atmospheric nuclear weapons testing. The activities of this radionuclide are well below the federal limits established in 40CFR190 and 10CFR72.104. These are comparable to those observed in previous annual reporting periods for the CCNPP REMP and in the earlier pre-operational data for the ISFSI. No detectable concentrations of plant-related radionuclides were found in any of these samples. Naturally occurring radionuclides such as K-40 were also detected in all these samples.

### **III.C.3 Direct Radiation**

Direct radiation is measured by a network of Environmental Dosimeters (OSLDs) surrounding the ISFSI. These dosimeters are collected quarterly from nineteen locations surrounding the ISFSI, plus one control location at the Visitor's Center (sample code SFDR7). The locations

include On Site Before the Entrance to Camp Conoy (sample code DR7, common to both the CCNPP Program and the ISFSI Program) and the Meteorological Station (sample code DR30, previously a location maintained for historical continuity.) The other sampling locations are SW of ISFSI (sample code SFDR1); N of ISFSI (sample code SFDR2); North of ISFSI (sample code SFDR3); NE of ISFSI (sample code SFDR4); East of ISFSI (sample code SFDR5); ESE of ISFSI (sample code SFDR6); NNW of ISFSI (sample code SFDR8); SSE of ISFSI (sample code SFDR9); NW of ISFSI (sample code SFDR10); WNW of ISFSI (sample code SFDR11); WSW of ISFSI (sample code SFDR12); South of ISFSI (sample code SFDR13); SE of ISFSI (sample code SFDR14); ENE of ISFSI (sample code SFDR15); SW of ISFSI (sample code SFDR16); NNE of ISFSI (sample code SFDR17) and West of ISFSI (sample code SFDR18). Sampling locations are shown on Figures A-4 and A-5.

The 2022 mean 91-day ambient radiation measured at the ISFSI indicator locations was 37.7 mrem and ranged from 9.8 to 127 mrem as reported in Table 4. The control location showed a 91-day mean of 14.8 mrem and ranged from 14.4 to 15.1 mrem. The location with the highest overall mean of 82.2 mrem with a range of 78.2 to 89.2 mrem was SFDR14, SE of ISFSI. These readings are consistent with those expected from the storage of spent fuel in the ISFSI. A comparison of the average monthly radiation levels per calendar year of the ISFSI dosimeter data from the indicator locations with the ISFSI control location at the Visitor's Center, SFDR7, can be seen in Figure 7.

Facility-related dose was detected NE of ISFSI (sample code SFDR4); East of ISFSI (sample code SFDR5); ESE of ISFSI (sample code SFDR6); SSE of ISFSI (sample code SFDR9); South of ISFSI (sample code SFDR13); SE of ISFSI (sample code SFDR14); ENE of ISFSI (sample code SFDR15); SW of ISFSI (sample code SFDR16). This is expected as additional spent fuel casks are generally installed at the ISFSI each year. The ISFSI OSLDs are located directly around the perimeter of the ISFSI. Due to the proximity of these OSLDs to the spent fuel storage structures, they detect the small increase in radiation exposure each year. However, it is clear from Figure 4a that there is no observable direct radiation exposure of the public from the ISFSI, as the other REMP dosimeters (on-site, 4 miles, and beyond) show no observable increase in exposure when compared to control Dosimeters.

The 2022 mean 91-day Facility-related dose measured at the indicator locations was 43.0 mrem and ranged from 5.22 to 103 mrem. Facility-related dose was not detected at the control location. The location with the highest overall mean of 64.2 mrem was Southeast of ISFSI (sample code SFDR14 which ranged from 60.2 to 71.2 mrem. A summary of the 2022 results is shown in the table below.


<b>2022 ISFSI Facility-related Dose Quarterly (91-Day) Summary</b>		
	<b>Mean Exposure (mrem)</b>	<b>Range (mrem)</b>
Indicator Locations	43.0	5.22-103
Control Location	Not Detected	N/A
Highest Overall Location (SFDR14)	64.2	60.2-71.2

### **III.D. CONCLUSION**

Low levels of Cs-137 were observed in the environment surrounding the ISFSI during the period. The Cs-137 observations were attributed to fallout from past atmospheric weapons testing. No plant-related radionuclides were observed in the environs of the ISFSI.

In general, the results in the following tables continue the historical trends previously observed at the official sites of the CCNPP REMP.

**FIGURE 7**  
**Mean Dosimeter Gamma Dose, ISFSI**

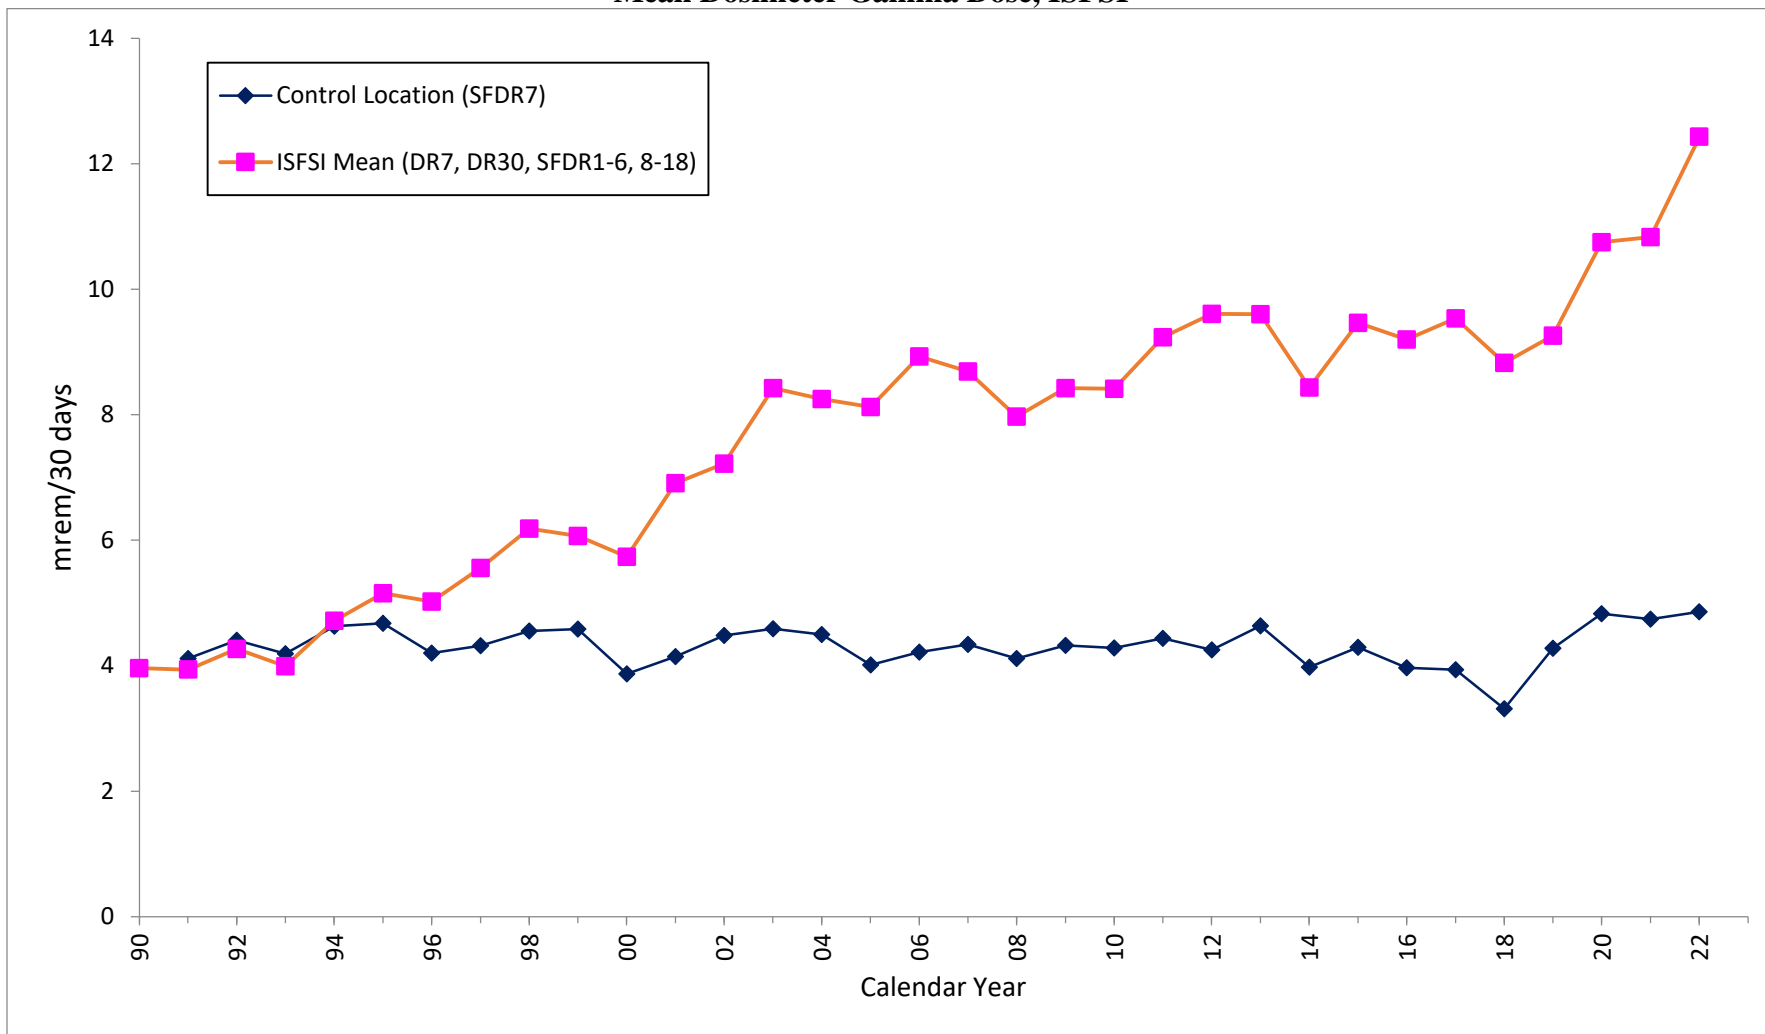

**Table 3**

**Synopsis of 2022 Calvert Cliffs Nuclear Power Plant  
Independent Spent Fuel Storage Installation  
Radiological Environmental Monitoring Program**

Sample Type	Sampling Frequency <sup>1</sup>	Number of Locations	Number Collected	Analysis	Analysis Frequency <sup>1</sup>	Number Analyzed
<b>Atmospheric Environment</b>						
Air Particulates <sup>2</sup>	W	5	260	Gross Beta	W	260
				Gamma	QC	20
<b>Direct Radiation</b>						
Ambient Radiation	Q	20	320	OSLD	Q	320
<b>Terrestrial Environment</b>						
Vegetation	Q	5	20	Gamma	Q	20
Soil	Q	5	20	Gamma	Q	20

<sup>1</sup> W=weekly, M=monthly, Q=quarterly, SA=semiannual, A=annual, C=composite

<sup>2</sup> Beta counting is performed after >72-hour decay, Gamma spectroscopy performed on monthly composites of weekly samples



**Table 4**  
**Annual Summary of Radioactivity in the Environs of the**  
**Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation**

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range <sup>1</sup>	Location with Highest Annual Mean Name/Distance & Direction <sup>2</sup>	Highest Annual Mean (F) / Range <sup>1</sup>	Control Locations Mean (F)/Range
<b>Atmospheric Environment</b>						
Air Particulates (10 <sup>-2</sup> pCi/m <sup>3</sup> )	Gross Beta (260)	0.5	2.0 (208/208) (0.9-4.4)	NNW of ISFSI SFA3 0.1 km NNW	2.1 (52/52) (1.0-4.1)	2.1 (52/52) (1.0-4.5)
<b>Direct Radiation</b>						
Ambient Radiation (mrem/91 days)	OSLDs (320)	0.1	37.7 (304/304) (9.8 - 127)	SE of ISFSI SFDR14 0.1 km SE	82.2 (16/16) (78.2 - 89.2)	14.8 (16/16) (14.4-15.1)
<b>Terrestrial Environment</b>						
Soil (pCi/kg)	Gamma (20) Cs-137	180	122 (4/16) (70.6-146)	NNW of ISFSI SFS3 0.1 km NNW	140 (3/4) (133-146)	-- --

<sup>1</sup> Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements at specified location is indicated in parentheses.

<sup>2</sup> Distance and direction from the central point between the two containment buildings.

#### **IV. REFERENCES**

- (1) Cohen, L. K., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 882 Semiannual Report January-June 1971, December 1971; NUS No. 1025 Annual Report 1971, March 1973.
- (2) Cohen, L. K., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1137 Annual Report 1972, December 1973.
- (3) Cohen, L. K. and Malmberg, M.S., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1188, Annual Report 1973, October 1974.
- (4) Malmberg, M. S., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1333, Data Summary Report, September 1970 to September 1974, July 1975
- (5) Calvert Cliffs Nuclear Power Plant, Units 1 and 2, License Nos. DPR-53 and DPR-69, Technical Specification 5.6.2; Annual Radiological Environmental Operating Report.
- (6) CY-CA-170-301 Current Revision, Offsite Dose Calculation Manual for the Calvert Cliffs Nuclear Power Plant.
- (7) Constellation Generation Solutions Sampling Procedures
  - a. CY-ES-214, Collection of RGPP Water Samples for Radiological Analysis
  - b. CY-ES-237, Air Iodine and Air Particulate Sample Collection for Radiological
  - c. CY-ES-239, EIS Collection Exchange of Field Dosimeters for Radiological Analysis
  - d. CY-ES-241, Vegetation Sample Collection for Radiological Analysis
  - e. CY-ES-242, Soil and Sediment Sample Collection for Radiological Analysis
  - f. CY-ES-247, Precipitation Sampling and Collection for Radiological Analysis
- (8) Constellation Generation Solutions Analytical Procedures
  - a. CY-ES-204, Sample Preparation for Gamma Analysis
  - b. CY-ES-205, Operation of HPGe Detectors with the Genie PC Counting System
  - c. CY-ES-206, Operation of the Tennelec S5E Proportional Counter
  - d. CY-ES-246, Sample Preparation for Gross Beta Analysis
- (9) Land Use Census Around Calvert Cliffs Nuclear Power Plant, August 2022
- (10) Calvert Cliffs Independent Spent Fuel Storage Installation Technical Specifications, Appendix A to Materials License SNM-2505
- (11) Baltimore Gas and Electric Company, Radiological Environmental Monitoring Program Pre-Operational Report for the Calvert Cliffs Independent Spent Fuel Storage Installation, August 1990 - November 1993, February 1994.

- (12) CY-AA-110-200, Current Revision, Sampling
- (13) CY-AA-170-1000, Radiological Environmental Monitoring Program (REMP) and Meteorological Program Implementation.
- (14) Teledyne Browne Engineering, (TBE) 2018 Analysis Procedures Current Revisions
  - a. TBE-2001 Alpha Isotopic and Pu-241
  - b. TBE-2006 Iron-55 Activity in Various Matrices
  - c. TBE-2007 Gamma Emitting Radioisotope Analysis
  - d. TBE-2008 Gross Alpha and/or Gross Beta Activity in Various Matrices
  - d. TBE-2011 Tritium Analysis in Drinking Water by Liquid Scintillation
  - e. TBE-2013 Radionickel Activity in Various Matrices
  - f. TBE-2019 Radiostrontium Analysis by Ion Exchange
- (15) Normandeau Associates, Inc. (NAI) Sampling Procedures Current Revisions
  - a. Procedure No. ER20 Collection of Bottom Sediment for Radiological Analysis (Calvert Cliffs Nuclear Power Plant)
  - b. Procedure No. ER21 Collection of Fish Samples for Radiological Analysis (Calvert Cliffs Nuclear Power Plant)
  - c. Procedure No. ER22 Collection of Oyster Samples for Radiological Analysis (Calvert Cliffs Nuclear Power Plant)
- (16) EN-CA-408-4160 Current Revision, RGPP Reference Material for Calvert Cliffs
- (17) Landauer Incorporated, Analysis procedure proprietary, Current Revision

## **APPENDIX A**

### **Sample Locations for the REMP and the ISFSI**

Appendix A contains information concerning the environmental samples which were collected during this operating period.

Sample locations and specific information about individual locations for the CCNPP REMP are given in Table A-1. Figure A-1 shows the location of the CCNPP in relation to Southern Maryland and the Chesapeake Bay. Figures A-2 and A-3 show the locations of the power plant sampling sites in relation to the plant site at different degrees of detail.

Sample locations and specific information about individual locations for the ISFSI radiological environmental monitoring program are given in Table A-2. Figures A-4 and A-5 show the locations of the ISFSI sampling sites in relation to the plant site at different degrees of detail.

**TABLE OF CONTENTS - SAMPLING LOCATIONS**

Table	Title	Page
A-1	Locations of Environmental Sampling Stations for the Calvert Cliffs Nuclear Power Plant .....	36
A-2	Locations of Environmental Sampling Stations for the Independent Spent Fuel Storage Installation at Calvert Cliffs .....	40

Figure	Title	Page
A-1	Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant .....	37
A-2	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-2 Miles .....	38
A-3	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-10 Miles .....	39
A-4	Independent Spent Fuel Storage Installation Sampling Locations .....	41
A-5	Enlarged Map of the Independent Spent Fuel Storage Installation Sampling Locations ..	42

**TABLE A-1**

**Locations of Environmental Sampling Stations  
for the Calvert Cliffs Nuclear Power Plant**


Station	Description	Distance <sup>1</sup>		Direction <sup>1</sup> (Sector)
		(KM)	(Miles)	
A1 <sup>2</sup>	On Site Before Entrance to Camp Conoy	0.7	0.5	S
A2	Camp Conoy Rd, at emergency siren	2.5	1.5	SSE
A3	Bay Breeze Rd	2.6	1.6	SE
A4	Route 765, Lusby	2.9	1.8	SSW
A5	Emergency Operations Facility	19.3	12.1	WNW
DR01	On Site, along Cliffs	0.6	0.4	NW
DR02	Route 765, Auto Dump	2.7	1.7	WNW
DR03	Route 765, Giovanni's Tavern (Knotty Pine)	2.3	1.4	W
DR04	Route 765, across from Vera's Beach Club	2.0	1.2	WSW
DR05	Route 765, John's Creek	2.4	1.5	SW
DR06	Route 765, Lusby	2.9	1.8	SSW
DR07 <sup>2</sup>	On Site Before Entrance to Camp Conoy	0.7	0.5	S
DR08	Camp Conoy Rd at Emergency Siren	2.5	1.5	SSE
DR09	Bay Breeze Rd	2.6	1.6	SE
DR10	Calvert Beach Rd and Decatur Street	6.4	4.0	NW
DR11	Dirt road off Mackall & Parren Rd	6.6	4.1	WNW
DR12	Mackall & Bowen Rds	6.7	4.2	W
DR13	Mackall Rd, near Wallville	6.1	3.8	WSW
DR14	Rodney Point	6.4	4.0	SW
DR15	Mill Bridge & Turner Rds	6.2	3.9	SSW
DR16	Across from Appeal School	6.5	4.1	S
DR17	Cove Point & Little Cove Point Rds	5.9	3.7	SSE
DR18	Cove Point	7.1	4.5	SE
DR19	Long Beach	4.4	2.8	NW
DR20	On site, near shore	0.4	0.3	NNW
DR21	Emergency Operations Facility (EOF)	19.3	12.1	WNW
DR22	Solomons Island	12.5	7.8	S
DR23	Taylor's Island, Anderson's Property	12.4	7.7	ENE
IA1	Discharge Area	0.3	0.2	N
IA2	Discharge Vicinity	0.3	0.2	N
IA3	Camp Conoy	0.9	0.6	E
IA4	Patuxent River	(Area not influenced by plant)		Patuxent
IA5	Patuxent river			River
IA6	Kenwood Beach	10.7	6.7	NNW
IB10	Meteorological Station	0.7	0.4	SW
IB11	Meteorological Station	0.7	0.4	SW
IB12	Meteorological Station	0.7	0.4	SW
IB4	On site, before entrance to Camp Conoy	0.7	0.5	S
IB5	On site, before entrance to Camp Conoy	0.7	0.5	S
IB6	On site, before entrance to Camp Conoy	0.7	0.5	S
IB7	Emergency offsite facility	19.3	12.1	WNW
IB8	Emergency offsite facility	19.3	12.1	WNW
IB9	Emergency offsite facility	19.3	12.1	WNW
SFA1 <sup>2</sup>	Meteorological Station	0.7	0.4	SW
SFA3 <sup>2</sup>	NNW of ISFSI	0.6	0.4	SSW
SFA4 <sup>2</sup>	SSE of ISFSI	0.8	0.5	SSW
WA1	Intake area	0.2	0.1	NNE
WA2	Discharge area	0.3	0.2	N
WB1	Shoreline at Barge Rd.	0.6	0.4	ESE

<sup>1</sup> Distance and direction from the central point between the two containment buildings

<sup>2</sup> Common to both the REMP and ISFSI monitoring program

Figure A-1

Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant

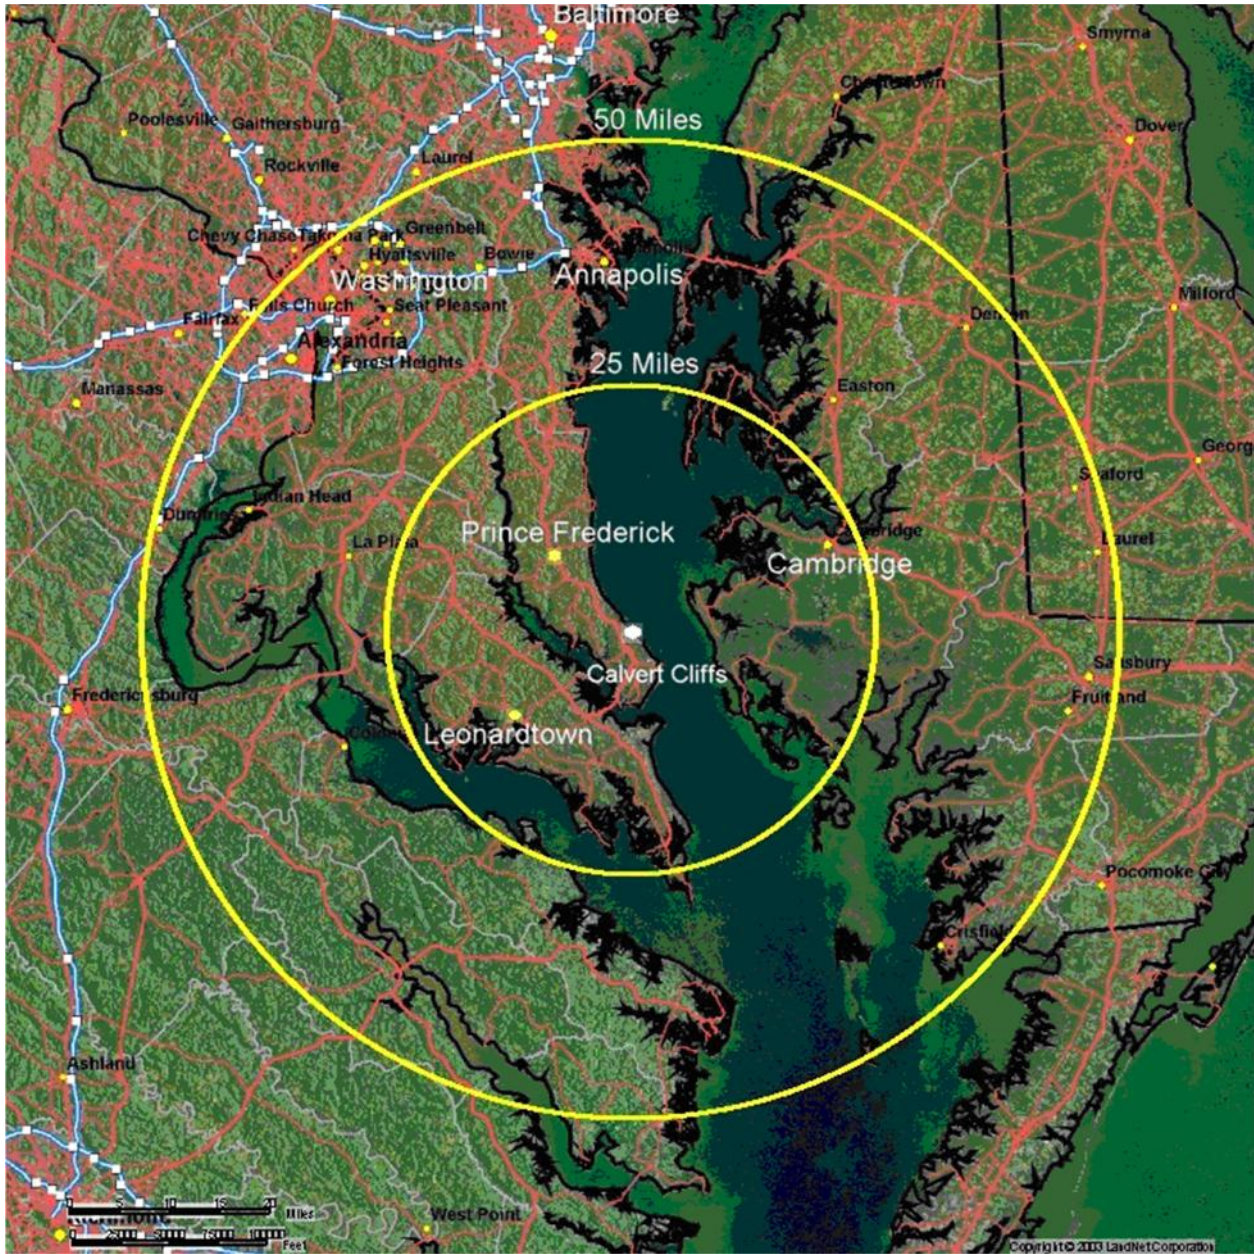

**Figure A-2**  
**Calvert Cliffs Nuclear Power Plant Sampling Locations**  
**0-2 Miles**

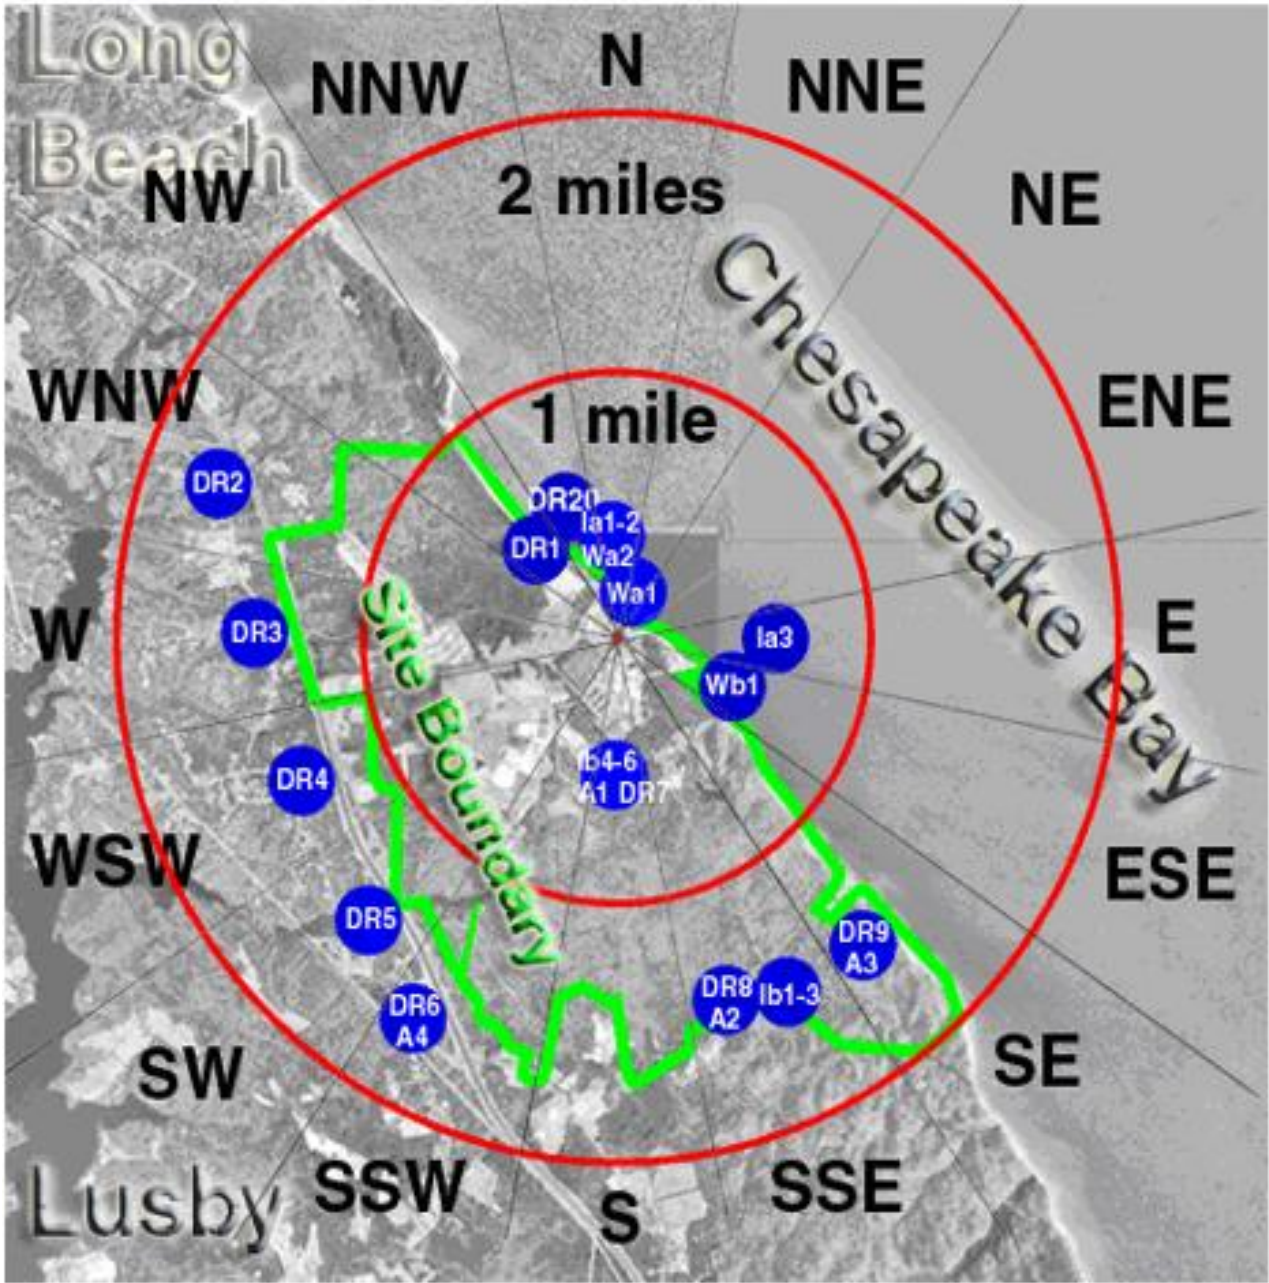




Figure A-3  
Calvert Cliffs Nuclear Power Plant Sampling Locations  
0-10 Miles



**Table A-2**

**Locations of Environmental Sampling Stations for the  
Independent Spent Fuel Storage Installation at Calvert Cliffs**

Station	Description	Distance <sup>1</sup>	Direction <sup>1</sup>
		(KM)	(Sector)
Air Particulate			
A1 <sup>2</sup>	On Site Before Entrance to Camp Conoy	0.3	ESE
SFA1 <sup>2</sup>	Meteorological Station	0.3	NW
SFA2	CCNPP Visitor's Center	0.8	N
SFA3 <sup>2</sup>	NNW of ISFSI	0.1	NNW
SFA4 <sup>2</sup>	SSE of ISFSI	0.1	SSE
Direct Radiation			
DR07 <sup>2</sup>	On Site Before Entrance to Camp Conoy	0.3	ESE
DR30	Meteorological Station	0.3	NW
SFDR01	SW of ISFSI	0.2	SW
SFDR02	N of ISFSI	0.2	N
SFDR03	North of ISFSI	0.1	N
SFDR04	NE of ISFSI	<0.1	NE
SFDR05	East of ISFSI	<0.1	E
SFDR06	ESE of ISFSI	0.1	ESE
SFDR07	CCNPP Visitor's Center	0.8	N
SFDR08	NNW of ISFSI	0.1	NNW
SFDR09	SSE of ISFSI	0.1	SSE
SFDR10	NW of ISFSI	0.1	NW
SFDR11	WNW ISFSI	0.1	WNW
SFDR12	WSW of ISFSI	<0.1	WSW
SFDR13	South of ISFSI	<0.1	S
SFDR14	SE of ISFSI	0.1	SE
SFDR15	ENE of ISFSI	<0.1	ENE
SFDR16	SW of ISFSI	<0.1	SW
SFDR17	NNE of ISFSI	0.1	NNE
SFDR18	West of ISFSI	0.04	W
Vegetation			
SFB1	ISFSI Vegetation Met Station	0.3	NW
SFB2	ISFSI Vegetation Visitors Center	0.8	N
SFB3	ISFSI Vegetation NNW of ISFSI	0.1	NNW
SFB4	ISFSI vegetation SSE of ISFSI	0.1	SSE
SFB5	On Site Before Entrance to Camp Conoy	0.3	ESE
Soil			
SFS1	ISFSI Soil Meteorological Station	0.3	NW
SFS2	ISFSI Soil CCNPP Visitors Center	0.8	N
SFS3	ISFSI Soil NNW of ISFSI	0.1	NNW
SFS4	ISFSI Soil SSE of ISFSI	0.1	SSE
SFS5	ISFSI Soil On Site Before entrance to Camp Conoy	0.3	ESE

<sup>1</sup> Distance and direction from the central point of the ISFSI

<sup>2</sup> Common to both the REMP and ISFSI monitoring program

Figure A-4

Independent Spent Fuel Storage Installation Sampling Locations


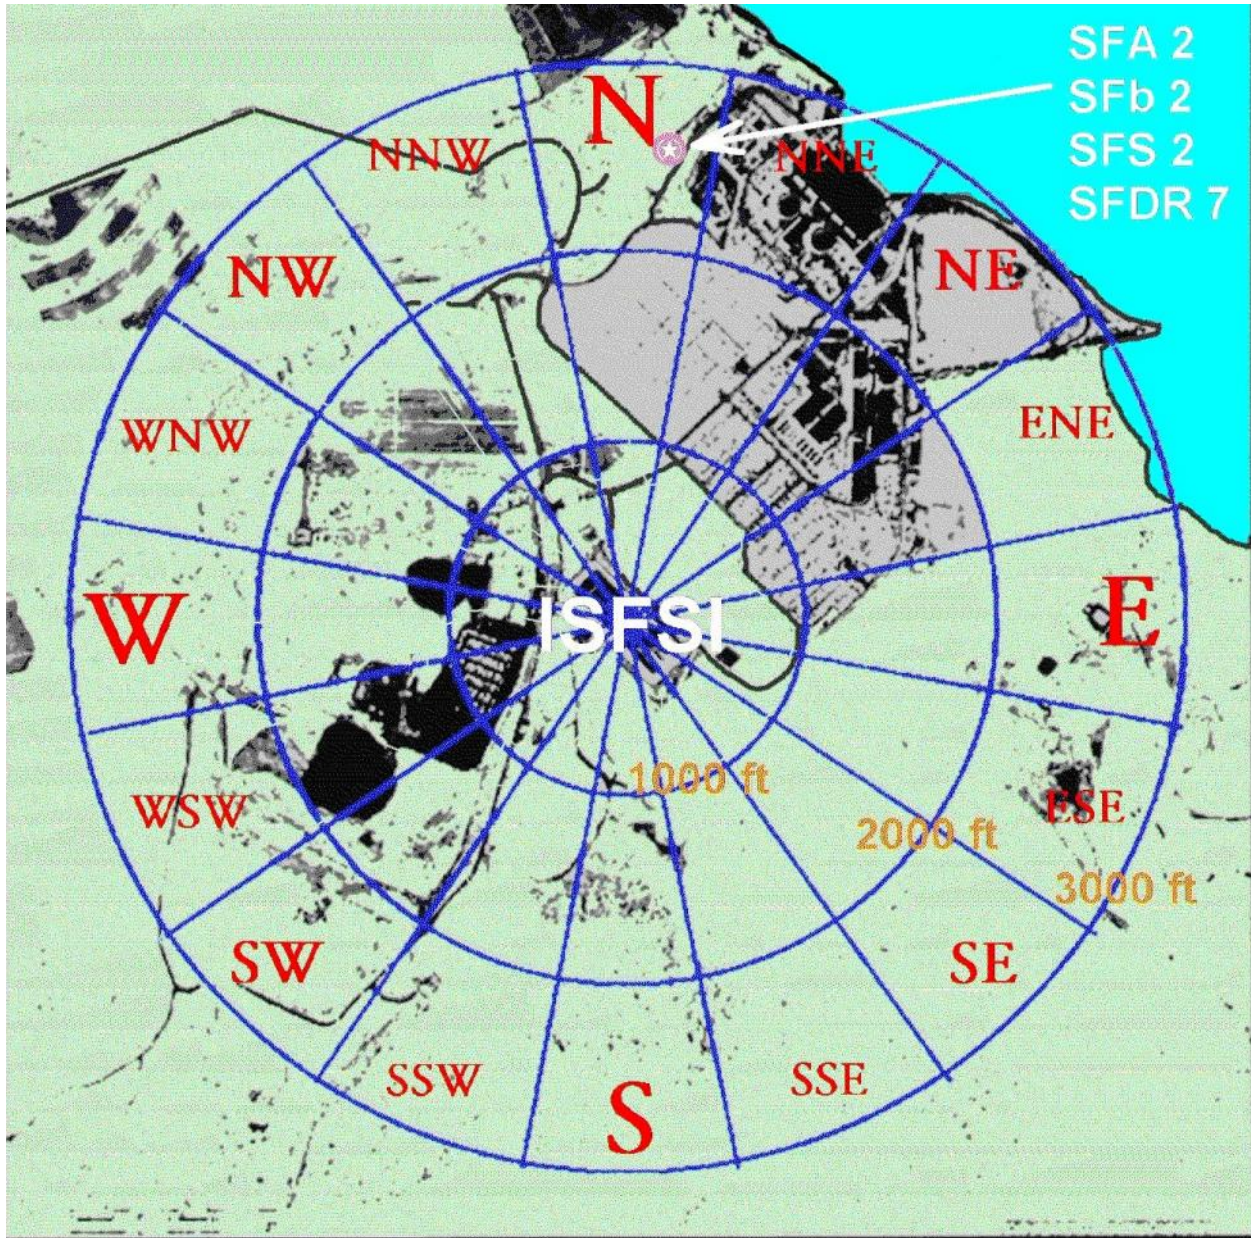


Figure A-5

Enlarged Map of the Independent Spent Fuel Storage Installation  
Sampling Locations

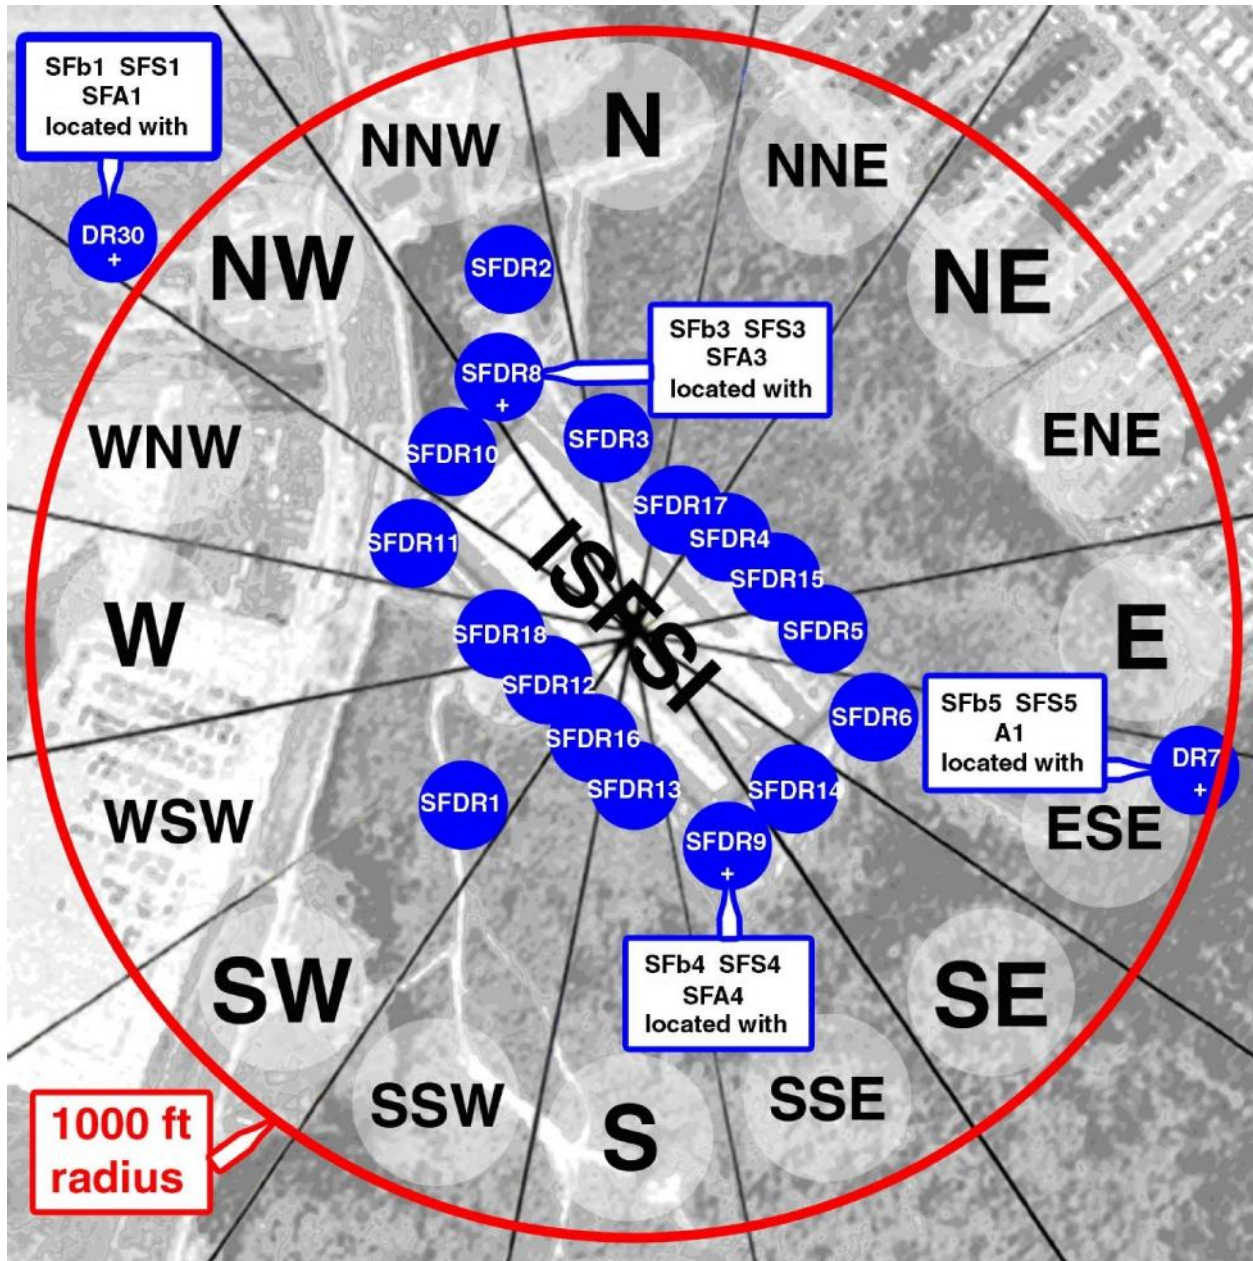

**APPENDIX B**  
**Analysis Results for the REMP and the ISFSI**

Appendix B is a presentation of the analytical results for the CCNPP and the ISFSI radiological environmental monitoring programs.

**TABLE OF CONTENTS - ANALYTICAL RESULTS**

---

Table	Title	Page
B-1	Concentration of Tritium and Gamma Emitters in Bay Water .....	45
B-2	Concentration of Gamma Emitters in the Flesh of Edible Fish .....	46
B-3	Concentration of Gamma Emitters in Oyster Samples .....	47
B-4	Concentration of Gamma Emitters in Shoreline Sediment.....	48
B-5	Concentration of Iodine-131 in Filtered Air .....	49
B-6	Concentration of Beta Emitters in Air Particulates.....	51
B-6	Concentration of Beta Emitters in Air Particulates.....	53
B-7	Concentration of Gamma Emitters in Air Particulates .....	55
B-8a	Concentration of Gamma Emitters in Vegetation Samples .....	56
B-8b	Concentration of Gamma Emitters in Vegetation From Locations Around the ISFSI.....	58
B-9	Concentration of Gamma Emitters in Soil Samples From Locations Around the ISFSI ..	59
B-10	Typical MDA Ranges for Gamma Spectrometry .....	60
B-11	Typical LLDs for Gamma Spectrometry .....	61
B-12	Direct Radiation .....	62

---

**Table B-1**

**Concentration of Tritium and Gamma Emitters in Bay Water  
(Results in units of pCi/L  $\pm$  2 )**

Sample Code	Sample Date	Gamma Emitters	H-3 <sup>1</sup>
<hr/>			
WA1			
Intake Vicinity	1/28/2022	*	
	3/3/2022	*	
	3/30/2022	*	<177
	4/29/2022	*	
	6/2/2022	*	
	7/1/2022	*	<181
	7/29/2022	*	
	9/2/2022	*	
	9/30/2022	*	<180
	10/28/2022	*	
	11/29/2022	*	
	12/29/2022	*	<183
<hr/>			
WA2			
Discharge Vicinity	1/28/2022	*	
	3/3/2022	*	
	3/30/2022	*	187+/-117
	4/29/2022	*	
	6/2/2022	*	
	7/1/2022	*	<175
	7/29/2022	*	
	9/2/2022	*	
	9/30/2022	*	599 +/- 138
	10/28/2022	*	
	11/29/2022	*	
	12/29/2022	*	<184

<sup>1</sup> Quarterly composite of monthly samples.  
\* All Non-Natural Gamma Emitters <MDA

**Table B-2**

**Concentration of Gamma Emitters in the Flesh of Edible Fish  
(Results in units of pCi/kg (wet)  $\pm 2$  )**

Sample Code	Sample Date	Sample Type	Gamma Emitters
IA1 Discharge Area	8/24/2022	Blue Fish	*
IA2 Discharge Area	8/24/2022	Spanish Mackerel	*
IA4 <sup>1</sup> Patuxent River	8/24/2022	Blue Fish	*
IA5 <sup>1</sup> Patuxent River	8/24/2022	Spanish Mackerel	*

<sup>1</sup> Control Location

\* All Non-Natural Gamma Emitters <MDA



**Table B-3**

**Concentration of Gamma Emitters in Oyster Samples  
(Results in units of pCi/kg (wet)  $\pm 2$  )**

Sample Code	Sample Date	Gamma Emitters
IA3 Camp Conoy	3/25/2022	*
	6/21/2022	*
	8/24/2022	*
	10/11/2022	*
IA6 <sup>1</sup> Kenwood Beach	3/25/2022	*
	6/21/2022	*
	8/24/2022	*
	10/11/2022	*

<sup>1</sup> Control Location

\* All Non-Natural Gamma Emitters <MDA

**Table B-4**

**Concentration of Gamma Emitters in Shoreline Sediment  
(Results in units of pCi/kg (dry)  $\pm 2$  )**

Sample Code	Sample Date	Gamma Emitters
WB1		
Shoreline at Barge Rd.	05/02/2022	*
	10/03/2022	*

\* All Non-Natural Gamma Emitters <MDA

**Table B-5**

**Concentration of Iodine-131 in Filtered Air  
(Results in units of  $10^{-3}$  pCi/m<sup>3</sup> ± 2 )**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 <sup>1</sup> EOF	SFA1 <sup>2</sup> Met Sta	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI
1/4/2022	1/10/2022	*	*	*	*	*	*	*	*
1/10/2022	1/18/2022	*	*	*	*	*	*	*	*
1/18/2022	1/24/2022	*	*	*	*	*	*	*	*
1/24/2022	1/31/2022	*	*	*	*	*	*	*	*
1/31/2022	2/7/2022	*	*	*	*	*	*	*	*
2/7/2022	2/15/2022	*	*	*	*	*	*	*	*
2/15/2022	2/21/2022	*	*	*	*	*	*	*	*
2/21/2022	3/1/2022	*	*	*	*	*	*	*	*
3/1/2022	3/7/2022	*	*	*	*	*	*	*	*
3/7/2022	3/14/2022	*	*	*	*	*	*	*	*
3/14/2022	3/21/2022	*	*	*	*	*	*	*	*
3/21/2022	3/28/2022	*	*	*	*	*	*	*	*
3/28/2022	4/4/2022	*	*	*	*	*	*	*	*
4/4/2022	4/11/2022	*	*	*	*	*	*	*	*
4/11/2022	4/18/2022	*	*	*	*	*	*	*	*
4/18/2022	4/25/2022	*	*	*	*	*	*	*	*
4/25/2022	5/2/2022	*	*	*	*	*	*	*	*
5/2/2022	5/9/2022	*	*	*	*	*	*	*	*
5/9/2022	5/16/2022	*	*	*	*	*	*	*	*
5/16/2022	5/23/2022	*	*	*	*	*	*	*	*
5/23/2022	5/31/2022	*	*	*	*	*	*	*	*
5/31/2022	6/6/2022	*	*	*	*	*	*	*	*
6/6/2022	6/13/2022	*	*	*	*	*	*	*	*
6/13/2022	6/20/2022	*	*	*	*	*	*	*	*
6/20/2022	6/27/2022	*	*	*	*	*	*	*	*
6/27/2022	7/5/2022	*	*	*	*	*	*	*	*
7/5/2022	7/11/2022	*	*	*	*	*	*	*	*
7/11/2022	7/18/2022	*	*	*	*	*	*	*	*
7/18/2022	7/25/2022	*	*	*	*	*	*	*	*
7/25/2022	8/1/2022	*	*	*	*	*	*	*	*
8/1/2022	8/8/2022	*	*	*	*	*	*	*	*
8/8/2022	8/15/2022	*	*	*	*	*	*	*	*
8/15/2022	8/22/2022	*	*	*	*	*	*	*	*
8/22/2022	8/29/2022	*	*	*	*	*	*	*	*
8/29/2022	9/6/2022	*	*	*	*	*	*	*	*
9/6/2022	9/12/2022	*	*	*	*	*	*	*	*
9/12/2022	9/19/2022	*	*	*	*	*	*	*	*
9/19/2022	9/26/2022	*	*	*	*	*	*	*	*
9/26/2022	10/3/2022	*	*	*	*	*	*	*	*

**Table B-5**

**Concentration of Iodine-131 in Filtered Air  
(Results in units of  $10^{-3}$  pCi/m<sup>3</sup> ± 2 )**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 <sup>1</sup> EOF	SFA1 <sup>2</sup> Met Sta	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI
10/3/2022	10/10/2022	*	*	*	*	*	*	*	*
10/10/2022	10/17/2022	*	*	*	*	*	*	*	*
10/17/2022	10/24/2022	*	*	*	*	*	*	*	*
10/24/2022	10/31/2022	*	*	*	*	*	*	*	*
10/31/2022	11/7/2022	*	*	*	*	*	*	*	*
11/7/2022	11/15/2022	*	*	*	*	*	*	*	*
11/15/2022	11/21/2022	*	*	*	*	*	*	*	*
11/21/2022	11/28/2022	*	*	*	*	*	*	*	*
11/28/2022	12/5/2022	*	*	*	*	*	*	*	*
12/5/2022	12/12/2022	*	*	*	*	*	*	*	*
12/12/2022	12/19/2022	*	*	*	*	*	*	*	*
12/19/2022	12/27/2022	*	*	*	*	*	*	*	*
12/27/2022	1/3/2023	*	*	*	*	*	*	*	*

<sup>1</sup> Control Location REMP Technical Specifications  
\* All Non-Natural Gamma Emitters <MDA

**Table B-6**

**Concentration of Beta Emitters in Air Particulates  
(Results in units of  $10^{-2}$  pCi/m<sup>3</sup> ± 2 )**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 <sup>1</sup> EOF
1/4/2022	1/10/2022	2.69 ± 0.16	2.41 ± 0.16	3.09 ± 0.18	2.75 ± 0.17	2.81 ± 0.19
1/10/2022	1/18/2022	2.44 ± 0.14	2.46 ± 0.15	2.75 ± 0.15	2.47 ± 0.14	2.44 ± 0.15
1/18/2022	1/24/2022	2.63 ± 0.16	2.14 ± 0.15	2.36 ± 0.16	2.23 ± 0.16	2.55 ± 0.16
1/24/2022	1/31/2022	2.26 ± 0.14	1.99 ± 0.14	2.29 ± 0.14	2.25 ± 0.15	2.15 ± 0.14
1/31/2022	2/7/2022	1.59 ± 0.12	1.44 ± 0.12	1.59 ± 0.12	1.81 ± 0.14	1.91 ± 0.13
2/7/2022	2/15/2022	2.31 ± 0.12	2.18 ± 0.13	2.40 ± 0.13	2.24 ± 0.12	2.37 ± 0.13
2/15/2022	2/21/2022	2.16 ± 0.15	1.96 ± 0.14	1.96 ± 0.14	1.99 ± 0.13	2.19 ± 0.15
2/21/2022	3/1/2022	1.98 ± 0.12	1.70 ± 0.11	1.99 ± 0.12	1.94 ± 0.11	2.06 ± 0.13
3/1/2022	3/7/2022	2.39 ± 0.15	2.22 ± 0.15	2.34 ± 0.16	2.52 ± 0.16	2.47 ± 0.16
3/7/2022	3/14/2022	1.17 ± 0.10	0.98 ± 0.10	1.19 ± 0.11	1.27 ± 0.11	1.21 ± 0.11
3/14/2022	3/21/2022	1.90 ± 0.13	1.61 ± 0.12	1.85 ± 0.13	1.78 ± 0.12	1.80 ± 0.13
3/21/2022	3/28/2022	1.62 ± 0.13	1.43 ± 0.12	1.49 ± 0.12	1.38 ± 0.11	1.39 ± 0.12
3/28/2022	4/4/2022	1.77 ± 0.13	1.50 ± 0.12	1.56 ± 0.12	1.56 ± 0.11	1.61 ± 0.12
4/4/2022	4/11/2022	0.96 ± 0.09	0.89 ± 0.10	1.01 ± 0.10	0.91 ± 0.10	0.95 ± 0.10
4/11/2022	4/18/2022	1.63 ± 0.13	1.36 ± 0.12	1.53 ± 0.12	1.51 ± 0.12	1.41 ± 0.12
4/18/2022	4/25/2022	1.77 ± 0.12	1.60 ± 0.12	1.79 ± 0.13	1.82 ± 0.13	1.69 ± 0.12
4/25/2022	5/2/2022	2.44 ± 0.14	2.21 ± 0.15	2.57 ± 0.15	2.37 ± 0.14	2.56 ± 0.16
5/2/2022	5/9/2022	1.27 ± 0.11	0.93 ± 0.10	1.29 ± 0.11	1.37 ± 0.11	1.30 ± 0.12
5/9/2022	5/16/2022	1.18 ± 0.11	0.95 ± 0.12	1.03 ± 0.10	1.16 ± 0.11	1.17 ± 0.12
5/16/2022	5/23/2022	2.01 ± 0.13	1.66 ± 0.14	1.94 ± 0.13	2.15 ± 0.13	2.14 ± 0.14
5/23/2022	5/31/2022	1.35 ± 0.11	1.00 ± 0.11	1.27 ± 0.10	1.34 ± 0.10	1.24 ± 0.11
5/31/2022	6/6/2022	2.28 ± 0.09	1.75 ± 0.08	2.31 ± 0.09	2.35 ± 0.09	2.19 ± 0.09
6/6/2022	6/13/2022	1.58 ± 0.10	1.46 ± 0.16	1.50 ± 0.18	1.59 ± 0.17	1.61 ± 0.18
6/13/2022	6/20/2022	2.01 ± 0.11	1.73 ± 0.11	1.70 ± 0.11	2.04 ± 0.10	1.96 ± 0.12
6/20/2022	6/27/2022	1.82 ± 0.14	1.60 ± 0.14	1.78 ± 0.12	1.81 ± 0.13	1.96 ± 0.14
6/27/2022	7/5/2022	1.79 ± 0.12	1.50 ± 0.12	1.65 ± 0.12	1.76 ± 0.12	1.78 ± 0.13
7/5/2022	7/11/2022	2.08 ± 0.12	1.69 ± 0.12	1.83 ± 0.13	1.99 ± 0.13	2.04 ± 0.13
7/11/2022	7/18/2022	2.30 ± 0.13	1.91 ± 0.12	2.04 ± 0.12	2.27 ± 0.13	2.03 ± 0.14
7/18/2022	7/25/2022	2.73 ± 0.13	2.18 ± 0.12	2.67 ± 0.12	2.90 ± 0.12	2.84 ± 0.11
7/25/2022	8/1/2022	2.05 ± 0.18	1.88 ± 0.16	2.02 ± 0.18	1.98 ± 0.20	2.13 ± 0.19

**Table B-6**  
**Concentration of Beta Emitters in Air Particulates**  
**(Results in units of  $10^{-2}$  pCi/m<sup>3</sup> ± 2 )**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 <sup>1</sup> EOF
8/1/2022	8/8/2022	1.98 ± 0.14	1.73 ± 0.14	1.97 ± 0.14	2.06 ± 0.13	1.94 ± 0.15
8/8/2022	8/15/2022	1.84 ± 0.14	1.48 ± 0.14	1.63 ± 0.15	1.78 ± 0.15	1.70 ± 0.14
8/15/2022	8/22/2022	2.06 ± 0.12	1.63 ± 0.11	1.87 ± 0.11	2.12 ± 0.11	2.26 ± 0.11
8/22/2022	8/29/2022	3.40 ± 0.10	2.99 ± 0.08	3.57 ± 0.09	3.64 ± 0.10	3.85 ± 0.10
8/29/2022	9/6/2022	3.29 ± 0.13	1.57 ± 0.12	1.84 ± 0.12	2.04 ± 0.13	2.23 ± 0.14
9/6/2022	9/12/2022	1.50 ± 0.13	1.25 ± 0.12	1.41 ± 0.13	1.42 ± 0.13	1.52 ± 0.13
9/12/2022	9/19/2022	2.67 ± 0.15	2.23 ± 0.14	2.39 ± 0.14	2.67 ± 0.15	2.57 ± 0.15
9/19/2022	9/26/2022	3.57 ± 0.17	3.17 ± 0.17	3.27 ± 0.16	3.83 ± 0.18	3.64 ± 0.17
9/26/2022	10/3/2022	1.54 ± 0.12	1.51 ± 0.12	1.39 ± 0.12	1.59 ± 0.12	1.42 ± 0.12
10/3/2022	10/10/2022	1.82 ± 0.13	1.83 ± 0.13	1.56 ± 0.12	1.89 ± 0.13	1.95 ± 0.12
10/10/2022	10/17/2022	3.10 ± 0.16	3.15 ± 0.16	3.01 ± 0.16	3.37 ± 0.17	3.38 ± 0.18
10/17/2022	10/24/2022	2.33 ± 0.14	2.22 ± 0.14	2.13 ± 0.14	2.35 ± 0.14	2.48 ± 0.15
10/24/2022	10/31/2022	1.09 ± 0.10	1.14 ± 0.10	1.03 ± 0.10	1.17 ± 0.11	1.16 ± 0.10
10/31/2022	11/7/2022	1.98 ± 0.15	2.11 ± 0.14	2.08 ± 0.14	2.27 ± 0.14	2.20 ± 0.14
11/7/2022	11/15/2022	1.47 ± 0.11	1.51 ± 0.11	1.46 ± 0.11	1.57 ± 0.12	1.66 ± 0.11
11/15/2022	11/21/2022	2.60 ± 0.16	2.73 ± 0.16	2.70 ± 0.16	3.25 ± 0.19	2.98 ± 0.17
11/21/2022	11/28/2022	4.12 ± 0.18	4.33 ± 0.18	4.14 ± 0.18	4.77 ± 0.19	4.44 ± 0.18
11/28/2022	12/5/2022	3.05 ± 0.16	3.23 ± 0.16	2.95 ± 0.15	3.41 ± 0.16	3.26 ± 0.16
12/5/2022	12/12/2022	2.55 ± 0.14	2.89 ± 0.15	2.63 ± 0.15	3.23 ± 0.16	3.13 ± 0.16
12/12/2022	12/19/2022	2.10 ± 0.14	2.05 ± 0.14	2.08 ± 0.14	2.35 ± 0.14	2.20 ± 0.14
12/19/2022	12/27/2022	2.54 ± 0.13	2.60 ± 0.14	2.62 ± 0.14	3.05 ± 0.15	3.01 ± 0.14
12/27/2022	1/3/2023	2.60 ± 0.14	2.68 ± 0.14	2.77 ± 0.15	2.93 ± 0.15	2.94 ± 0.14

<sup>1</sup> Control Location

**Table B-6 - Continued**

**Concentration of Beta Emitters in Air Particulates  
(Results in units of  $10^{-2}$  pCi/m<sup>3</sup> +/- 2†)**

Start Date	Stop Date	SFA1 Met Station	SFA2 <sup>1</sup> Visitors Center	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI
1/4/2022	1/10/2022	3.13 ± 0.17	2.68 ± 0.16	2.87 ± 0.17	2.70 ± 0.16
1/10/2022	1/18/2022	2.45 ± 0.14	2.31 ± 0.13	2.70 ± 0.14	2.54 ± 0.14
1/18/2022	1/24/2022	2.54 ± 0.16	2.35 ± 0.16	2.71 ± 0.17	2.30 ± 0.15
1/24/2022	1/31/2022	2.28 ± 0.14	2.00 ± 0.14	2.42 ± 0.15	2.26 ± 0.14
1/31/2022	2/7/2022	1.60 ± 0.12	1.52 ± 0.12	1.72 ± 0.13	1.82 ± 0.13
2/7/2022	2/15/2022	2.43 ± 0.13	2.44 ± 0.13	2.50 ± 0.14	2.31 ± 0.13
2/15/2022	2/21/2022	2.14 ± 0.15	2.16 ± 0.14	2.18 ± 0.15	1.92 ± 0.14
2/21/2022	3/1/2022	1.94 ± 0.12	2.10 ± 0.12	2.06 ± 0.13	1.86 ± 0.12
3/1/2022	3/7/2022	2.46 ± 0.16	2.51 ± 0.15	2.38 ± 0.16	2.16 ± 0.15
3/7/2022	3/14/2022	1.23 ± 0.11	1.29 ± 0.11	1.29 ± 0.11	1.11 ± 0.11
3/14/2022	3/21/2022	1.85 ± 0.13	1.91 ± 0.13	1.86 ± 0.13	1.77 ± 0.13
3/21/2022	3/28/2022	1.32 ± 0.12	1.59 ± 0.12	1.52 ± 0.12	1.29 ± 0.12
3/28/2022	4/4/2022	1.52 ± 0.12	1.52 ± 0.11	1.49 ± 0.12	1.57 ± 0.12
4/4/2022	4/11/2022	0.99 ± 0.10	1.08 ± 0.10	0.97 ± 0.10	0.97 ± 0.10
4/11/2022	4/18/2022	1.44 ± 0.12	1.60 ± 0.12	1.51 ± 0.12	1.45 ± 0.12
4/18/2022	4/25/2022	1.59 ± 0.12	1.83 ± 0.12	1.62 ± 0.12	1.70 ± 0.12
4/25/2022	5/2/2022	2.24 ± 0.15	2.17 ± 0.13	2.26 ± 0.14	2.17 ± 0.14
5/2/2022	5/9/2022	1.15 ± 0.12	1.34 ± 0.11	1.29 ± 0.11	1.20 ± 0.11
5/9/2022	5/16/2022	1.08 ± 0.11	1.02 ± 0.10	0.99 ± 0.10	1.06 ± 0.11
5/16/2022	5/23/2022	1.96 ± 0.14	2.01 ± 0.12	2.07 ± 0.14	1.77 ± 0.13
5/23/2022	5/31/2022	1.20 ± 0.11	1.38 ± 0.10	1.16 ± 0.10	1.20 ± 0.10
5/31/2022	6/6/2022	2.12 ± 0.09	2.40 ± 0.08	2.39 ± 0.08	2.00 ± 0.09
6/6/2022	6/13/2022	1.57 ± 0.18	1.54 ± 0.17	1.42 ± 0.20	1.40 ± 0.17
6/13/2022	6/20/2022	1.79 ± 0.11	1.96 ± 0.10	1.91 ± 0.10	1.66 ± 0.11
6/20/2022	6/27/2022	1.58 ± 0.13	1.92 ± 0.13	1.74 ± 0.14	1.62 ± 0.13
6/27/2022	7/5/2022	1.54 ± 0.11	1.72 ± 0.12	1.67 ± 0.12	1.51 ± 0.12
7/5/2022	7/11/2022	1.83 ± 0.12	1.97 ± 0.12	1.75 ± 0.13	1.80 ± 0.12
7/11/2022	7/18/2022	1.87 ± 0.12	2.16 ± 0.12	2.01 ± 0.12	1.84 ± 0.13
7/18/2022	7/25/2022	2.69 ± 0.10	2.81 ± 0.11	2.71 ± 0.11	2.46 ± 0.11
7/25/2022	8/1/2022	1.75 ± 0.18	2.16 ± 0.17	1.92 ± 0.19	1.90 ± 0.17

**Table B-6 - Continued**

**Concentration of Beta Emitters in Air Particulates  
(Results in units of  $10^{-2}$  pCi/m<sup>3</sup> +/- 2<sup>†</sup>)**

Start Date	Stop Date	SFA1 Met Station	SFA2 <sup>1</sup> Visitors Center	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI
8/1/2022	8/8/2022	1.84 ± 0.12	1.91 ± 0.14	1.98 ± 0.13	1.84 ± 0.14
8/8/2022	8/15/2022	1.67 ± 0.13	1.71 ± 0.13	1.58 ± 0.15	1.47 ± 0.15
8/15/2022	8/22/2022	1.81 ± 0.12	1.92 ± 0.11	1.73 ± 0.12	1.65 ± 0.11
8/22/2022	8/29/2022	3.17 ± 0.09	3.34 ± 0.09	3.52 ± 0.08	3.23 ± 0.08
8/29/2022	9/6/2022	1.91 ± 0.13	1.93 ± 0.12	1.77 ± 0.12	1.66 ± 0.12
9/6/2022	9/12/2022	1.36 ± 0.13	1.51 ± 0.13	1.41 ± 0.13	1.30 ± 0.12
9/12/2022	9/19/2022	2.49 ± 0.15	2.68 ± 0.15	2.45 ± 0.15	2.19 ± 0.14
9/19/2022	9/26/2022	3.40 ± 0.17	3.69 ± 0.17	3.39 ± 0.17	3.05 ± 0.16
9/26/2022	10/3/2022	1.44 ± 0.11	1.38 ± 0.11	1.33 ± 0.11	1.23 ± 0.11
10/3/2022	10/10/2022	1.72 ± 0.12	1.86 ± 0.13	1.77 ± 0.13	1.36 ± 0.11
10/10/2022	10/17/2022	3.39 ± 0.17	3.56 ± 0.17	3.02 ± 0.17	2.95 ± 0.16
10/17/2022	10/24/2022	2.34 ± 0.14	2.30 ± 0.14	2.05 ± 0.13	2.02 ± 0.13
10/24/2022	10/31/2022	1.00 ± 0.10	0.99 ± 0.10	0.90 ± 0.10	0.89 ± 0.10
10/31/2022	11/7/2022	1.70 ± 0.12	1.64 ± 0.12	1.71 ± 0.13	1.68 ± 0.13
11/7/2022	11/15/2022	1.47 ± 0.11	1.54 ± 0.11	1.23 ± 0.10	1.32 ± 0.11
11/15/2022	11/21/2022	2.90 ± 0.16	2.93 ± 0.17	2.54 ± 0.16	2.53 ± 0.16
11/21/2022	11/28/2022	4.36 ± 0.18	4.46 ± 0.19	3.86 ± 0.17	3.84 ± 0.18
11/28/2022	12/5/2022	3.27 ± 0.16	3.13 ± 0.16	2.95 ± 0.15	2.80 ± 0.15
12/5/2022	12/12/2022	3.05 ± 0.16	2.92 ± 0.15	2.48 ± 0.14	2.70 ± 0.15
12/12/2022	12/19/2022	2.24 ± 0.14	2.23 ± 0.14	1.85 ± 0.13	2.02 ± 0.13
12/19/2022	12/27/2022	2.91 ± 0.14	2.81 ± 0.14	2.50 ± 0.13	2.60 ± 0.14
12/27/2022	1/3/2023	2.92 ± 0.15	2.89 ± 0.15	2.56 ± 0.14	2.52 ± 0.14

<sup>†</sup> Control Location



**Table B-7**

**Concentration of Gamma Emitters in Air Particulates  
(Results in units of  $10^{-3}$  pCi/m<sup>3</sup> ± 2 )**

Sample Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 <sup>1</sup> EOF
3/28/2022	*	*	*	*	*
6/27/2022	*	*	*	*	*
10/3/2022	*	*	*	*	*
1/3/2023	*	*	*	*	*

Sample Date	SFA1 MET Station	SFA2 <sup>1</sup> Visitors Center	SFA3 NNW of ISFSI	SFA4 SSE of ISFSI
3/28/2022	*	*	*	*
6/27/2022	*	*	*	*
10/3/2022	*	*	*	*
1/3/2023	*	*	*	*

<sup>1</sup> Control Location

\* All Non-Natural Gamma Emitters <MDA

**Table B-8a**

**Concentration of Gamma Emitters in Vegetation Samples  
(Results in units of pCi/kg (wet) +/- 2 )**

Sample Code	Sample Date	Sample Type	Gamma Emitters
IB4	6/27/2022	Kale	*
Camp Conoy	7/25/2022	Cabbage	*
Entrance	8/22/2022	Cabbage	*
	9/19/2022	Collards	*
IB5	6/27/2022	Cabbage	*
Camp Conoy	7/25/2022	Kale	*
Entrance	8/22/2022	Kale	*
	9/19/2022	Kale	*
IB6	6/27/2022	Collards	*
Camp Conoy	7/25/2022	Collards	*
Entrance	8/22/2022	Collards	*
	9/19/2022	Swiss Chard	*
IB7 <sup>1</sup>	6/27/2022	Kale	*
EOF	7/25/2022	Cabbage	*
	8/22/2022	Kale	*
	9/19/2022	Kale	*
IB8 <sup>1</sup>	6/27/2022	Cabbage	*
EOF	7/25/2022	Kale	*
	8/22/2022	Collards	*
	9/19/2022	Collards	*
IB9 <sup>1</sup>	6/27/2022	Collards	*
EOF	7/25/2022	Collards	*
	8/22/2022	Swiss Chard	*
	9/19/2022	Zucchini	*

**Table B-8a**

**Concentration of Gamma Emitters in Vegetation Samples  
(Results in units of pCi/kg (wet) +/- 2 )**

Sample Code	Sample Date	Sample Type	Gamma Emitters
IB10 Met Station	6/27/2022	Cabbage	*
	7/25/2022	Kale	*
	8/22/2022	Cabbage	*
	9/19/2022	Collards	*
IB11 Met Station	6/27/2022	Kale	*
	7/25/2022	Kale	*
	8/22/2022	Kale	*
	9/19/2022	Kale	*
IB12 Met Station	6/27/2022	Collards	*
	7/25/2022	Collards	*
	8/22/2022	Collards	*
	9/19/2022	Swiss Chard	*

<sup>1</sup> Control Garden

\* All Non-Natural Gamma Emitters <MDA

**Table B-8b**

**Concentration of Gamma Emitters in Vegetation  
From Locations Around the ISFSI  
(Results in units of pCi/kg (wet) ± 2**

Sample Code	Sample Date	Gamma Emitters
SFB1 MET Station	2/21/2022	*
	6/6/2022	*
	8/15/2022	*
	11/15/2022	*
SFB2 <sup>1</sup> Visitor's Center	2/21/2022	*
	6/6/2022	*
	8/15/2022	*
	11/15/2022	*
SFB3 NNW of ISFSI	2/21/2022	*
	6/6/2022	*
	8/15/2022	*
	11/15/2022	*
SFB4 SSE of ISFSI	2/21/2022	*
	6/6/2022	*
	8/15/2022	*
	11/15/2022	*
SFB5 On Site Before Entrance to Camp Conoy	2/21/2022	*
	6/6/2022	*
	8/15/2022	*
	11/15/2022	*

<sup>1</sup> Control Location

\* All Non-Natural Gamma Emitters <MDA

**Table B-9**

**Concentration of Gamma Emitters in Soil Samples  
From Locations Around the ISFSI  
(Results in units of pCi/kg (dry)  $\pm 2$  )**

Sample Code	Sample Date	Cs-137	Gamma Emitters
SFS1			
MET station	2/21/2022	1	*
	6/6/2022	1	*
	8/15/2022	1	*
	11/15/2022	1	*
SFS2 <sup>2</sup>			
Visitors Center	2/21/2022	1	*
	6/6/2022	1	*
	8/15/2022	1	*
	11/15/2022	1	*
SFS3			
NNW of ISFSI	2/21/2022	146 +/- 62	*
	6/6/2022	140 +/- 46	*
	8/15/2022	1	*
	11/15/2022	133 +/- 55	*
SFS4			
SSE of ISFSI	2/21/2022	1	*
	6/6/2022	1	*
	8/15/2022	1	*
	11/15/2022	1	*
SFS5			
Entrance to Camp Conoy	2/21/2022	1	*
	6/6/2022	70.6 +/- 46	*
	8/15/2022	1	*
	11/15/2022	1	*

<sup>1</sup> This isotope <MDA

<sup>2</sup> Control Location

\* All Non-Natural Gamma Emitters <MDA except where Cs-137 is observed and reported

**Table B-10**  
**Typical MDA Ranges for Gamma Spectrometry**

Selected Nuclides	Air Particulates (10 <sup>-3</sup> pCi/m <sup>3</sup> )	Bay Water, Surface Water, Drinking Water (pCi/L)	Fish (pCi/kg) Wet	Ground water (pCi/L)	Milk (pCi/L)	Oysters (pCi/kg)	Shoreline Sediment (pCi/kg) Dry	Soil (pCi/kg) Dry	Vegetation (pCi/kg) Wet
K-40	5.65 - 24.6	16 - 182	2,747 - 4,505	21.5 - 66.4	1,286 - 1,529	1,269 - 2,069	781 - 13,761	789 - 10,713	671 - 11,829
Mn-54	0.32 - 1.16	2.7 - 5.6	9.8 - 19.6	2.86 - 5.14	3.6 - 6.6	10.8 - 16.4	41.4 - 67.1	37.4 - 91.9	10.3 - 53.0
Fe-59	1.01 - 8.52	5.6 - 13.2	31.6 - 93.2	6.04 - 11.7	9.2 - 15.9	29.3 - 56.7	142 - 251	96.4 - 389	22.0 - 151
Co-58	0.38 - 2.07	2.7 - 5.6	10.9 - 28.3	2.86 - 5.27	3.7 - 6.3	10.5 - 19.3	53.7 - 82.9	44.6 - 133	10.9 - 59.8
Co-60	0.28 - 1.09	2.8 - 5.5	10.9 - 24.3	3.01 - 5.38	4.1 - 7.2	11.7 - 17.0	38.6 - 57.9	32.8 - 85.8	12.9 - 55.0
Zn-65	0.81 - 3.10	5.5 - 11.4	23.3 - 57.2	6.41 - 14.4	9.4 - 16.1	22.0 - 43.3	112 - 198	96.4 - 275	24.7 - 116
Ag-110m	0.33 - 1.06	2.42 - 4.96	8.2 - 18.1	2.79 - 5.06	3.26 - 5.64	8.7 - 16.0	36.6 - 175	40.7 - 99.4	10.1 - 61.4
Zr-95	0.72 - 3.88	4.7 - 10.2	20.0 - 47.1	5.62 - 8.75	5.8 - 11.5	19.0 - 34.0	93.5 - 151	84.6 - 261	19.3 - 116
Nb-95	0.56 - 4.91	2.9 - 6.0	13.7 - 42.7	3.3 - 5.88	3.9 - 6.5	13.9 - 24.3	82.1 - 157	61.5 - 227	10.9 - 90.5
Ru-106	3.00 - 12.1	23.8 - 48.1	77.1 - 197	25.6 - 45.3	29.3 - 51.8	88.0 - 141	327.0 - 570	314.0 - 840	92.9 - 541
I-131 <sup>1</sup>	2.73 - 914	0.52 - 11.7	21.4 - 2,340	4.87 - 9.04	0.5 - 7.03	22.4 - 107	470 - 2,040	139 - 8,060	13.4 - 854
Cs-134	0.47 - 0.88	3.2 - 5.7	7.8 - 16.0	2.92 - 5.48	4.09 - 4.82	9.7 - 16.5	43.3 - 82.4	33.4 - 109	11.1 - 58.1
Cs-137	0.46 - 0.88	3.7 - 5.9	3.8 - 17.5	2.97 - 5.43	4.08 - 5.29	10.0 - 16.7	38.4 - 65.4	39.1 - 135	11.1 - 62.3
La-140	2.01 - 116	5.05 - 11.5	15.9 - 444	4.87 - 10.3	4.89 - 6.28	24.1 - 80.4	368 - 773	136 - 1,820	9.1 - 388
Ba-140	2.01 - 116	5.05 - 11.5	15.9 - 444	5.86 - 26.0	4.89 - 6.28	24.1 - 80.4	368 - 773	136 - 1,820	9.1 - 388
Ce-144	1.12 - 3.27	16.8 - 36.7	38.1 - 70.9	17.8 - 32.0	20.5 - 31.0	42.6 - 72.6	208 - 279	191 - 414	46.6 - 289
Cr-51	4.90 - 45.0	23.2 - 50.6	93.0 - 395	26.7 - 42.1	30.4 - 46.8	97.0 - 199	711 - 1,110	489 - 1,810	93.9 - 850
Na-22	0.34 - 1.33	2.7 - 6.0	12.1 - 28.0	2.78 - 5.94	4.9 - 8.5	13.4 - 19.5	46.4 - 77.4	36.4 - 92.4	8.9 - 54.1

<sup>1</sup> This MDA range for I-131 on a charcoal cartridge is typically 5.22 x 10<sup>-3</sup> to 1.37 x 10<sup>-2</sup> pCi/m<sup>3</sup>

**Table B-11**  
**Typical LLDs for Gamma Spectrometry**

Selected Nuclides	Air Particulates 10-3 pCi/m <sup>3</sup>	Bay Water, Surface Water, Drinking Water pCi/L	Fish pCi/kg (wet)	Ground water pCi/L	Oysters pCi/kg (wet)	Milk pCi/L	Soil pCi/kg (dry)	Vegetation pCi/kg (wet)
Na-22	5	5.3	12	5.3	12	9.1	78	27
Cr-51	74	37	76	37	76	62	452	174
Mn-54	4.6	4.7	13	4.7	13	7.4	63	19
Co-58	6.7	4.3	12	4.3	12	8.2	78	23
Fe-59	20	11	27	11	27	18	123	57
Co-60	3.5	4.8	12	4.8	12	7.5	59	24
Zn-65	8.9	11	27	11	27	17	162	55
Nb-95	9.8	4.5	13	4.5	13	9.5	73	25
Zr-95	11	7.9	18	7.9	18	14	117	34
Ru-106	43	38	111	38	111	62	624	174
Ag-110m	4.2	4.3	11	4.3	11	6	65	20
Te-129m	101	56	118	56	118	90	833	263
I-131*	90	0.8	11	6.4	11	0.8	58	42
Cs-134	4.7	4.7	11	4.7	11	6.7	66	18
Cs-137	4.2	5.1	11	5.1	11	6.9	78	21
Ba-140	47	23	39	23	39	46	103	111
La-140	47	9.2	15	9.2	15	13	103	30
Ce-144	15	23	45	23	45	37	288	70

\* The LLD for I-131 measured on a charcoal cartridge is  $3.7 \times 10^{-2}$  pCi/m<sup>3</sup>

**Table B-12**  
**Direct Radiation**  
**(Results in Units of mrem/91 days ± 2 )**

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter	Mean +/- 2 Stdev
DR01	On Site, along Cliffs	13.6	13.5	11.5	12.4	12.8 ± 2.0
DR02	Route 765, Auto Dump	10.0	10.9	11.5	11.3	10.9 ± 1.3
DR03	Route 765, Giovanni's Tavern	11.1	11.3	9.68	10.3	10.6 ± 1.5
DR04	Route 765, across from Vera's Beach Club	12.7	12.8	14.1	13.4	13.3 ± 1.3
DR05	Route 765, John's Creek	12.4	14.5	11.7	13.1	12.9 ± 2.4
DR06	Route 765 at Lusby	9.98	9.49	11.6	10.3	10.3 ± 1.8
DR07	Entrance to Camp Conoy	11.2	10.1	11.3	11.6	11.1 ± 1.3
DR08	Camp Conoy Rd at Emergency Siren	14.9	16.9	13.1	13.2	14.5 ± 3.6
DR09	Bay Breeze Rd	11.1	11.2	11.3	10.2	11.0 ± 1.0
DR10	Calvert Beach Rd and Decatur Street	10.3	11.2	10.2	10.2	10.5 ± 1.0
DR11	Dirt road off Mackall & Parren Rd	12.0	12.3	13.2	11.5	12.3 ± 1.4
DR12	Mackall & Bowen Rds	11.0	10.6	12.3	9.98	11.0 ± 2.0



DR13	Mackall Rd, near Wallville	11.8	11.7	12.6	32.0	17.0	±	20.0
DR14	Rodney Point	13.4	12.8	14.1	11.5	13.0	±	2.2
DR15	Mill Bridge & Turner Rds	12.0	11.6	12.3	11.6	11.9	±	0.7
DR16	Across from Appeal School	10.9	12.2	11.1	12.2	11.6	±	1.4
DR17	Cove Point & Little Cove Point Rds	13.9	13.1	14.4	12.5	13.5	±	1.7
DR18	Cove Point	10.4	10.1	10.2	8.69	9.8	±	1.6
DR19	Long Beach	12.0	12.5	12.5	10.7	11.9	±	1.7
DR20	On site, near shore	13.4	14.1	14.1	14.1	13.9	±	0.7
DR21 <sup>1</sup>	EOF	14.7	12.6	14.9	12.9	13.8	±	2.4
DR22 <sup>1</sup>	Solomons Island	11.8	12.0	13.1	11.2	12.1	±	1.6
DR23 <sup>1</sup>	Taylor's Island	17.2	17.4	No data*	16.4	17.0	±	1.1
DR30	MET Station	12.3	12.4	12.8	9.8	11.8	±	2.7
SFDR01	SW of ISFSI	17.5	16.8	18.9	18.8	18.0	±	2.0
SFDR02	NNW of ISFSI	18	18.4	19.9	17.2	18.4	±	2.3
SFDR03	North of ISFSI	28.6	29.8	32.2	29.4	30.0	±	3.1
SFDR04	NE of ISFSI	43.9	41.2	43.4	48.1	44.2	±	5.8

SFDR05	East of ISFSI	42.1	39.5	46	39.3	41.7	± 6.2
SFDR06	ESE of ISFSI	23.5	22.7	24.6	29.4	25.1	± 6.0
SFDR07 <sup>1</sup>	Visitor's Center	15.1	14.9	14.6	14.4	14.8	± 0.6
SFDR08	NNW of ISFSI	24.8	24.1	25.3	53.3	31.9	± 28.6
SFDR09	SSE of ISFSI	62.8	62.8	59.5	39.8	56.2	± 22.1
SFDR10	NW of ISFSI	27.2	26.4	24.0	25.7	25.8	± 2.7
SFDR11	WNW ISFSI	26.8	25.2	25.1	23.4	25.1	± 2.8
SFDR12	WSW of ISFSI	39.8	36.6	42.3	33.4	38.0	± 7.7
SFDR13	South of ISFSI	49.2	49.2	82	127	76.9	± 73.7
SFDR14	SE of ISFSI	81.9	79.4	89.2	78.2	82.2	± 9.9
SFDR15	ENE of ISFSI	39.4	37	43.5	50	42.5	± 11.4
SFDR16	SSW of ISFSI	57.0	48.4	58.7	80.4	61.1	± 27.2
SFDR17	NNE of ISFSI	37.5	38.4	38.2	37.2	37.8	± 1.1
SFDR18	NNE of ISFSI	39.7	36.9	39.3	35.0	37.8	± 1.1

<sup>1</sup> Control Location

\* Missing dosimeter No Data

## APPENDIX C

### **Quality Assurance Program**

Appendix C is a summary of Constellation Generation Solutions (CGS) laboratory's quality assurance program. It consists of Table C-1 which is a compilation of the results of the CGS laboratory's participation in an interlaboratory comparison program with Environmental Resource Associates (ERA) located in Arvada, Colorado and Eckert and Ziegler Analytics, Inc. (EZA) located in Atlanta, Georgia.

It also includes Table C-2, which is a compilation of the results of the Constellation Generation Solutions (CGS) Laboratory's participation in a split sample program with Teledyne Brown Engineering located in Knoxville, Tennessee, and Table C-3, which is a list of the Site Specific LLDs required by the ODCM.

The CGS laboratory's results contained in Table C-1, intercomparison results, are in full agreement when they were evaluated using the NRC Resolution Test Criteria [1] except as noted in the Pass/Fail column and described below. The CGS laboratory's results are provided with their analytical uncertainties of 2 sigma. When evaluating with the NRC Resolution Test a one sigma uncertainty is used to determine Pass or Fail and noted accordingly.

All results reported passed their respective vendor acceptance ranges and NRC Resolution Test Criteria [1] with one exception for the Gross Beta Study ERA RAD 129, reference date 4/4/2022. The CGS result passed the low end of vendor acceptance criteria but failed NRC Resolution Test Criteria. Low recovery of activity was likely due to an ineffective residue correction factor that undercompensates for the significant residue weight present in the study accounting for the low result reported. This low value and a low uncertainty in turn resulted in an NRC Resolution Test Criteria Failure. A set of 3rd party, NIST traceable standards has been procured to build a residue correction curve for more accurate results going forward. This event has been entered into the Corrective Action Program for tracking and to prevent future occurrence.

All results reported passed their respective vendor acceptance ranges and NRC Resolution Test Criteria [1]

The vendor laboratories used by CGS for subcontracting and interlaboratory comparison samples, GEL Laboratories and Teledyne Brown Engineering, also participate in the ERA and EZA interlaboratory comparison program. A presentation of their full data report is provided in their Annual Environmental Quality Assurance Program Reports, (Ref 14,15). In summary Gel and TBE reported results met vendor and laboratory acceptance ranges with the following exceptions discussed here:

1. TBE result for Air particulate Ce-144 submitted for a study in March 2022 failed the upper acceptance limit. The laboratory investigated and the study results were outside the acceptable range specified in TBE's QA plan, 70-130% of True Value, but would have been acceptable when taking the uncertainty into account.

A duplicate study was analyzed on two other detectors and passed the upper acceptance limit. In both cases TBE's published QA requirements of acceptable range being 70-130% of True value were met. The lab's performance is within the acceptable range specified in their QA plan. This same range is considered acceptable by Constellation Nuclear Quality Assurance Requirements as well. TBE states in their investigation that there was no impact to sample data and no further action is warranted.

2. TBE result for Air particulate Co-60 study in September 2022 failed the upper acceptance limit. The laboratory investigated and the study results were outside the acceptable range specified in TBE's QA plan, 70-130% of True Value. The study was analyzed as a duplicate on another detector and passed within 114% of True Value. Historical results for Air particulate Co-60 have ranged from 91% - 141% with a mean of 91%. The lab determined no correction action needed at this time as it is the first failure for this nuclide for Air particulate.
3. GEL results for MRAD-37 Sr-90 failed vendor acceptance criteria, exceeding the maximum range for both Vegetation and water. The laboratory review did not reveal any gross errors or possible contributors to the high bias. During this same analysis time period the laboratory successfully analyzed these same matrices in PT for MAPEP-47 which required the same preparation and analysis processes and procedures. The lab will continue to monitor the recoveries of these parameters to ensure there are no continued issues.

The Inter and Intra laboratory results contained in Table C-2 are intercomparison results for routine samples analyzed for replicate and split analyses and evaluated for beta and non-natural gamma emitters. The CGS laboratory's results are provided with their analytical uncertainties of 2 sigma. When evaluating with the NRC Resolution Test a one sigma uncertainty is used to determine Pass or Fail and noted accordingly. In the event there are no non-natural isotopes detected, the samples are reported <MDA and designated as Pass.

There were three of the 4 quarterly samples for soil at SFS3 that indicated low level, Non Plant related Cs-137 just above the analyses Minimum Detectable Activity. This activity has been investigated previously and levels are in trend with historical data at this location.

1. The original analysis of soil collected on February 21, 2022, at SFS3 indicated low level, Non Plant related Cs-137 just above the analyses Minimum Detectable Activity at  $146 \pm 61.9$  pCi/kg. The replicate and split samples also indicated Cs-137 above the Minimum Detectable Activity, MDA, at  $212 \pm 37.5$  pCi/kg and  $141 \pm 83.0$  pCi/kg, respectively.
2. The original analysis of soil collected on June 6, 2022, at SFS3 indicated low level, Non Plant related Cs-137 just above the analyses Minimum Detectable Activity at  $140 \pm 56.2$  pCi/kg. The replicate analysis confirmed Cs-137 above the Minimum Detectable Activity, MDA, at  $98.9 \pm 52.3$  pCi/kg and results are in agreement when evaluated using the NRC Resolution Test Criteria<sup>1</sup>.

3. The original analysis of soil collected on November 15, 2022, at SFS3 indicated low level, Non Plant related Cs-137 just above the analyses Minimum Detectable Activity at  $133 \pm 55.3$  pCi/kg. The replicate analysis confirmed Cs-137 above the Minimum Detectable Activity, MDA, at  $169 \pm 61.3$  pCi/kg and these results are in agreement when evaluated using the NRC Resolution Test Criteria<sup>1</sup>.

The original, replicate and split results pass the NRC Resolution Test Criteria<sup>1</sup>, as specified in the rule. The low-level Cs-137 observed in these soil analyses is consistent with weapons related fallout previously identified in the environs around Calvert Cliffs Nuclear Power Plant.

All air particulate samples contain Beta emitters and are reported with a 2sigma uncertainty. The original and replicate analyses are evaluated for agreement using the NRC Resolution Test Criteria<sup>1</sup>. These samples must be composited for further analysis and this precludes them from being split for analysis of beta emitters. These filters and other samples whose nature generally preclude sample splitting are marked "\*\*\*" in the Split Analysis column

---

<sup>1</sup> NRC Inspection Manual, Inspection Procedure 84750, March 15, 1994

**TABLE OF CONTENTS - ANALYTICAL RESULTS**

Table	Title	Page
C-1	Results of Participation in Cross Check Programs .....	69
C-2	Results of Quality Assurance Program .....	75
C-3	Calvert Cliffs Nuclear Power Plant ODCM Required LLDs.....	89

**Table C-1**  
**Results of Participation in Cross Check Programs**

Sample Date	Vendor	Study ID	Sample Type	Units	Equip ID	Isotope Observed	Reported Laboratory's Results			Cross Check Lab Results	NRC Resolution Test Pass / Fail <sup>1</sup>	
3/10/2022	ANA	E13643	Milk	Gamma	pCi/L	D4	Ce-141	58.6	±	11.5	64.6	Pass
							Co-58	160	±	15.6	164	Pass
							Co-60	313	±	15.8	302	Pass
							Cr-51	390	±	95.0	339	Pass
							Cs-134	168	±	8.98	182	Pass
							Cs-137	222	±	17.4	223	Pass
							Fe-59	185	±	20.8	185	Pass
							I-131	98.9	±	21.6	96.7	Pass
							Mn-54	157	±	14.8	164	Pass
							Zn-65	231	±	31.7	246	Pass
3/10/2022	ANA	E13643	Milk	Gamma	pCi/L	D5	Ce-141	71.6	±	16.3	64.6	Pass
							Co-58	164	±	15.1	164	Pass
							Co-60	302	±	14.8	302	Pass
							Cr-51	398	±	107	339	Pass
							Cs-134	168	±	9.67	182	Pass
							Cs-137	212	±	16.0	223	Pass
							Fe-59	207	±	21.3	185	Pass
							I-131	96.2	±	26.7	96.7	Pass
							Mn-54	166	±	15.0	164	Pass
							Zn-65	230	±	31.0	246	Pass
3/10/2022	ANA	E13644	Water	Beta	pCi/L	S5E	Cs-137	224	±	4.43	222	Pass

Sample Date	Vendor	Study ID	Sample Type	Units	Equip ID	Isotope Observed	Reported Laboratory's Results			Cross Check Lab Results	NRC Resolution Test Pass / Fail <sup>1</sup>	
3/10/2022	ANA	E13645	Cartridge	Gamma	pCi	D2	I-131	81.9	±	8.35	88.2	Pass
						D3	I-131	84.7	±	7.96	88.2	Pass
						D4	I-131	82.0	±	7.39	88.2	Pass
4/4/2022	ERA	RAD129	Water	Gamma	pCi/L	D4	Ba-133	56.6	±	4.24	62.9	Pass
							Cs-134	81.0	±	3.61	81.6	Pass
							Cs-137	37.8	±	4.54	36.6	Pass
							Co-60	97.6	±	5.11	97.4	Pass
							Zn-65	293	±	17.9	302	Pass
4/4/2022	ERA	RAD129	Water	Beta	pCi/L	S5E	Cs-137	35.8	±	1.88	51.0	Fail <sup>1</sup>
4/4/2022	ERA	RAD129	Water	Gamma	pCi/L	D4	I-131	27.1	±	4.39	26.2	Pass
6/16/2022	ANA	E13646	Water	Beta	pCi/L	S5E	Cs-137	250	±	4.66	260	Pass
6/16/2022	ANA	E13647	Water	Gamma	pCi/L	D3	Ce-141	141	±	15.5	139	Pass
							Co-58	126	±	14.9	128	Pass
							Co-60	244	±	12.6	242	Pass
							Cr-51	314	±	84.7	344	Pass
							Cs-134	163	±	9.09	172	Pass
							Cs-137	213	±	15.4	204	Pass
							Fe-59	170	±	19.0	157	Pass
							I-131	112	±	22.6	91.2	Pass
							Mn-54	243	±	16.9	229	Pass
Zn-65	302	±	30.5	296	Pass							



Sample Date	Vendor	Study ID	Sample Type	Units	Equip ID	Isotope Observed	Reported Laboratory's Results			Cross Check Lab Results	NRC Resolution Test Pass / Fail <sup>1</sup>	
6/16/2022	ANA	E13647	Water	Gamma	pCi/L	D4	Ce-141	126	±	14.6	139	Pass
							Co-58	124	±	13.8	128	Pass
							Co-60	248	±	13.1	242	Pass
							Cr-51	358	±	92.9	344	Pass
							Cs-134	163	±	9.11	172	Pass
							Cs-137	217	±	15.8	204	Pass
							Fe-59	180	±	19.0	157	Pass
							I-131	86.2	±	24.2	91.2	Pass
							Mn-54	253	±	17.0	229	Pass
							Zn-65	253	±	30.2	296	Pass
6/16/2022	ANA	E13648	Filter	Gamma	pCi	D5	Ce-141	101	±	5.17	96.6	Pass
							Co-58	89.3	±	4.93	89.3	Pass
							Co-60	169	±	4.85	168	Pass
							Cr-51	252	±	34.6	239	Pass
							Cs-134	100	±	2.67	119	Pass
							Cs-137	142	±	5.25	142	Pass
							Fe-59	129	±	8.07	109	Pass
							Mn-54	168	±	5.97	159	Pass
							Zn-65	211	±	11.7	206	Pass

Sample Date	Vendor	Study ID	Sample Type	Units	Equip ID	Isotope Observed	Reported Laboratory's Results			Cross Check Lab Results	NRC Resolution Test Pass / Fail <sup>1</sup>	
6/16/2022	ANA	E13648	Filter	Gamma	pCi	D4	Ce-141	96.7	±	7.64	97.0	Pass
							Co-58	89.2	±	7.09	89.0	Pass
							Co-60	171	±	7.27	168	Pass
							Cr-51	265	±	35.4	239	Pass
							Cs-134	104	±	4.09	119	Pass
							Cs-137	147	±	7.98	142	Pass
							Fe-59	136	±	10.6	109	Pass
							Mn-54	170	±	9.08	159	Pass
Zn-65	198	±	16.4	206	Pass							
6/16/2022	ANA	E13649	Filter	Beta	pCi	S5E	Cs-137	276	±	3.47	242	Pass
							Cs-137	276	±	3.47	242	Pass
							Cs-137	275	±	3.47	242	Pass
9/15/2022	ANA	E13650A	Filter	Beta	pCi	S5E	Cs-137	242	±	3.25	224	Pass
9/19/2022	ERA	MRAD037	Filter	Gamma	pCi	D4	Cs-134	270	±	6.71	325	Pass
							Cs-137	706	±	19.3	795	Pass
							Co-60	198	±	8.36	191	Pass
							Zn-65	125	±	16.5	120	Pass
10/7/2022	ERA	RAD131	Water	Gamma	pCi/L	D4	Ba-133	75.0	±	3.79	79.4	Pass
							Cs-134	29.0	±	2.09	30.5	Pass
							Cs-137	212	±	7.45	212	Pass
							Co-60	50.4	±	3.06	51.4	Pass
							Zn-65	212	±	12.8	216	Pass
10/7/2022	ERA	RAD131	Water	Gamma	pCi/L	D3	I-131	25.4	±	6.03	24.4	Pass

Sample Date	Vendor	Study ID	Sample Type		Units	Equip ID	Isotope Observed	Reported Laboratory's Results			Cross Check Lab Results	NRC Resolution Test Pass / Fail <sup>1</sup>
12/1/2022	ANA	E13651	Filter	Gamma	pCi	D4	Ce-141	144	±	9.4	140	Pass
							Co-58	143	±	12.0	144	Pass
							Co-60	174	±	10.0	181	Pass
							Cr-51	287	±	54.4	290	Pass
							Cs-134	93.0	±	5.59	120	Pass
							Cs-137	134	±	10.7	137	Pass
							Fe-59	142	±	15.9	124	Pass
							Mn-54	162	±	12.1	158	Pass
							Zn-65	192	±	23.5	191	Pass
12/1/2022	ANA	E13651	Filter	Gamma	pCi	D5	Ce-141	146	±	8.6	140	Pass
							Co-58	140	±	10.1	144	Pass
							Co-60	180	±	8.97	181	Pass
							Cr-51	286	±	46.1	290	Pass
							Cs-134	94.5	±	48.6	120	Pass
							Cs-137	125	±	91.6	137	Pass
							Fe-59	148	±	12.8	124	Pass
							Mn-54	172	±	10.4	158	Pass
							Zn-65	199	±	20.3	191	Pass
12/1/2022	ANA	E13652	Water	Beta	pCi/L	S5E	Cs-137	308	±	5.11	283	Pass
12/1/2022	ANA	E13653	Cartridge	Gamma	pCi	D2	I-131	88.7	±	9.50	91.6	Pass
						D3	I-131	88.5	±	9.40	91.6	Pass
						D4	I-131	93.5	±	8.60	91.6	Pass

Sample Date	Vendor	Study ID	Sample Type	Units	Equip ID	Isotope Observed	Reported Laboratory's Results			Cross Check Lab Results	NRC Resolution Test Pass / Fail <sup>1</sup>	
12/1/2022	ANA	E13653	Cartridge	Gamma	pCi	D5	I-131	89.8	±	9.10	91.6	Pass
12/1/2022	ANA	E13654	Milk	Gamma	pCi/L	D4	Ce-141	223	±	19.5	225	Pass
							Co-58	222	±	19.7	230	Pass
							Co-60	281	±	16.3	290	Pass
							Cr-51	433	±	111	464	Pass
							Cs-134	182	±	114	191	Pass
							Cs-137	214	±	18.6	219	Pass
							Fe-59	220	±	23.3	198	Pass
							I-131	104	±	22.1	95.1	Pass
							Mn-54	252	±	19.7	252	Pass
Zn-65	274	±	38.0	305	Pass							
12/1/2022	ANA	E13654	Milk	Gamma	pCi/L	D5	Ce-141	228	±	19.1	225	Pass
							Co-58	226	±	17.7	230	Pass
							Co-60	285	±	14.9	290	Pass
							Cr-51	494	±	110	464	Pass
							Cs-134	179	±	10.1	191	Pass
							Cs-137	231	±	18.0	219	Pass
							Fe-59	214	±	21.6	198	Pass
							I-131	102	±	23.0	95.1	Pass
							Mn-54	252	±	18.6	252	Pass
Zn-65	282	±	33.4	305	Pass							

<sup>1</sup> See discussion at the beginning of the Appendix

**Table C-2**  
**Results of Quality Assurance Program**

<b>Sample Type and Location</b>	<b>Sample Date</b>	<b>Type of Analysis</b>	<b>Result Units</b>	<b>Original Analysis</b>			<b>Replicate Analysis</b>			<b>Split Analysis</b>	<b>Pass/Fail (Replicate)</b>	<b>Pass/Fail (Split)</b>
Water - Circ in	1/3/2022	Gross Beta	pCi/L	2.03	±	0.8	2.95	±	0.8	**	Pass	NA
Water - Circ Out	1/3/2022	Gross Beta	pCi/L	2.53	±	0.8	2.94	±	0.8	**	Pass	NA
Water - OWD	1/3/2022	Gross Beta	pCi/L	2.11	±	0.8	2.86	±	0.8	**	Pass	NA
Water - MCWA	1/3/2022	Gross Beta	pCi/L	1.64	±	0.8	2.11	±	0.8	**	Pass	NA
Water - Webster	1/3/2022	Gross Beta	pCi/L	1.33	±	0.7	1.75	±	0.7	**	Pass	NA
Water - DC	1/12/2022	Gross Beta	pCi/L	2.61	±	1.9	4.48	±	1.9	**	Pass	NA
Water - ML	1/12/2022	Gross Beta	pCi/L	4.74	±	4.1	4.96	±	4.1	**	Pass	NA
Water - Circ in	10/10/2022	Gross Beta	pCi/L	2.64	±	0.8	3.48	±	0.8	**	Pass	NA
Water - Circ Out	10/10/2022	Gross Beta	pCi/L	2.07	±	0.8	2.41	±	0.8	**	Pass	NA
Water - OWD	10/10/2022	Gross Beta	pCi/L	1.88	±	0.7	2.61	±	0.8	**	Pass	NA
Water - MCWA	10/10/2022	Gross Beta	pCi/L	1.82	±	0.7	1.74	±	0.7	**	Pass	NA
Water - Webster	10/10/2022	Gross Beta	pCi/L	2.23	±	0.8	2.36	±	0.8	**	Pass	NA
Water - DC	10/31/2022	Gross Beta	pCi/L	5.35	±	2.0	8.89	±	2.3	**	Pass	NA
Water - ML	10/31/2022	Gross Beta	pCi/L	8.19	±	2.2	8.58	±	2.2	**	Pass	NA
Water - 16C2	1/31/2022	Gross Beta	pCi/L	2.6	±	0.8	NA			<2.5	NA	Pass
Water - 16C2	1/31/2022	LLI	pCi/L	<MDA			NA			<MDA	NA	Pass
Water - 16C2	1/31/2022	Gamma	pCi/L	<MDA			NA			<MDA	NA	Pass
Water - 16C2	2/28/2022	Gross Beta	pCi/L	2.7	±	0.9	NA			<3.3	NA	Pass
Water - 16C2	2/28/2022	LLI	pCi/L	<MDA			NA			<MDA	NA	Pass
Water - 16C2	2/28/2022	Gamma	pCi/L	<MDA			NA			<MDA	NA	Pass

Water - 16C2	3/29/2022	Gross Beta	pCi/L	2.1	±	0.8	NA	3.24	±	1.7	NA	Pass
Water - 16C2	3/29/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	3/29/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	3/29/2022	Tritium	pCi/L	<123			NA	<194			NA	Pass
Water - 16C2	5/2/2022	Gross Beta	pCi/L	1.6	±	0.8	NA	<2.8			NA	Pass
Water - 16C2	5/2/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	5/2/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	5/31/2022	Gross Beta	pCi/L	1.8	±	0.8	NA	<3.3			NA	Pass
Water - 16C2	5/31/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	5/31/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	6/27/2022	Gross Beta	pCi/L	5.1	±	1.0	NA	<3.0			NA	Pass
Water - 16C2	6/27/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	6/27/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	6/27/2022	Tritium	pCi/L	<164			NA	<182			NA	Pass
Water - 16C2	8/2/2022	Gross Beta	pCi/L	2.7	±	1.6	NA	<1.8			NA	Pass
Water - 16C2	8/2/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	8/2/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	8/29/2022	Gross Beta	pCi/L	3.4	±	0.7	NA	<3.1			NA	Pass
Water - 16C2	8/29/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	8/29/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	10/3/2022	Gross Beta	pCi/L	1.8	±	0.8	NA	<3.1			NA	Pass
Water - 16C2	10/3/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	10/3/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water - 16C2	10/3/2022	Tritium	pCi/L	<163			NA	<188			NA	Pass

Water -	16C2	10/31/2022	Gross Beta	pCi/L	2.0	±	0.8	NA	3.22	±	1.8	NA	Pass
Water -	16C2	10/31/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water -	16C2	10/31/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water -	16C2	11/29/2022	Gross Beta	pCi/L	1.8	±	0.8	NA	<2.7			NA	Pass
Water -	16C2	11/29/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water -	16C2	11/29/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water -	16C2	1/3/2023	Gross Beta	pCi/L	2.4	±	0.8	NA	<3.0			NA	Pass
Water -	16C2	1/3/2023	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Water -	16C2	1/3/2023	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Water -	16C2	1/3/2023	Tritium	pCi/L	<156			NA	<178			NA	Pass
Milk-	19B1	1/18/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	19B1	1/18/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	25C1	1/18/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	25C1	1/18/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	19B1	4/11/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	19B1	4/11/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	25C1	4/11/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	25C1	4/11/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	19B1	7/5/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	19B1	7/5/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	19B1	10/11/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	19B1	10/11/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	22B1	12/6/2022	LLI	pCi/L	<MDA			NA	<MDA			NA	Pass
Milk-	22B1	12/6/2022	Gamma	pCi/L	<MDA			NA	<MDA			NA	Pass

Composite-	11S1	3/29/2022	Gamma	pCi/m3	11S1	<MDA		NA	11S2	<MDA	NA	Pass
Composite-	11S1	6/27/2022	Gamma	pCi/m3	11S1	<MDA		NA	11S2	<MDA	NA	Pass
Composite-	11S1	10/3/2022	Gamma	pCi/m3	11S1	<MDA		NA	11S2	<MDA	NA	Pass
Composite-	11S1	1/3/2023	Gamma	pCi/m3	11S1	<MDA		NA	11S2	<MDA	NA	Pass
Air Filter -	A1	1/10/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	2.7	± 0.2	2.8	± 0.2	**	Pass	NA	
Air Filter -	A1	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.6	± 0.1	1.6	± 0.1	**	Pass	NA	
Air Filter -	A1	4/25/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.8	± 0.1	1.8	± 0.1	**	Pass	NA	
Air Filter -	A1	5/2/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	2.4	± 0.1	2.3	± 0.1	**	Pass	NA	
Air Filter -	A1	6/6/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	2.3	± 0.1	2.2	± 0.1	**	Pass	NA	
Air Filter -	A1	8/29/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.4	± 0.1	3.3	± 0.2	**	Pass	NA	
Air Filter -	A1	10/31/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.1	± 0.1	1.3	± 0.1	**	Pass	NA	
Air Filter -	A1	11/15/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.5	± 0.1	1.6	± 0.1	**	Pass	NA	
Air Filter -	A2	1/10/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	2.4	± 0.2	2.4	± 0.2	**	Pass	NA	
Air Filter -	A2	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.4	± 0.1	1.3	± 0.1	**	Pass	NA	
Air Filter -	A2	4/25/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.6	± 0.1	1.6	± 0.1	**	Pass	NA	
Air Filter -	A2	5/2/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	2.2	± 0.2	2.0	± 0.1	**	Pass	NA	
Air Filter -	A2	6/6/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.7	± 0.1	1.7	± 0.1	**	Pass	NA	
Air Filter -	A2	8/29/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.0	± 0.1	3.0	± 0.2	**	Pass	NA	
Air Filter -	A2	10/31/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.1	± 0.1	1.2	± 0.1	**	Pass	NA	
Air Filter -	A2	11/15/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.5	± 0.1	1.6	± 0.1	**	Pass	NA	
Air Filter -	A3	1/10/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.1	± 0.2	2.9	± 0.2	**	Pass	NA	
Air Filter -	A3	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.5	± 0.1	1.5	± 0.1	**	Pass	NA	
Air Filter -	A3	4/25/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	1.8	± 0.1	1.8	± 0.1	**	Pass	NA	
Air Filter -	A3	5/2/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	2.6	± 0.1	2.1	± 0.1	**	Pass	NA	
Air Filter -	A3	6/6/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	2.3	± 0.1	2.3	± 0.2	**	Pass	NA	
Air Filter -	A3	8/29/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.6	± 0.1	3.5	± 0.2	**	Pass	NA	



Air Filter - A3	10/31/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.0	±	0.1	1.0	±	0.1	**	Pass	NA
Air Filter - A3	11/15/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.5	±	0.1	1.6	±	0.1	**	Pass	NA
Air Filter - A4	1/10/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.7	±	0.2	2.9	±	0.2	**	Pass	NA
Air Filter - A4	4/18/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.5	±	0.1	1.5	±	0.1	**	Pass	NA
Air Filter - A4	4/25/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.8	±	0.1	1.9	±	0.1	**	Pass	NA
Air Filter - A4	5/2/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.4	±	0.1	2.2	±	0.1	**	Pass	NA
Air Filter - A4	6/6/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.3	±	0.1	2.3	±	0.1	**	Pass	NA
Air Filter - A4	8/29/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	3.6	±	0.1	3.8	±	0.2	**	Pass	NA
Air Filter - A4	10/31/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.2	±	0.1	1.3	±	0.1	**	Pass	NA
Air Filter - A4	11/15/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.6	±	0.1	1.8	±	0.1	**	Pass	NA
Air Filter - A5	1/10/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.8	±	0.2	2.8	±	0.2	**	Pass	NA
Air Filter - A5	4/18/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.4	±	0.1	1.4	±	0.1	**	Pass	NA
Air Filter - A5	4/25/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.7	±	0.1	1.8	±	0.1	**	Pass	NA
Air Filter - A5	5/2/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.6	±	0.2	2.2	±	0.1	**	Pass	NA
Air Filter - A5	6/6/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.2	±	0.1	2.3	±	0.2	**	Pass	NA
Air Filter - A5	8/29/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	3.9	±	0.1	3.9	±	0.2	**	Pass	NA
Air Filter - A5	10/31/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.2	±	0.1	1.3	±	0.1	**	Pass	NA
Air Filter - A5	11/15/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.7	±	0.1	1.8	±	0.1	**	Pass	NA
Air Filter - SFA1	1/10/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	3.1	±	0.2	3.0	±	0.2	**	Pass	NA
Air Filter - SFA1	4/18/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.4	±	0.1	1.5	±	0.1	**	Pass	NA
Air Filter - SFA1	4/25/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.6	±	0.1	1.7	±	0.1	**	Pass	NA
Air Filter - SFA1	5/2/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.2	±	0.1	2.2	±	0.1	**	Pass	NA
Air Filter - SFA1	6/6/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.2	±	0.1	2.0	±	0.2	**	Pass	NA
Air Filter - SFA1	8/29/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	3.2	±	0.1	3.2	±	0.2	**	Pass	NA
Air Filter - SFA1	10/31/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.0	±	0.1	1.1	±	0.1	**	Pass	NA

Air Filter - SFA1	11/15/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.5	±	0.1	1.6	±	0.1	**	Pass	NA
Air Filter - SFA2	1/10/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.7	±	0.2	2.8	±	0.2	**	Pass	NA
Air Filter - SFA2	4/18/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.6	±	0.1	1.6	±	0.1	**	Pass	NA
Air Filter - SFA2	4/25/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.8	±	0.1	1.8	±	0.1	**	Pass	NA
Air Filter - SFA2	5/2/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.2	±	0.1	2.4	±	0.1	**	Pass	NA
Air Filter - SFA2	6/6/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.4	±	0.1	2.4	±	0.1	**	Pass	NA
Air Filter - SFA2	8/29/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	3.3	±	0.1	3.4	±	0.2	**	Pass	NA
Air Filter - SFA2	10/31/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.0	±	0.1	1.0	±	0.1	**	Pass	NA
Air Filter - SFA2	11/15/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.5	±	0.1	1.6	±	0.1	**	Pass	NA
Air Filter - SFA3	1/10/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.9	±	0.2	3.0	±	0.2	**	Pass	NA
Air Filter - SFA3	4/18/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.5	±	0.1	1.4	±	0.1	**	Pass	NA
Air Filter - SFA3	4/25/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.6	±	0.1	1.7	±	0.1	**	Pass	NA
Air Filter - SFA3	5/2/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.3	±	0.1	2.1	±	0.1	**	Pass	NA
Air Filter - SFA3	6/6/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.4	±	0.1	2.2	±	0.2	**	Pass	NA
Air Filter - SFA3	8/29/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	3.5	±	0.1	3.3	±	0.2	**	Pass	NA
Air Filter - SFA3	10/31/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	0.9	±	0.1	1.1	±	0.1	**	Pass	NA
Air Filter - SFA3	11/15/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.2	±	0.1	1.5	±	0.1	**	Pass	NA
Air Filter - SFA4	1/10/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.7	±	0.2	2.8	±	0.2	**	Pass	NA
Air Filter - SFA4	4/18/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.4	±	0.1	1.4	±	0.1	**	Pass	NA
Air Filter - SFA4	4/25/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.7	±	0.1	1.7	±	0.1	**	Pass	NA
Air Filter - SFA4	5/2/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.2	±	0.1	2.0	±	0.1	**	Pass	NA
Air Filter - SFA4	6/6/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	2.0	±	0.1	2.1	±	0.1	**	Pass	NA
Air Filter - SFA4	10/31/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	0.9	±	0.1	1.1	±	0.1	**	Pass	NA
Air Filter - SFA4	11/15/2022	Gross Beta	$10^{-2}$ pCi/m <sup>3</sup>	1.3	±	0.1	1.5	±	0.1	**	Pass	NA

Air Filter -	STATION-02	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.0 ± 0.1	3.1 ± 0.1	**	Pass	NA
Air Filter -	STATION-03	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.0 ± 0.2	3.1 ± 0.1	**	Pass	NA
Air Filter -	STATION-04	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.4 ± 0.3	3.2 ± 0.3	**	Pass	NA
Air Filter -	STATION-05	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.4 ± 0.2	3.4 ± 0.2	**	Pass	NA
Air Filter -	STATION-06	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.3 ± 0.2	3.4 ± 0.2	**	Pass	NA
Air Filter -	STATION-07	4/18/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.6 ± 0.2	3.6 ± 0.2	**	Pass	NA
Air Filter -	STATION-08	4/19/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.0 ± 0.2	3.3 ± 0.2	**	Pass	NA
Air Filter -	STATION-09	4/19/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.4 ± 0.2	3.2 ± 0.2	**	Pass	NA
Air Filter -	STATION-10	4/19/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.5 ± 0.2	3.5 ± 0.2	**	Pass	NA
Air Filter -	STATION-11	4/19/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.4 ± 0.2	3.2 ± 0.2	**	Pass	NA
Air Filter -	STATION-12	4/19/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.3 ± 0.2	3.4 ± 0.2	**	Pass	NA
Air Filter -	STATION-13	4/19/2022	Gross Beta	10 <sup>-2</sup> pCi/m <sup>3</sup>	3.4 ± 0.2	3.4 ± 0.2	**	Pass	NA
Air Iodine -	A1	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A2	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A3	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A4	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A5	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	SFA1	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	SFA2	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	SFA3	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	SFA4	1/18/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A1	2/15/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A2	2/15/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A3	2/15/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A4	2/15/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA
Air Iodine -	A5	2/15/2022	I-131	pCi/m <sup>3</sup>	<MDA	<MDA	**	Pass	NA

Air Iodine - SFA1	2/15/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA2	2/15/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA3	2/15/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA4	2/15/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A1	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A2	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A3	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A4	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A5	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA1	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA2	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA3	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA4	5/9/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A1	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A2	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A3	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A4	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A5	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA1	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA2	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA3	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA4	8/1/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A1	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A2	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A3	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A4	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A5	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA

Air Iodine - SFA1	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA2	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA3	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA4	9/6/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-02	10/4/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-04	10/4/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-07	10/4/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-08	10/4/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-09	10/4/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-11	10/4/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A1	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A2	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A3	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A4	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A5	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA1	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA2	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA3	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA4	10/24/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A1	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A2	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A3	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A4	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A5	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA

Air Iodine - SFA1	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA2	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA3	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA4	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-02	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-04	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-07	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-08	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-09	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - STATION-11	12/19/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A1	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A2	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A3	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A4	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - A5	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA1	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA2	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA3	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Air Iodine - SFA4	12/27/2022	I-131	pCi/m3	<MDA	<MDA	**	Pass	NA
Soil- SFS3 <sup>1</sup>	2/21/2022	Gamma	pCi/kg	146 ± 61.9	212 ± 67.5	141 ± 83.0	Pass	Pass
Soil- SFS3	6/6/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Soil- SFS5	6/6/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Sediment- WBS2	6/21/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Air Filter - A1	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass
Air Filter - A2	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass

Air Filter -	A3	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass
Air Filter -	A4	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass
Air Filter -	A5	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass
Air Filter -	SFA1	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass
Air Filter -	SFA2	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass
Air Filter -	SFA3	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass
Air Filter -	SFA4	6/27/2022	Gamma	pCi/m3	<MDA	<MDA	<MDA	Pass	Pass
Cabbage-	IB8	6/27/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Water-	WA1	7/1/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Water-	WA2	7/1/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Cabbage-	IB4	7/25/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Tomato-	EAST	7/28/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Zucchini-	SSE	7/28/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Zucchini-	EAST	7/28/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Water-	WA1	7/29/2022	Gamma	pCi/L	<MDA	<MDA	<MDA	Pass	Pass
Water-	WA2	7/29/2022	Gamma	pCi/L	<MDA	<MDA	<MDA	Pass	Pass
Fish-	IA1	8/24/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Oysters-	IA3	8/24/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Collards-	IB4	9/19/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Kale-	IB5	9/19/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Water-	WA1	9/30/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Water-	WA2	9/30/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA

Sediment-	WB1	10/3/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Milk-	Farm A	10/5/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	Farm B	10/3/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Oysters-	IA3	10/11/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Oysters-	IA6	10/11/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Vegetation									
-	SFB1	11/15/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Vegetation									
-	SFB5	11/15/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Fish-	NORTH	11/15/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Fish-	WEST	11/15/2022	Gamma	pCi/kg	<MDA	<MDA	<MDA	Pass	Pass
Soil-	SFS3 <sup>1</sup>	11/15/2022	Gamma	pCi/kg	133 ± 55.3	169 ± 61.3	NA	Pass	NA
Soil-	SFS1	11/15/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Soil-	SFS2	11/15/2022	Gamma	pCi/kg	<MDA	<MDA	NA	Pass	NA
Milk-	18E1	11/22/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	19B1	11/22/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	G2-1Q	11/23/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	Farm A	11/28/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	Farm B	11/28/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Water-	WA1	11/29/2022	Gamma	pCi/L	<MDA	<MDA	<MDA	Pass	Pass
Water-	WA2	11/29/2022	Gamma	pCi/L	<MDA	<MDA	<MDA	Pass	Pass
Water-	4L	11/30/2022	Gamma	pCi/L	<MDA	<MDA	<MDA	Pass	Pass



Water-	Q9-1	11/30/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	Farm J	12/6/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	Farm S	12/6/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	Farm V	12/7/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Milk-	G2-1Q	12/7/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Water-	4L	12/29/2022	Gamma	pCi/L	<MDA	<MDA	<MDA	Pass	Pass
Water-	WA1	12/29/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
Water-	WA2	12/29/2022	Gamma	pCi/L	<MDA	<MDA	NA	Pass	NA
	DR05 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	12.4	13.9	**	PASS	**
	DR06 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	10.0	10.2	**	PASS	**
	DR07 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	11.2	9.3	**	PASS	**
	DR08 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	14.9	16.2	**	PASS	**
	DR09 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	11.1	9.7	**	PASS	**
	DR10 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	10.3	11.2	**	PASS	**
	DR11 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	12.0	11.2	**	PASS	**
	SFDR14 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	81.9	78.0	**	PASS	**
	SFDR15 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	39.4	37.2	**	PASS	**
	DR23 <sup>1</sup>	04/11/22	Ambient Radiation	mrem	17.2	16.5	**	PASS	**
	DR05 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	14.5	11.7	**	PASS	**
	DR06 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	9.49	10.8	**	PASS	**
	DR07 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	10.1	11.4	**	PASS	**
	DR08 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	16.9	15.5	**	PASS	**
	DR09 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	11.2	9.99	**	PASS	**
	DR10 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	11.2	10.5	**	PASS	**
	DR11 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	12.3	11.2	**	PASS	**

SFDR14 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	79.4	82.0	**	PASS	**
SFDR15 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	37.0	39.7	**	PASS	**
DR23 <sup>1</sup>	07/11/22	Ambient Radiation	mrem	17.4	16.0	**	PASS	**
DR05 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	11.7	13.0	**	PASS	**
DR06 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	11.6	11.4	**	PASS	**
DR07 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	11.3	11.4	**	PASS	**
DR08 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	13.1	16.9	**	PASS	**
DR09 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	11.3	11.4	**	PASS	**
DR10 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	10.2	10.4	**	PASS	**
DR11 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	13.2	11.9	**	PASS	**
SFDR14 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	89.2	87.3	**	PASS	**
SFDR15 <sup>1</sup>	10/11/22	Ambient Radiation	mrem	43.5	37.0	**	PASS	**
DR05 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	13.1	12.4	**	PASS	**
DR06 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	10.3	12.1	**	PASS	**
DR07 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	11.6	13.0	**	PASS	**
DR08 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	13.2	13.7	**	PASS	**
DR09 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	10.2	9.8	**	PASS	**
DR10 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	10.2	12.6	**	PASS	**
DR11 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	11.5	11.9	**	PASS	**
SFDR14 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	78.2	87.0	**	PASS	**
SFDR15 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	50.0	43.0	**	PASS	**
DR23 <sup>1</sup>	01/17/23	Ambient Radiation	mrem	13.1	12.4	**	PASS	**

<sup>1</sup> See discussion at the beginning of the Appendix

\*\* The nature of these samples precluded splitting them with an independent laboratory.

**TABLE C-3**

**Calvert Cliffs Nuclear Power Plant ODCM Required LLDs**

Selected Nuclides	Water pCi/l	Fish/Shellfish pCi/kg	Milk pCi/L	Sediment pCi/kg	Vegetation pCi/kg	Particulates <sup>1</sup> pCi/m <sup>3</sup>
H-3	2000	--	--	--	--	--
Mn-54	15	130	--	--	--	--
Co-58	15	130	--	--	--	--
Fe-59	30	260	--	--	--	--
Co-60	15	130	--	--	--	--
Zn-65	30	260	--	--	--	--
Zr-95/Nb-95	15	--	--	--	--	--
I-131	15 <sup>2</sup>	--	1	--	60	0.07 <sup>3</sup>
Cs-134	15	130	15	150	60	0.05
Cs-137	18	150	18	180	80	0.06
BaLa-140	15	--	15	--	--	--

<sup>1</sup>Gross Beta activity LLD = 0.01pCi/m<sup>3</sup>

<sup>2</sup>In accordance with the ODCM no drinking water pathway exists so the Gamma Isotopic LLD is used.

<sup>3</sup> Air samples for I-131 are collected separately on a charcoal radioiodine cannister

**APPENDIX D**  
**Land Use Survey**

Appendix D contains the results of a Land Use Survey conducted around Calvert Cliffs Nuclear Power Plant during this operating period. A table listing the raw data of this survey and a discussion of the results are included in this appendix.

Discussion

A Land Use Survey was conducted to identify, within a distance of 5 miles, the location of the nearest milk animal, the nearest residence, and the nearest garden greater than 50 m<sup>2</sup> in each of the nine sectors over land. A detailed description of the Land Use Survey is given in a separate document (Ref. 9). The position of the nearest residence and garden in each sector out to 5 miles is given in the adjacent table. An “\*” denotes a change in this sector since the 2021 Land Use Census.

<b>Table D-1</b>		
<b>Land Use Survey</b>		
Sector	Distance from Plant (miles)	
	Residence	Garden
SE	1.5	4.5
SSE	1.6	2.0*
S	1.6	1.9
SSW	1.5	1.6
SW	1.1	2.4
WSW	1.2	1.5
W	1.3	1.2
WNW	2.7	2.0
NW	2.0	2.1

The closest residence is situated in the SW sector and the nearest garden is in the West sector.

There are no animals producing milk for public consumption within the 5-mile radius. At a farm that spans the W to WNW Sectors, goats were identified as being used occasionally for meat consumption by the owners and not for milk or dairy. At this time there is no plan to sell these items to the public. The closest beef cattle for meat consumption are 3.0 miles in the South Sector.

Discussion with a local waterman indicate that oysters are still harvested in the vicinity of CCNPP.

## **APPENDIX E**

### **Additional Samples and Analysis Results**

Appendix E is a presentation of the analytical results for additional samples collected in the environs of CCNPP. These extra samples are not required by the ODCM (Ref. 6). Table E-1 lists the locations of all the additional samples and groundwater samples discussed below. The remaining tables in this appendix provide the results. Some of these samples were collected and analyzed to maintain the historical continuity for samples and sampling pathways discontinued when the Environmental Technical Specifications were changed in March, 1985.

Table E-4 through E-5 contain analytical results for additional samples taken from aquatic and atmospheric radiological pathways surrounding the plant. There were no positive detects for any non-natural Gamma emitters

The NEI Industry Groundwater Protection Initiative was established to determine the potential impact nuclear power plants may have on the surrounding environment due to unplanned releases of radioactive liquids. Under the Groundwater Protection Initiative, groundwater monitoring is accomplished through routine sampling of the water table around the plant (Ref. 16). Analysis is performed for gamma, tritium, alpha, beta, and various other radiological isotopes. Tables E-6 through E-12 contain the analytical results for samples taken from the various groundwater monitoring wells, subsurface drains, and rainwater. In 2019 MH24 was renamed to MH66/SSD3.

Groundwater samples were collected from 16 of 17 on-site piezometer tubes and three subsurface manholes in 2021. These locations are listed in Table E-1 and on Figure E-1, Site Map Groundwater Monitoring Wells. Figure E-2, Site Map RW Locations, shows precipitation collection sites. A piezometer tube is a shallow monitoring well which allows access to groundwater at a depth of approximately 40 feet beneath the site. Of the piezometer tubes sampled, only #11 piezometer, MH28 and MH30 showed any results greater than MDAs. This activity was previously identified and evaluated in December of 2005. The activity consists of tritium originating from normal radiological waste discharges and was previously reported in the Annual Radioactive Release Reports. The tritium contamination is contained on site. No drinking water has been affected; the groundwater at this location does not impact any drinking water pathway.

**TABLE OF CONTENTS - ANALYTICAL RESULTS**

Table	Title	Page
E-1	Locations of Non-Tech Spec and Radiological Groundwater Environmental Sampling Stations for Calvert Cliffs Nuclear Power Plant .....	93
E-2	Synopsis of 2022 Calvert Cliffs Nuclear Power Plant Non-Tech Spec Radiological Environmental Monitoring Program .....	94
E-3	Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2 Non-Tech Spec Radiological Environmental Monitoring Program .....	95
E-4	Concentration of Gamma Emitters in Bottom Sediment .....	96
E-5	Concentration of Iodine-131 in Filtered Air .....	97
E-6	Alpha Isotopic and Pu-241 in Groundwater .....	99
E-7	Gross Alpha Activity in Groundwater .....	100
E-8	Concentration of Radiostrontium in Groundwater .....	101
E-9	Concentration of Tritium in Groundwater .....	102
E-10	Concentration of Tritium in Surface Water, Precipitation, and Subsurface Drainage.....	103
E-11	Gross Concentration of Gamma Emitters in Groundwater .....	104
E-12	Gross Concentration of Gamma Emitters in Surface Water, Precipitation and MH .....	105
Figure	Title	Page
E-1	Site Map Groundwater Monitoring Wells .....	106
E-2	Site Map Rainwater Locations .....	107

**TABLE E-1**

**Locations of Non-Tech Spec and Radiological Groundwater Environmental Sampling Stations for Calvert Cliffs Nuclear Power Plant**

Non-Tech Spec Station	Description	Distance <sup>1</sup>		Direction <sup>1</sup>
		(KM)	(Miles)	(Sector)
WBS2	Discharge Area	0.3	0.2	N
WBS4	Camp Conoy/Rocky Point	3.0	1.9	SE
SFA2	Visitors Center	0.8 <sup>2</sup>	0.5 <sup>2</sup>	N <sup>2</sup>
<b>RGPP Station</b>				
	<b>Description</b>			
PZ11	45' - North side of Unit 1 near roll-up door			
PZ12	NW corner of Unit 1			
PZ13	Unit 1 RWT			
PZ15	Unit 2 RWT			
PZ18	45' - South side near stairwell to waterfront (idle)			
PZ19	10' - Southside near traveling screen trough			
PZ20	10' -Northside of MMD Shop			
PZ21	10' - In grass West of STP			
PZ22	10' - In grass West of STP			
PZ23	45' - S of SSB doors			
PZ24	45' - East of SSB near Unit 2 roll-up door			
PZ25	45' - South side near stairwell to waterfront			
PZ26	45' -SW of Spare Transformer			
PZ27	45' -SW of Spare Transformer			
PZ28	45' - SW corner of NRC Bldg			
PZ29	45' - East of Nitrogen Tank in road			
PZ30	45' -NE Corner of Turbine Bldg			
RW1	Met Tower			
RW2	Lower Lay Down Area			
RW3	Visitor's Center Overlook			
RW4	Waterfront			
RW5	Open Grass Area outside NSF PA exit			
RW6	U2 Turbine Building roll up door			
RW7	Open area north of Outfall 004			
RW8	Open area on north wing wall			
MH28	12'- Unit1 next to Feed Water Heater			
MH30	12'- Unit 2 next to elevator			
MH66/SSD3	45'- East of SSB and South of Turbine Bldg (formerly named MH-24)			
SW003	Waterfront south of Sewage Treatment Plant			
SW004	Waterfront Barge Dock Rd			

<sup>1</sup> Distance and direction from the central point between the two containment buildings

<sup>2</sup> Distance and direction from the central point of the ISFSI

**Table E-2**

**Synopsis of 2022 Calvert Cliffs Nuclear Power Plant  
Non-Tech Spec Radiological Environmental Monitoring Program**

Sample Type	Sampling Frequency <sup>1</sup>	Number of Locations	Number Collected	Analysis	Analysis Frequency <sup>1</sup>	Number Analyzed
<b>Aquatic Environment</b>						
Bottom Sediment	SA	2	4	Gamma	SA	4
<b>Atmospheric Environment</b>						
Air Iodine <sup>2</sup>	W	1	52	I-131	W	52

<sup>1</sup> W=weekly, M=monthly, Q=quarterly, SA=semiannual, A=annual, C=composite

<sup>2</sup> The collection device contains Charcoal



**Table E-3**

**Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2  
Non-Tech Spec Radiological Environmental Monitoring Program**

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range <sup>1</sup>	Location with Highest Annual Mean Name/Distance & Direction <sup>2</sup>	Highest Annual Mean (F) / Range <sup>1</sup>	Control Locations Mean (F)/Range
---	---	--------------------------------	---	--	--	----------------------------------

**There were No Positive Results in 2022 Non-Tech Spec samples of air and bottom sediment reported in Tables E-4 and E-5.**

<sup>1</sup> Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements at specified location is indicated in parentheses.

<sup>2</sup> Distance and direction from the central point between the two containment buildings.

**Table E-4**

**Concentration of Gamma Emitters in Bottom Sediment  
(Results in units of pCi/kg (dry)  $\pm 2$  )**

Sample Code	Sample Date	Gamma Emitters
WBS2		
Discharge Area	6/21/2022	*
	10/11/2022	*
WBS4 <sup>1</sup>		
Camp Conoy/ Rocky Point	6/21/2022	*
	10/11/2022	*

<sup>1</sup> Control Location

\* All Non-Natural Gamma Emitters <MDA

**Table E-5**

**Concentration of Iodine-131 in Filtered Air  
(Results in units of  $10^{-3}$  pCi/m<sup>3</sup> ± 2 )**

Start Date	Stop Date	SFA2 <sup>1</sup> Visitors Center
1/4/2022	1/10/2022	*
1/10/2022	1/18/2022	*
1/18/2022	1/24/2022	*
1/24/2022	1/31/2022	*
1/31/2022	2/7/2022	*
2/7/2022	2/15/2022	*
2/15/2022	2/21/2022	*
2/21/2022	3/1/2022	*
3/1/2022	3/7/2022	*
3/7/2022	3/14/2022	*
3/14/2022	3/21/2022	*
3/21/2022	3/28/2022	*
3/28/2022	4/4/2022	*
4/4/2022	4/11/2022	*
4/11/2022	4/18/2022	*
4/18/2022	4/25/2022	*
4/25/2022	5/2/2022	*
5/2/2022	5/9/2022	*
5/9/2022	5/16/2022	*
5/16/2022	5/23/2022	*
5/23/2022	5/31/2022	*
5/31/2022	6/6/2022	*
6/6/2022	6/13/2022	*
6/13/2022	6/20/2022	*
6/20/2022	6/27/2022	*
6/27/2022	7/5/2022	*
7/5/2022	7/11/2022	*
7/11/2022	7/18/2022	*
7/18/2022	7/25/2022	*
7/25/2022	8/1/2022	*
8/1/2022	8/8/2022	*
8/8/2022	8/15/2022	*
8/15/2022	8/22/2022	*
8/22/2022	8/29/2022	*
8/29/2022	9/6/2022	*
9/6/2022	9/12/2022	*
9/12/2022	9/19/2022	*
9/19/2022	9/26/2022	*
9/26/2022	10/3/2022	*

**Table E-5**

**Concentration of Iodine-131 in Filtered Air  
(Results in units of  $10^{-3}$  pCi/m<sup>3</sup> ± 2 )**

Start Date	Stop Date	SFA2 <sup>1</sup> Visitors Center
10/3/2022	10/10/2022	*
10/10/2022	10/17/2022	*
10/17/2022	10/24/2022	*
10/24/2022	10/31/2022	*
10/31/2022	11/7/2022	*
11/7/2022	11/15/2022	*
11/15/2022	11/21/2022	*
11/21/2022	11/28/2022	*
11/28/2022	12/5/2022	*
12/5/2022	12/12/2022	*
12/12/2022	12/19/2022	*
12/19/2022	12/27/2022	*
12/27/2022	1/3/2023	*

<sup>1</sup> Control Location  
\* <MDA

**Table E-6**

**Alpha Isotopic and Pu-241 in Groundwater  
(Results in units of pCi/L  $\pm$  2 )**

Station	Sample Date	AM-241 (AS)	CM-242 (AS)	CM-243/244 (AS)	PU-238 (AS)
PZ11	5/4/2022	<0.0718	<0.0382	<0.071	<0.1962
PZ24	10/19/22	<0.0335	<0.0553	<0.033	<0.0632

Station	Sample Date	U-233/234 (AS)	U-235 (AS)	U-238 (AS)	PU-239/240 (AS)
PZ11	5/4/2022	<0.0622	<0.0413	<0.0334	<0.0981
PZ24	10/19/22	0.934 $\pm$ 0.295	<0.0301	0.5441 $\pm$ 0.258	<0.1264

Station	Sample Date	Fe-55	Ni-63
PZ11	5/4/2022	<104.3	<4.99

**Table E-7**

**Gross Alpha Activity in Groundwater  
(Results in units of pCi/L  $\pm 2$  )**

Station	Sample Date	GR-A (DIS) (pCi/L)	GR-A (SUS) (pCi/L)
PZ11	5/4/2022	<0.766	<0.622
PZ12	5/4/2022	<2.66	<0.829
PZ13	5/4/2022	<0.885	<0.848
PZ15	5/4/2022	<1.25	<0.787
PZ24	5/3/2022	<1.31	1.87 $\pm$ 0.95
	10/19/2022	<1.76	<0.99
PZ25	5/3/2022	<1.27	<0.677
PZ29	5/3/2022	<1.34	<0.729
PZ30	5/3/2022	2.5 $\pm$ 1.1	<0.676
MH66/SSD3*	12/02/2022	<1.17	<0.852
MH-28	10/11/2022	<0.584	<0.489
MH-30	10/13/2022	<0.560	<0.491

\*Renamed from MH-24

**Table E-8**

**Concentration of Radiostrontium in Groundwater  
(Results in units of pCi/L  $\pm$  2 )**

Station	Sample Date	SR-89 (pCi/L)	SR-90 (pCi/L)
MH66/SSD3*	4/8/2022	<8.34	<0.856
MH28	4/12/2022	<7.27	<0.816
MH30	4/12/2022	<8.82	<0.862
PZ11	5/04/2022	<6.68	<0.837
PZ12	5/04/2022	<5.55	<0.902
PZ13	5/04/2022	<5.46	<0.843
PZ15	5/04/2022	<5.67	<0.761
PZ24	5/03/2022	<7.84	<0.871
PZ25	5/03/2022	<6.20	<0.829
PZ29	5/03/2022	<6.50	<0.863
PZ30	5/03/2022	<6.37	<0.844

---

\*Renamed from MH-24

**Table E-9**

**Concentration of Tritium in Groundwater**  
**(Results in units of pCi/L  $\pm$  2 )**  
By Piezometer Tube Locations

<b>SAMPLE DATE</b>	<b>11</b>	<b>12</b>	<b>13</b>	<b>15</b>	<b>19</b>	<b>20</b>	<b>21</b>	<b>22</b>	<b>23</b>	<b>24</b>	<b>25</b>	<b>26</b>	<b>27</b>	<b>28</b>	<b>29</b>	<b>30</b>
03/08/2022	186 $\pm$ 115	<180	<169	<192	ND	ND	ND	ND	ND	<194	<199	ND	ND	ND	<189	<199
05/03/2022	ND	ND	ND	ND	<200	<179	<179	<186	ND	<188	<189	ND	ND	ND	<188	<199
05/04/2022	<185	<180	<183	<200	ND	ND	ND	ND	<182	ND	ND	<193	<186	<177	ND	ND
08/09/2022	<186	<187	<188	<184	ND	ND	ND	ND	ND	<175	<176	ND	ND	ND	<194	<199
10/19/2022	ND	<174	<190	<173	ND	ND	ND	ND	ND	<196	<189	ND	ND	ND	<197	<194

---

<sup>ND</sup> No Data – Sample obtained as required



**Table E-10**

**Concentration of Tritium in Surface Water, Precipitation, and Subsurface Drainage  
(Results in units of pCi/L  $\pm$  2 )**

SAMPLE DATE	*MH-66 /SSD3	MH28	MH30	SW003	SW004	RW1	RW2	RW3	RW4	RW5	RW6	RW7	RW8
01/11/2022	ND	2560 $\pm$ 319	1870 $\pm$ 256	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
01/18/2022	<184	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
01/19/2022	ND	ND	ND	ND	ND	<175	<179	<179	<177	<175	<172	<191	<179
04/04/2022	ND	ND	ND	ND	ND	<177	<174	<189	<169	<167	<184	<195	<186
4/8/2022	<187	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4/12/2022	ND	644 $\pm$ 148	1580 $\pm$ 224	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
07/01/2022	ND	ND	ND	ND	ND	<180	<168	<171	<194	<176	<180	<191	<190
7/8/2022	<195	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
7/13/2022	ND	1440 $\pm$ 219	1700 $\pm$ 247	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
9/28/2022	ND	ND	ND	ND	ND	<179	<171	<178	<194	<187	<193	<182	<200
10/11/2022	ND	1770 $\pm$ 265	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
10/13/2022	ND	ND	1510 $\pm$ 241	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
12/02/2022	<180	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
12/13/2022	ND	ND	ND	ND	ND	<183	<185	<177	<173	<183	<180	<178	<191

\* MH24 Renamed MH-66/SSD3

ND No Data – sample obtained as required

**Table E-11**

**Gross Concentration of Gamma Emitters in Groundwater**  
**(Results in units of pCi/L  $\pm$  2 )**  
By Piezometer Tube Locations

SAMPLE DATE	11	12	13	15	19	20	21	22	23	24	25	26	27	28	29	30
5/3/2022	ND	ND	ND	ND	#	#	#	#	ND	#	#	ND	ND	ND	#	#
5/4/2022	#	#	#	#	ND	ND	ND	ND	#	ND	ND	#	#	#	ND	ND
10/19/2022	#	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND

# Non-Natural Gamma Emitters Less than Minimum Detectable Activity (MDA)

<sup>ND</sup> No Data – Biennial sample obtained as required.


**Table E-12**

**Gross Concentration of Gamma Emitters in Surface Water, Precipitation and MH (subsurface drains)  
(Results in units of pCi/L  $\pm$  2 )**

SAMPLE DATE	*MH66/SSD3	MH28	MH30	SW003	SW004	RW1	RW2	RW3	RW4
10/11/2022	ND	#	ND	ND	ND	ND	ND	ND	ND
10/13/2022	ND	ND	#	ND	ND	ND	ND	ND	ND
12/02/2022	#	ND	ND	ND	ND	ND	ND	ND	ND

\*MH24 Renamed as MH66/SSD3  
# All Non-Natural Gamma Emitters <MDA  
<sup>ND</sup> No Data - Sample obtained as required.

**Figure E-1**  
**Site Map Groundwater Monitoring Wells**

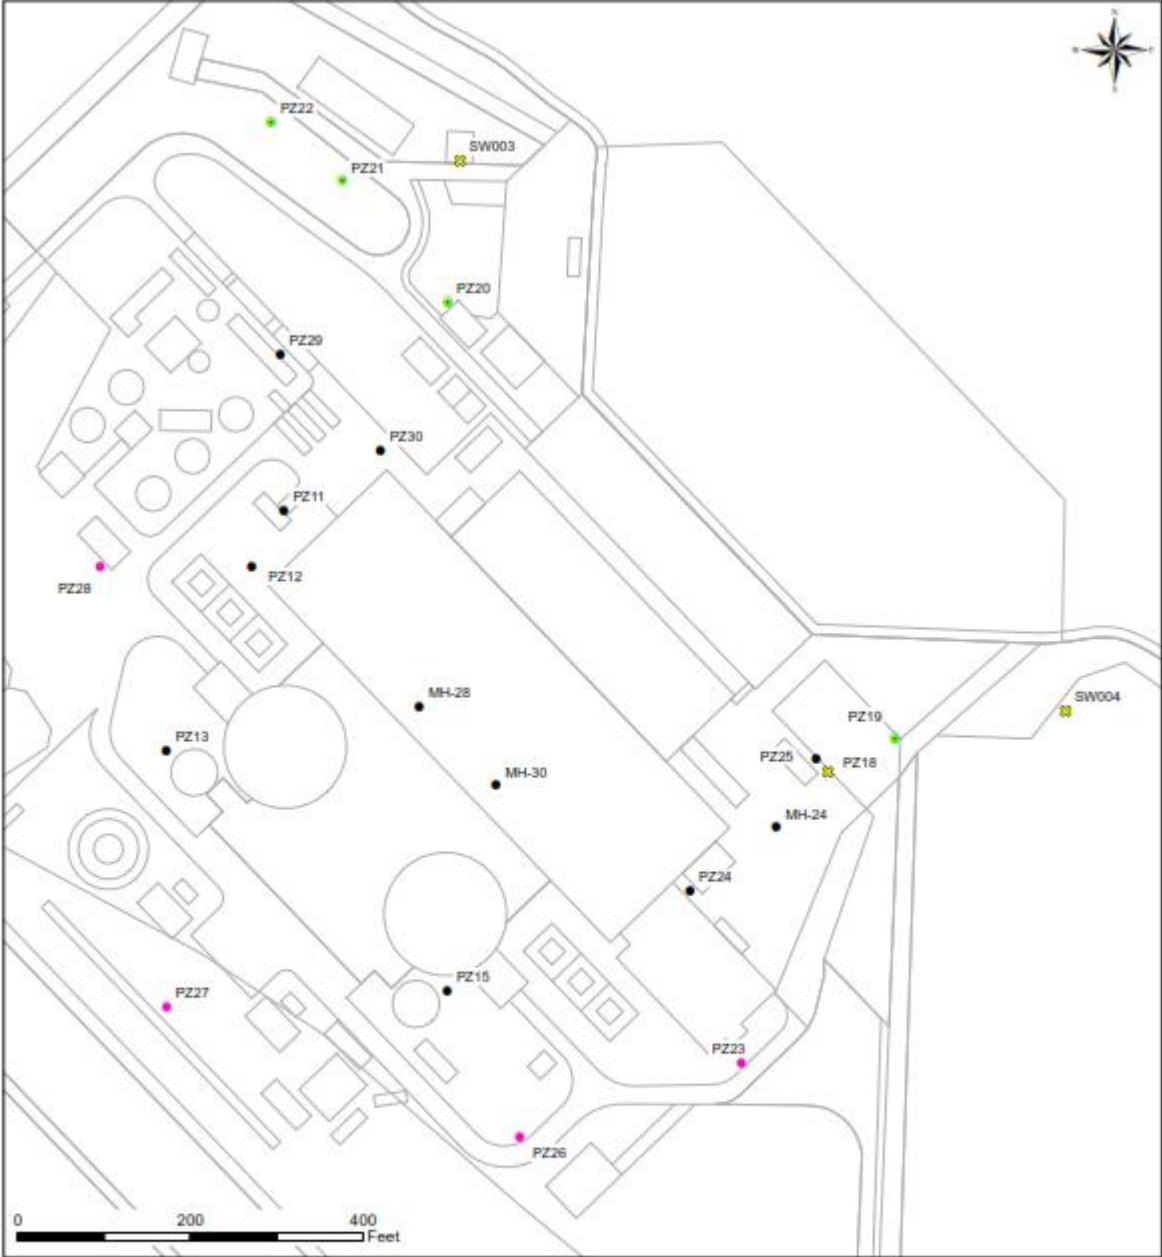

**Explanation:**  
**Modified RGPP Sample Locations**

- Background
- Perimeter
- Source
- Idle

Figure 1  
RGPP Sample Locations  
Overburden Aquifer  
Constellation Energy Corporation  
Calvert Cliffs Generating Station

**Figure E-2**  
**Site Map Rainwater Locations**

