

60A 61A 62A 63A 64A 65A 66A 67A 68A 69A

E

D

C

B

A


E

D

C

B

A

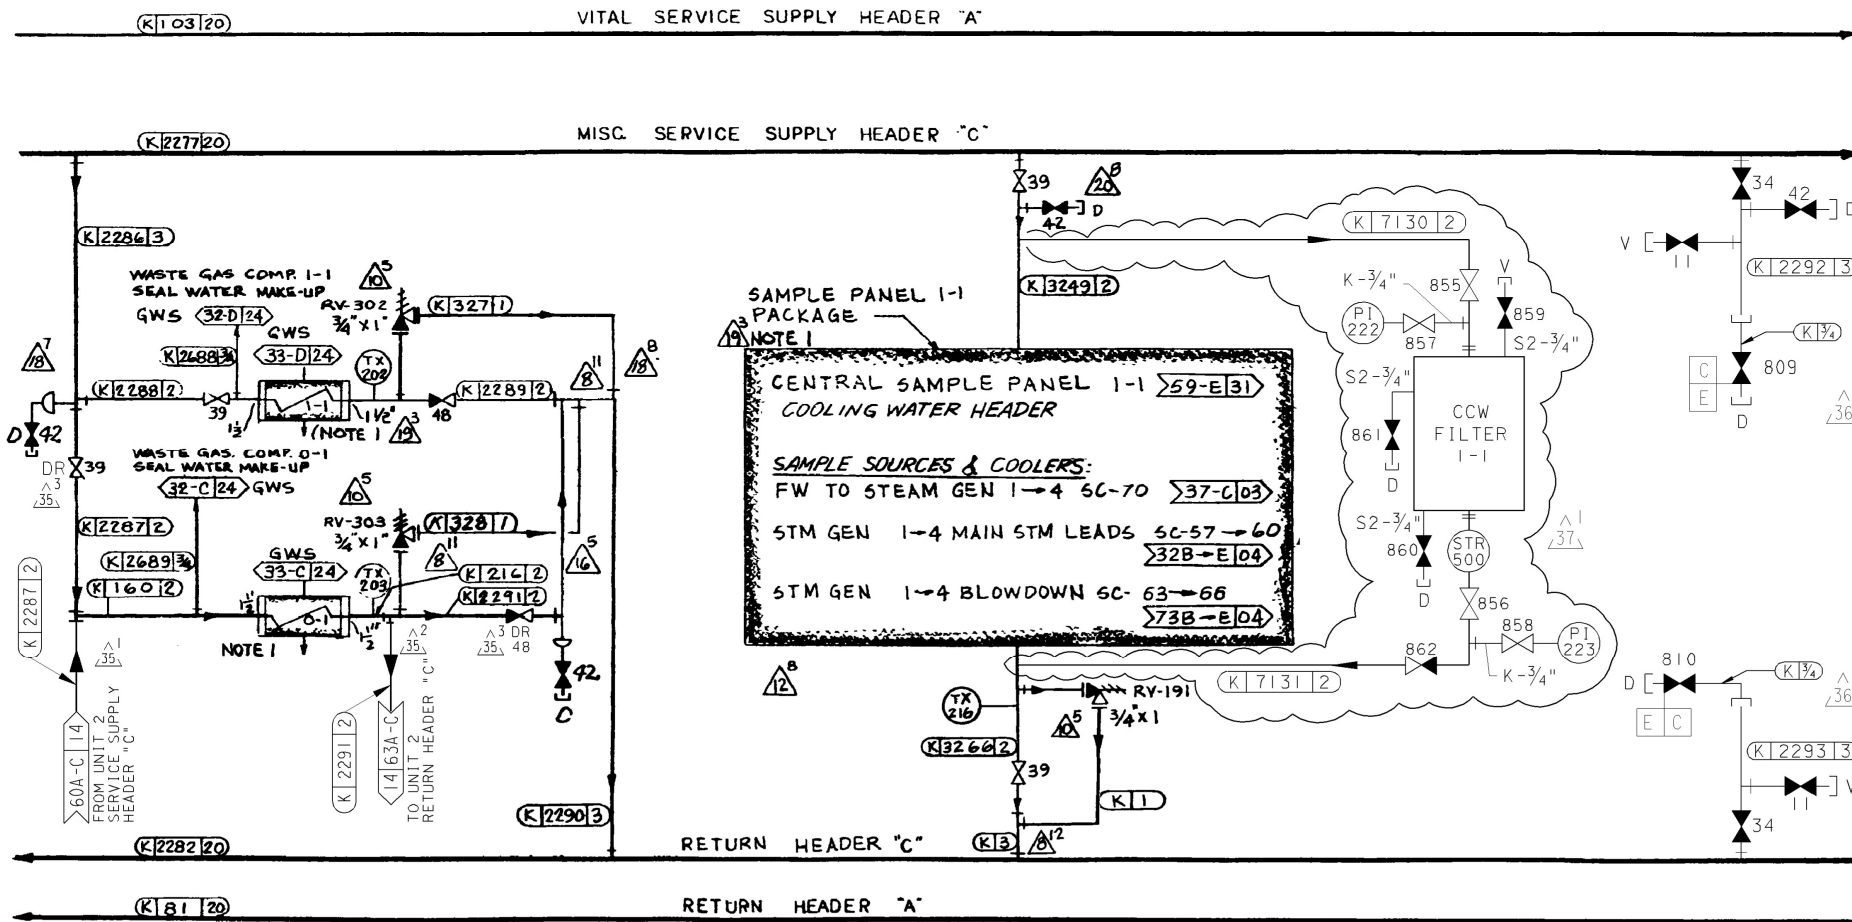

WASTE GAS COMPRESSORS 1-1, 0-1
SEAL WATER COOLERS
DC-663274-2

CENTRAL SAMPLE PANEL 1-1
COOLERS
DC-663108-5

NOTE

1. WASTE GAS COMPRESSOR SEAL WATER COOLERS & CENTRAL
SAMPLE PANEL COOLERS ARE DESIGN CLASS II & SEISMICALLY
ANALYZED IN ACCORDANCE WITH DESIGN CRITERIA
MEMORANDUM T-10 (FORMERLY M-61) 61A-C/D, 64A-D

HEADER "C" COMPONENTS

UNIT 1

DIABLO CANYON POWER PLANT - PG&E CO.
COMPONENT COOLING WATER SYSTEM

DRAWING	SHEET	PAGE	REV
102014	6A	0	37

RASTER=2014s6a.dgn
DCN=2014s6a.dgn
CAD User: AJFU Date: 02-25-2010

INPGIC
I Size

02-25-2010	AJFU	Fxc2		KERSI J. DALAL	MECHANICAL	M 16690	3/31/2010	REVISED PER DDN-2*169
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	