

130A

131A

132A

133A

134A

135A

136A

137A

138A

139A

A

B

C

D

E

A


B

C

D

E

ROOF AREA - ELEV. 163' - 4"
(480 SWITCHGEAR ROOM VENTILATION SYSTEM SUPPLY & EXHAUST)

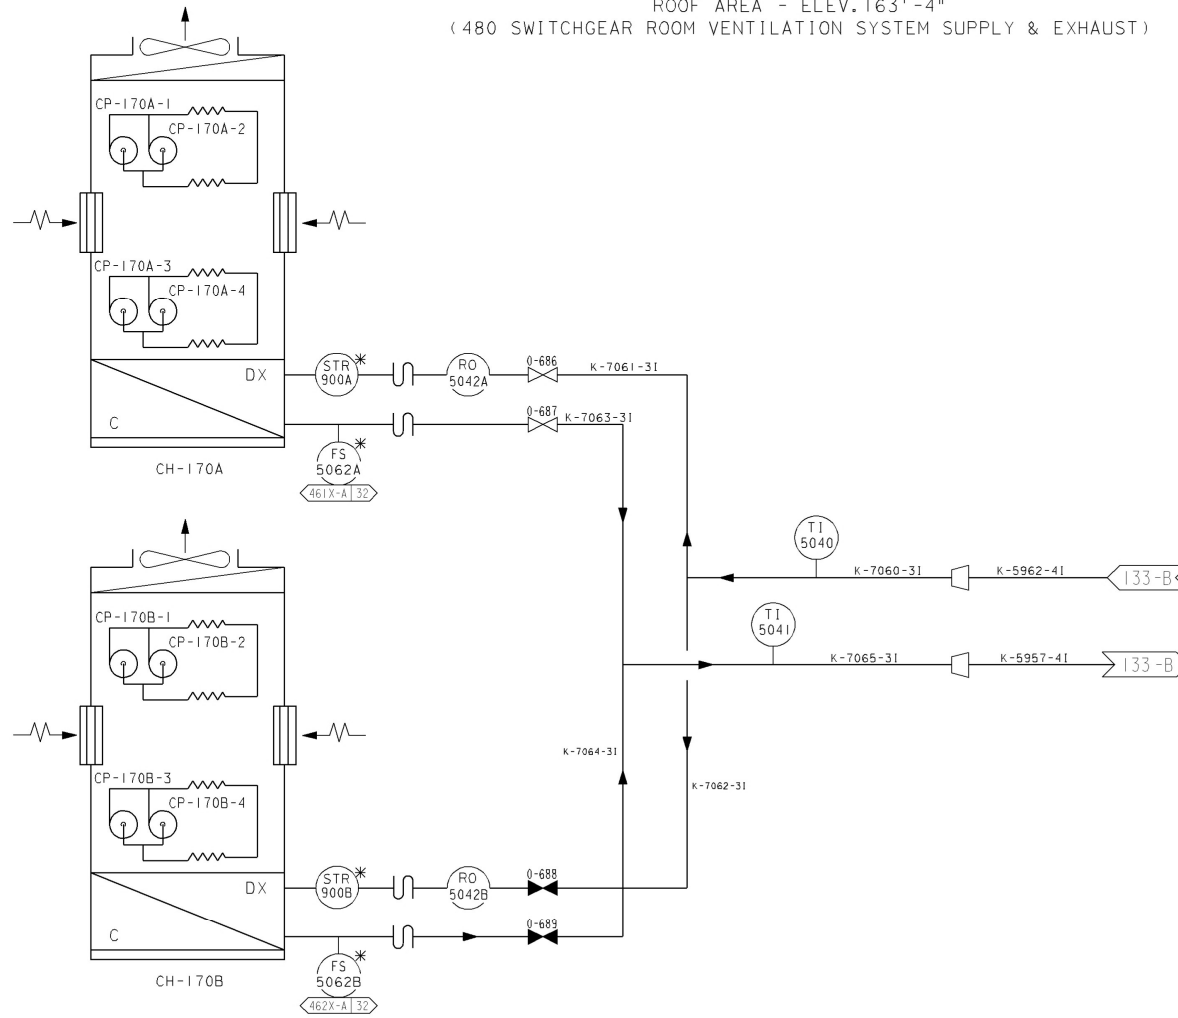

UNIT 1

DIABLO CANYON POWER PLANT - PG&E CO.

DRAWING

102023

SHEET

13A

PAGE

0

REV

1

10-07-2005	AJL2	FxC2		FRANCIS C. LING	MECHANICAL	M 16098	12/31/2005	REVISED PER DCI-SM-049694-00
DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	FCT-030407

RASTER=102023S13A.dgn
DGN=102023S13A.dgn
CAD User: AJL2 Date: 10-07-2005

INPG2ND
I Size