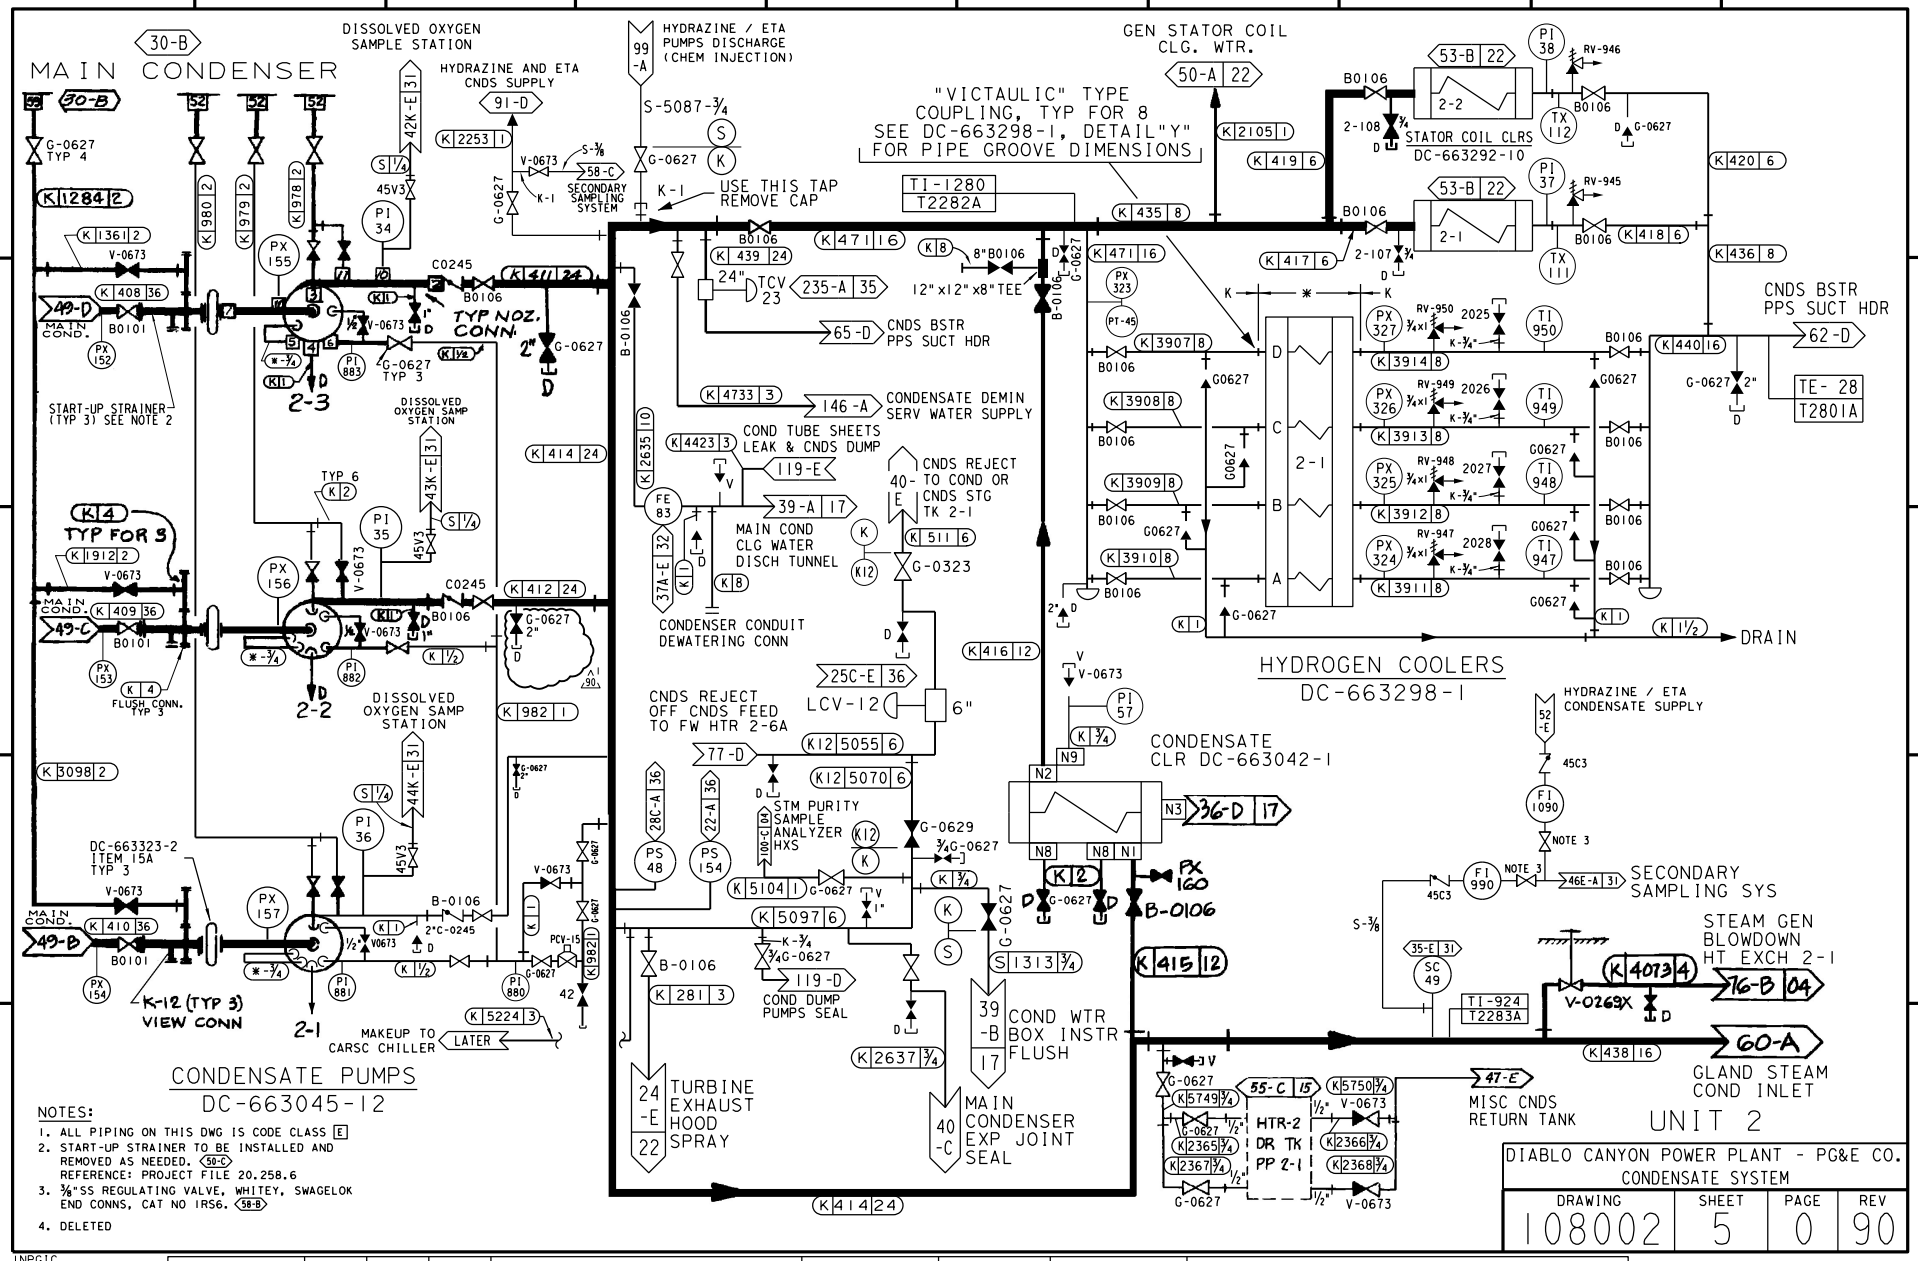

NOTES:

1. ALL PIPING ON THIS DWG IS CODE CLASS E
2. START-UP STRAINER TO BE INSTALLED AND REMOVED AS NEEDED. 50-C REFERENCE: PROJECT FILE 20.258.6
3. 3/8"SS REGULATING VALVE, WHITEY, SWAGELOK END CONNS, CAT NO 1RS6. 58-B
4. DELETED

DIABLO CANYON POWER PLANT - PG&E CO.
CONDENSATE SYSTEM

DRAWING	SHEET	PAGE	REV
108002	5	0	90

DATE	DWN	RE	IV	PROFESSIONAL ENGINEER	PE DISC.	PE#	PE EXP.	
11-14-2022	ZNS4	FXC2	N/A	NOT REQUIRED PER CF3.ID5	-	-	-	Revised Per DDT-4*2128

RASTER=108002-5-0.dgn
DGN=108002-5-0.dgn
CAD User: ZNS4 Date:11-14-2022

INPGIC
1 Size